



TRANE®

Geothermal/Water Source Heat Pump Product Data

- R-410A Refrigerant
- 2 - 6 Tons Single Stage
- 2 - 6 Tons Dual Stage

XL Series T1GX, T2GX



022-1853-01

Table of Contents

General Introduction	4
Model Nomenclature	5
AHRI Data	6-9
Design Features	10-11
Unit Components	12-13
Dimensional Data	14-17
Physical Data	18-19
Electrical Data	20-21
Auxiliary Heat Data	22
Blower Performance Data	23-24
Reference Calculations	25
Legend and Notes	25
Operating Limits	25
Correction Factor Tables	26
Performance Data	27-50
Wiring Schematics	51-56
Microprocessor Control	57-60
Operation Logic	61
Pressure Drop	61
Engineering Guide Specifications	62-63

XL Series T1GX, T2GX



Geothermal/Water Source Heat Pump:


The XI Series T1GX, T2GX products established a new industry standard for efficiency, performance, reliability and quiet operation. The T1GX Series product line is available in seven Single Stage sizes (2 to 6 tons) with high efficiency scroll compressors. The T2GX Series product line is available in five Dual Stage sizes (2 to 6 tons) with two-stage scroll compressors.

All XL Series T1GX, T2GX units utilize ozone-safe R-410A refrigerant to meet the most stringent EPA requirements. Coated air coils add durability and longer life. ECM2.3 blowers are used to increase comfort and efficiency. A sophisticated microprocessor control sequences all components during operation for optimum performance, and provides easy-to-use troubleshooting features with fault lights and on-board diagnostics. An Emerson Comfort Alert is also included to monitor compressor operation and faults. Unit configurations include vertical top, bottom, or rear discharge (left or right return) and horizontal units with left or right return, side or end discharge. Heavy-gauge metal cabinets are fully insulated and coated with an attractive and durable white paint for long lasting protection.

T1GX, T2GX Series products are performance-certified to AHRI ISO 13256-1 standards, are ETL listed, and are ENERGYSTAR® qualified.

As a leader in the industry, we are dedicated to innovation, quality and customer satisfaction. In fact, every unit built is exposed to a wide range of quality control procedures throughout the assembly process and is then subjected to a rigorous battery of computerized run tests to certify that it meets or exceeds performance standards for efficiency and safety, and will perform flawlessly at startup. As further affirmation of our quality standards, each unit carries our exclusive Quality Assurance emblem, signed by the final test technician.

Model Nomenclature

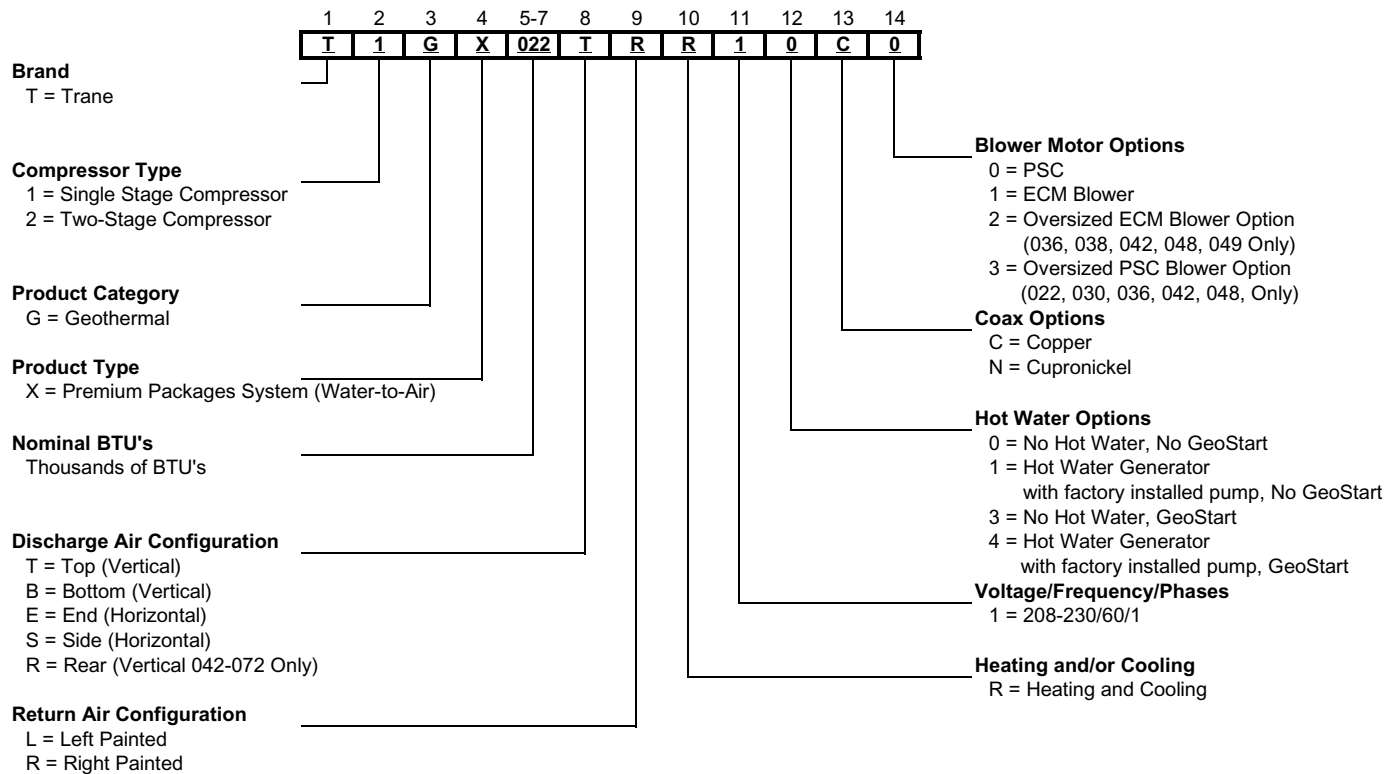

Notes:
All models have sound kits

AHRI Data

PSC Motors

AHRI/ASHRAE/ISO 13256-1

English (IP) Units

Model	Capacity Modulation	Flow Rate		Water Loop Heat Pump				Ground Water Heat Pump				Ground Loop Heat Pump			
				Cooling EWT 86°F		Heating EWT 68°F		Cooling EWT 59°F		Heating EWT 50°F		Cooling Brine Full Load 77°F Part Load 68°F		Heating Brine Full Load 32°F Part Load 41°F	
		gpm	cfm	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP
022	Single	8	850	20,600	17.2	25,000	6.0	23,000	28.0	19,800	5.0	21,200	20.3	15,000	3.8
030	Single	8	900	28,100	18.2	32,700	5.5	30,900	27.1	25,800	4.8	29,200	21.1	19,800	3.8
036	Single	9	1200	34,100	17.6	37,900	5.6	36,300	25.7	30,300	4.7	34,600	19.6	24,100	4.0
042	Single	11	1300	40,100	16.6	44,100	5.3	44,600	24.5	34,900	4.6	41,600	18.6	27,500	3.7
048	Single	12	1500	46,400	15.5	55,400	5.0	51,600	22.5	45,100	4.3	48,900	17.3	35,300	3.6
060	Single	15	1800	64,000	16.0	69,800	5.1	71,700	24.6	55,100	4.4	66,800	18.5	43,200	3.7
070	Single	18	2000	70,600	15.1	84,300	4.7	77,500	21.6	66,100	4.0	73,200	17.2	52,000	3.4

Cooling capacities based upon 80.6°F DB, 66.2°F WB entering air temperature
 Heating capacities based upon 68°F DB, 59°F WB entering air temperature
 All ratings based upon 208V operation

11/12/10

ECM2.3 Motors

AHRI/ASHRAE/ISO 13256-1

English (IP) Units

Model	Capacity Modulation	Flow Rate		Water Loop Heat Pump				Ground Water Heat Pump				Ground Loop Heat Pump			
				Cooling EWT 86°F		Heating EWT 68°F		Cooling EWT 59°F		Heating EWT 50°F		Cooling Brine Full Load 77°F Part Load 68°F		Heating Brine Full Load 32°F Part Load 41°F	
		gpm	cfm	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP
026	Full	8	950	26,000	16.0	31,000	5.5	29,000	24.0	25,300	5.0	27,200	18.6	19,500	4.2
	Part	7	750	19,500	18.6	22,600	6.3	22,000	31.2	18,100	5.4	21,500	26.8	16,200	4.7
038	Full	9	1300	39,000	17.2	42,200	5.5	39,400	24.1	34,800	5.0	40,200	20.1	27,000	4.2
	Part	8	1150	28,000	20.1	30,300	6.5	30,500	32.1	24,800	5.4	30,100	29.4	22,300	4.9
049	Full	12	1500	48,300	15.8	57,400	5.1	53,200	22.7	47,200	4.7	50,000	18.0	37,400	4.1
	Part	11	1300	35,900	18.1	41,900	6.1	37,800	28.3	34,000	5.2	38,700	25.1	31,000	4.7
064	Full	16	1800	64,500	16.2	72,500	5.1	70,700	22.7	56,800	4.6	67,600	18.0	45,800	3.9
	Part	14	1500	47,000	18.2	51,500	5.8	51,500	29.3	39,600	4.8	51,100	25.6	36,000	4.2
072	Full	18	2000	71,000	15.0	86,700	5.0	79,900	20.4	67,900	4.4	73,600	16.8	54,100	3.8
	Part	16	1500	54,000	16.6	63,400	5.4	62,200	26.0	51,000	4.6	58,800	23.1	45,000	4.3
022	Single	8	850	20,700	17.5	25,300	6.2	23,500	30.0	19,800	5.3	21,700	21.0	15,000	4.0
030	Single	8	900	28,300	19.2	32,700	5.8	31,300	28.8	25,800	5.0	29,400	21.9	20,000	4.0
036	Single	9	1200	34,500	19.6	38,000	6.1	37,200	30.1	30,300	5.2	35,000	22.0	24,100	4.4
042	Single	11	1300	40,600	19.2	44,100	5.9	45,200	29.5	34,900	5.2	42,000	21.4	27,500	4.2
048	Single	12	1500	47,000	17.5	55,400	5.5	52,000	26.1	45,100	4.8	49,300	19.7	35,300	4.0
060	Single	15	1800	64,300	17.2	69,800	5.4	72,000	26.1	55,100	4.7	66,800	19.5	43,200	3.9
070	Single	18	2000	70,600	16.0	84,300	5.1	79,100	23.8	66,100	4.4	73,200	18.2	52,000	3.7

Cooling capacities based upon 80.6°F DB, 66.2°F WB entering air temperature
 Heating capacities based upon 68°F DB, 59°F WB entering air temperature
 All ratings based upon 208V operation

3/23/11

AHRI Data cont.

Energy Star Compliance Table

Model	Tier 1		Tier 2	
	Ground Water	Ground Loop	Ground Water	Ground Loop
022	E, P	E, P	E, P	E, P
030	E, P	E, P	E, P	E, P
036	E, P	E, P	E, P	E, P
042	E, P	E, P	E, P	E, P
048	E, P	E, P	E, P	E, P
060	E, P	E, P	E, P	E, P
070	E, P	E, P	E, P	E
026	E	E	E	E
038	E	E	E	E
049	E	E	E	E
064	E	E	E	E
072	E	E	E	E

E - Unit with ECM2.3 Blower
P - Unit with PSC Blower

1/4/11

Energy Star Rating Criteria

In order for water-source heat pumps to be Energy Star rated they must meet or exceed the minimum efficiency requirements listed below. Please note there are 3 Tier levels that dictate minimum efficiency for water source heat pumps. Only one tier level is active at a given moment.

Tier 1: 12/1/2009 – 12/31/2010

Water-to-Air	EER	COP
Ground Loop	14.1	3.3
Ground Water	16.2	3.6
Water-to-Water		
Ground Loop	15.1	3.0
Ground Water	19.1	3.4

Tier 2: 1/1/2011 – 12/31/2011

Water-to-Air	EER	COP
Ground Loop	16.1	3.5
Ground Water	18.2	3.8
Water-to-Water		
Ground Loop	15.1	3.0
Ground Water	19.1	3.4

Tier 3: 1/1/2012 – No Effective End Date Published

Water-to-Air	EER	COP
Ground Loop	17.1	3.6
Ground Water	21.1	4.1
Water-to-Water		
Ground Loop	16.1	3.1
Ground Water	20.1	3.5



AHRI Data cont.

The performance standard AHRI/ASHRAE/ISO 13256-1 became effective January 1, 2000 and replaces ARI Standards 320, 325, and 330. This new standard has three major categories: Water Loop (comparable to ARI 320), Ground Water (ARI 325), and Ground Loop (ARI 330). Although these standards are similar there are some differences:

Unit of Measure: The Cooling COP

The cooling efficiency is measured in EER (US version measured in Btuh per Watt. The Metric version is measured in a cooling COP (Watt per Watt) similar to the traditional COP measurement.

Water Conditions Differences

Entering water temperatures have changed to reflect the centigrade temperature scale. For instance the water loop heating test is performed with 68°F (20°C) water rounded down from the old 70°F (21.1°C).

Air Conditions Differences

Entering air temperatures have also changed (rounded down) to reflect the centigrade temperature scale. For instance the cooling tests are performed with 80.6°F (27°C) dry bulb and 66.2°F (19°C) wet bulb entering air instead of the traditional 80°F (26.7°C) DB and 67°F (19.4°C) WB entering air temperatures. 80.6/66.2 data may be converted to 80/67 using the entering air correction table. This represents a significantly lower relative humidity than the old 80/67 of 50% and will result in lower latent capacities.

Pump Power Correction Calculation

Within each model, only one water flow rate is specified for all three groups and pumping Watts are calculated using the following formula. This additional power is added onto the existing power consumption.

- Pump power correction = $(\text{gpm} \times 0.0631) \times (\text{Press Drop} \times 2990) / 300$

Where 'gpm' is waterflow in gpm and 'Press Drop' is the pressure drop through the unit heat exchanger at rated water flow in feet of head.

Blower Power Correction Calculation

Blower power is corrected to zero external static pressure using the following equation. The nominal airflow is rated at a specific external static pressure. This effectively reduces the power consumption of the unit and increases cooling capacity but decreases heating capacity. These Watts are significant enough in most cases to increase EER and COPs fairly dramatically over ARI 320, 325, and 330 ratings.

- Blower Power Correction = $(\text{cfm} \times 0.472) \times (\text{esp} \times 249) / 300$

Where 'cfm' is airflow in cfm and 'esp' is the external static pressure at rated airflow in inches of water gauge.

ISO Capacity and Efficiency Calculations

The following equations illustrate cooling calculations:

- ISO Cooling Capacity = Cooling Capacity (Btuh) + (Blower Power Correction (Watts) x 3.412)

- ISO EER Efficiency (W/W) = ISO Cooling Capacity (Btuh) x 3.412 / [Power Input (Watts) - Blower Power Correction (Watts) + Pump Power Correction (Watt)]

The following equations illustrate heating calculations:

- ISO Heating Capacity = Heating Capacity (Btuh) - (Blower Power Correction (Watts) x 3.412)

- ISO COP Efficiency (W/W) = ISO Heating Capacity (Btuh) x 3.412 / [Power Input (Watts) - Blower Power Correction (Watts) + Pump Power Correction (Watt)]

AHRI Data cont.

Comparison of Test Conditions

	ARI 320	ISO/AHRI 13256-1 WLHP	ARI 325	ISO/AHRI 13256-1 GWHP	ARI 330	ISO/AHRI 13256-1 GLHP
Cooling						
Entering Air - DB/WB °F	80/67	80.6/66.2	80/67	80.6/66.2	80/67	80.6/66.2
Entering Water - °F	85	86	50/70	59	77	77
Fluid Flow Rate	*	**	**	**	**	**
Heating						
Entering Air - DB/WB °F	70	68	70	68	70	68
Entering Water - °F	70	68	50/70	50	32	32
Fluid Flow Rate	*	**	**	**	**	**

Note *: Flow rate is set by 10°F rise in standard cooling test
 Part load entering water conditions not shown.
 WLHP = Water Loop Heat Pump; GWHP = Ground Water Heat Pump; GLHP = Ground Loop Heat Pump

Note **: Flow rate is specified by the manufacturer

Conversions:

Airflow (lps) = CFM x 0.472;
 ESP (Pascals) = ESP (in wg) x 249;

WaterFlow (lps) = GPM x 0.0631;
 Press Drop (Pascals) = Press Drop (ft hd) x 2990

Design Features

Features

- Ultra High AHRI/ISO 13256-1 Ratings.
 - 29.4 EER & 4.9 COP (size 038).
- High efficiency scroll in Single Stage units.
 - Sizes 022, 030, 036, 042, 048, 060, 070.
- Two-stage scroll compressors in Dual Stage units.
 - Modulating, switches from low to high without delay.
 - 67% capacity first stage.
 - 2-ton Dual Stage now available.
 - Sizes 026, 038, 049, 064, 072.
- Comfort Alert Control Module.
 - Monitors compressor operation and communicates with control board.
- Foil faced cleanable insulation.
- Double isolation mounted compressors.
- Improved air coil service access.
- Coated air coil.
- Foam coated coaxial heat exchanger and hot water generator.
- Optional GeoStart soft starter
 - Reduces start current (LRA) by 60%
 - Allows heat pump to go "off grid" more easily
 - Reduces light flicker and start-up noise
 - Improves compressor's start behavior

Application Flexibility

- Safe, efficient operation in a wide range of liquid temperatures (20°F to 120°F) and flow rates (as low as 1.5 GPM/ton in open loop applications when EWT >50°F).
- Top or rear air discharge for upflow or bottom discharge for counterflow installations in vertical units, side or end discharge for horizontal units.
- True left or right return air locations—vertical units include filter rack/duct collar.
- Variable-speed ECM2.3 blowers permit various duct applications.
- Narrow cabinet for easy movement through doorways.
- Internally trapped condensate piping for neat, compact installation (vertical upflow units only).
- Optional field-installed auxiliary electric heater.
- Corner-located electrical box for field wiring from two sides.
- Fuse-protected loop pump power block for easy wiring.
- Loop pump slaving feature allows multiple units to share one flow center.
- Relay to control field-mounted accessories.
- Field-selectable freeze sensing setting for well or closed loop systems.

Operating Efficiencies

- AHRI/ISO 13256-1 rating for heating COPs, cooling EERs and low water flow requirements.
- Optional hot water generator with internal pump generates hot water at considerable savings while improving overall system efficiency.
- High-stability expansion valve delivers optimum refrigerant flow over a wide range of conditions and provides bidirectional operation without troublesome check valves.
- Efficient scroll compressors operate quietly.
- Oversized coaxial tube water-to-refrigerant heat exchanger operates at low liquid pressure drops.
- Convoluted copper water tube functions efficiently at low flow rates.
- Oversized rifled copper tube/lanced aluminum fin air-to-refrigerant heat exchanger provides high efficiencies at low-face velocity.
- Large, low-RPM blowers with variable-speed motors provide quiet and efficient air movement with high static capability.
- Utilizes the ozone-friendly R-410A refrigerant which produces higher efficiencies and warmer discharge air temperatures.

Service Advantages

- Removable panels: three for the compressor compartment and one (on horizontals) or two (on verticals) for the air handling compartment to provide quick access to all internal components with ductwork in place.
- Easily accessible thermal expansion valve.
- Brass, swivel-type water connections for quick connection union, and elimination of wrenches and sealants during installation.
- Insulated divider and separate air handling/compressor access panels permit service testing without air bypass.
- Designed for front access in tight applications.
- LED fault and status lights with memory for easy diagnostics.
- Detachable thermostat connection strip for wiring convenience.
- Hot water pump shut-off switch for easy startup and service.
- Control box and blower motors have quick-attach wiring plugs for easy removal.
- Internal drop-out blower with permanently-lubricated ball bearing motor.
- High- and low-pressure service ports in refrigerant circuit.
- Blower and transformer powered from auxiliary heat supply (when installed) to provide emergency heat with open compressor circuit breaker.

Design Features cont.

Product Quality

- Heavy-gauge steel cabinets are painted with durable powder coat paint for long lasting beauty and service.
- Coaxial heat exchanger, refrigerant suction lines, hot water generator coil, and all water pipes are fully insulated to reduce condensation problems in low temperature operation.
- Coated air coils for extended life.
- Noise reduction features include double isolation mounted compressors and soft starting blower motors; insulated compressor compartment; interior cabinet insulation using 1/2-inch foil lined glass fiber. All units include compressor blanket for quiet operation.
- Safety features include high- and low-pressure refrigerant controls to protect the compressor; condensate overflow protection; freeze sensing to safeguard the coaxial heat exchanger; blower start detection; hot water high-limit hot water generator pump shutdown; Comfort Alert compressor monitoring; fault lockout enables emergency heat and prevents compressor operation until thermostat or circuit breaker is reset.

Microprocessor Benefits

- Digital auto-changeover thermostat with 3-stage heating/2-stage cooling holds precise temperature and provides varying blower speed control.
- Component sequencing delays for quiet startup, shutdown, and timed staging of auxiliary electric heat.
- ECM2.3 blower speed control provides higher supply air temperature in heating, better dehumidification in cooling, and quiet operation at reduced airflows in all modes.
- Hot water limit prevents scalding, and pump shuts down automatically when full unit capacity is needed for heating.

Options & Accessories

- Cupronickel heat exchangers for open loop applications
- Optional hot water generator with internally mounted pump and water heater plumbing connector
- Electronic auto-changeover thermostat with 3-stage heating/2-stage cooling
- 24 volt 1-inch electronic air cleaner
- Closed loop flow center
- Auxiliary electric heater
- Hose kits
- Filter rack/duct collar for horizontal units
- Additional accessory relay
- Oversized ECM2.3 blower motor
- Oversized PSC blower motor
- GeoStart soft starter


Manufacturing Quality

- All units are computer run-tested, with conditioned source water, in all modes to ensure efficiency and reliability.
- All refrigerant brazing is performed in a nitrogen atmosphere.
- All units are deep evacuated to less than 150 microns prior to refrigerant charging.
- All joints are helium leak-tested to ensure an annual leak rate of less than 1/4 ounce.
- All major components bar coded. Eliminating possibility of mis-matched parts built into unit.
- All assembly technicians thoroughly trained in proper quality procedures.
- Focus on geothermal products enables company to dedicate all resources to product.

Unit Components



- | | |
|---|---|
| ① High efficiency scroll (Single Stage), Two-stage scroll (Dual Capacity) | ⑪ Fault and status LEDs |
| ② Double isolation plate for compressor mounting | ⑫ ECM2.3 or PSC blower motor |
| ③ Coated air coil | ⑬ Oversize blower wheel |
| ④ Factory mounted filter rack | ⑭ Internally mounted auxiliary heater (vertical units) |
| ⑤ MERV 11 pleated filter standard | ⑮ Internally mounted control for auxiliary heater, external strips (horizontal units) |
| ⑥ Microprocessor control | ⑯ Plastic drain pan with overflow protection |
| ⑦ Comfort Alert compressor monitor | ⑰ Internally trapped condensate (vertical units) |
| ⑧ Copper heat exchanger (optional cupronickel) with foam coating | ⑱ Brass swivel water connections |
| ⑨ Fully insulated with foil lined material | ⑲ Optional hot water generator with internal pump |
| ⑩ Insulated divider panel | ⑳ Easy access to expansion valve |
| | ㉑ Optional GeoStart™ soft starter |

Vertical

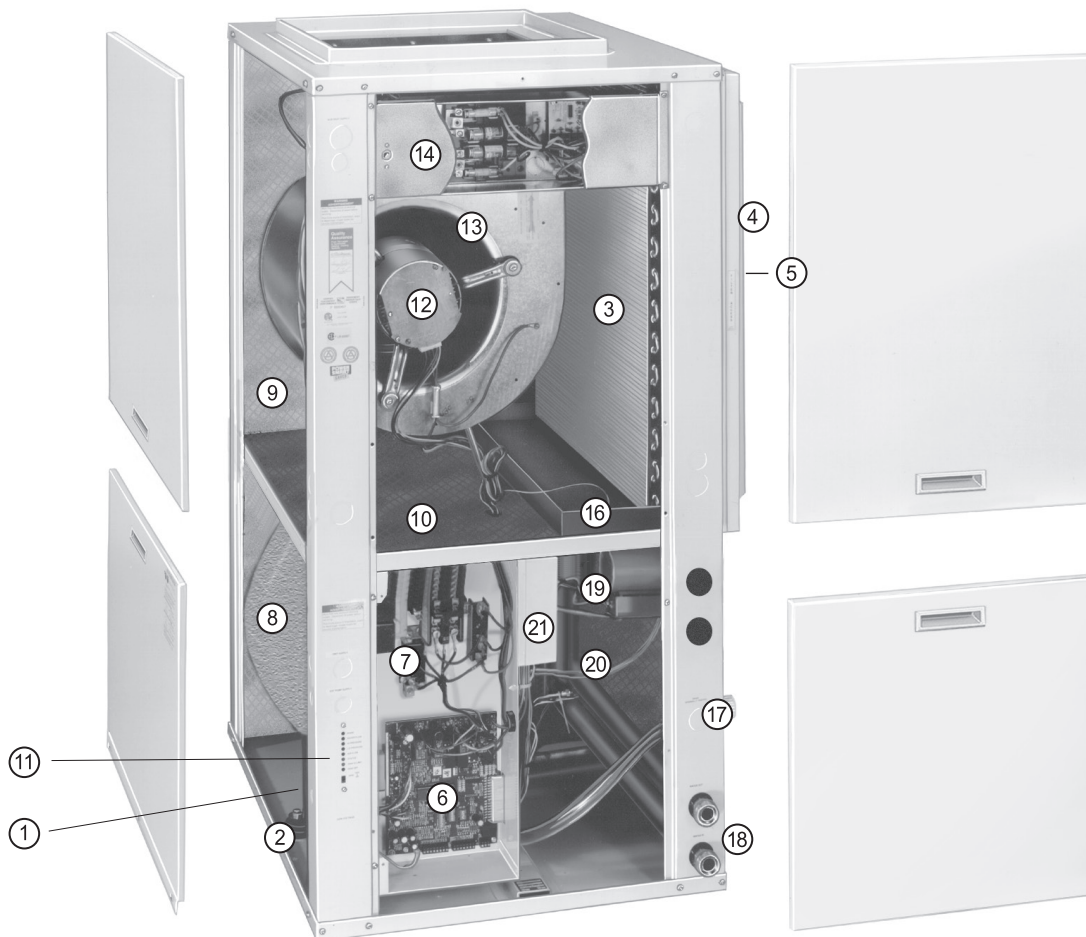


Unit Components cont.

Horizontal

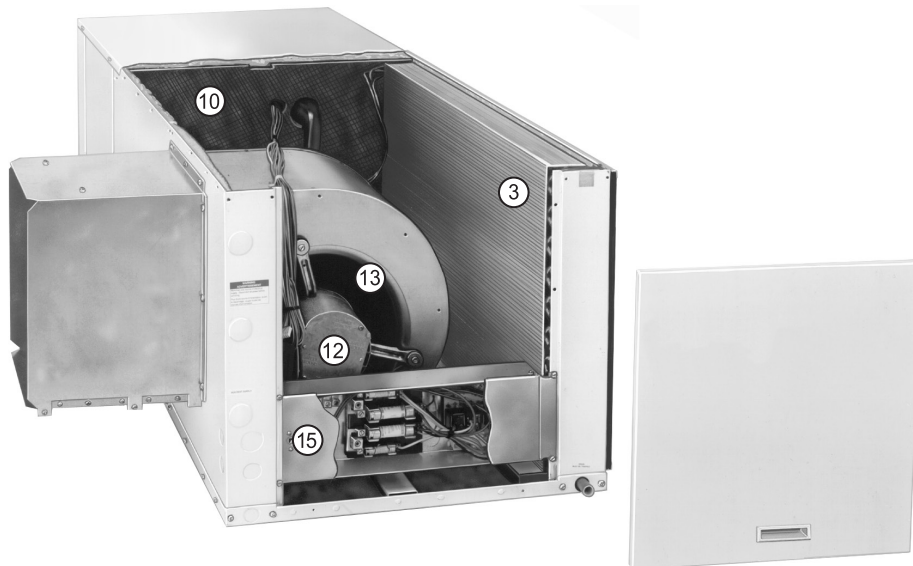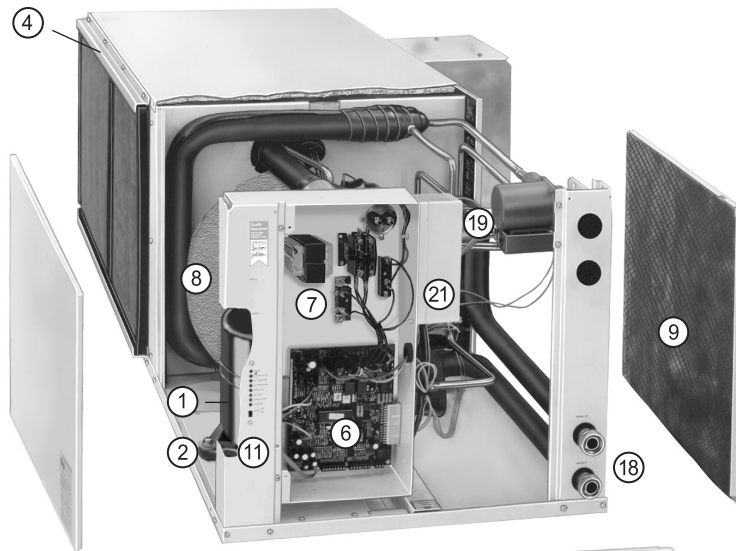

Vertical Dimensional Data

Top Air Discharge

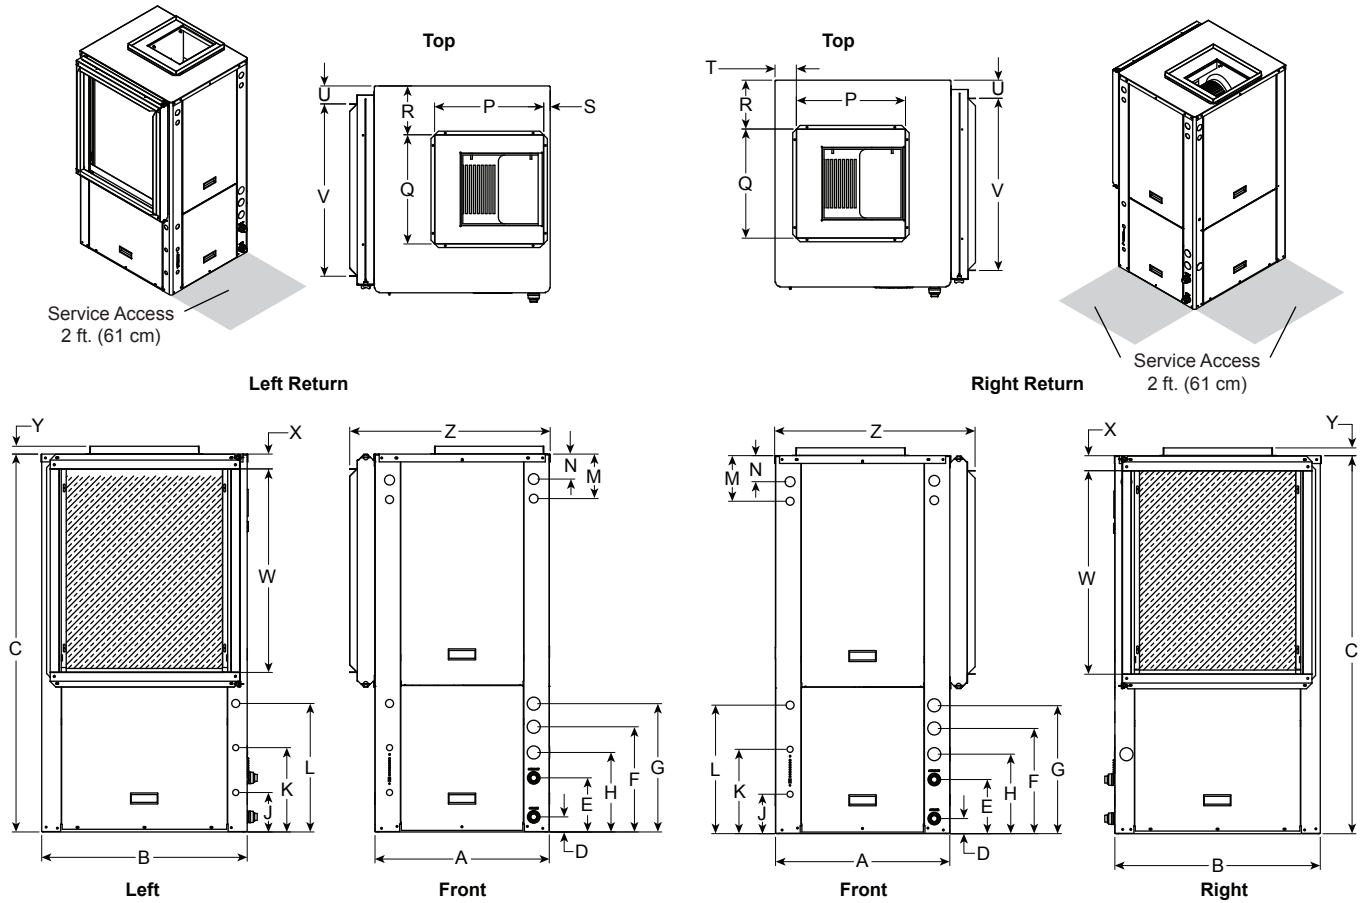

Vertical Topflow Model	Overall Cabinet			Water Connections							Electrical Connections					
	A	B	C	D	E	F	G	H	Loop Water FPT	HWG Sweat (I.D.)	J	K	L	M	N	
	Width	Depth	Height	Loop In	Loop Out	HWG In	HWG Out	Condensate			Low Voltage	Ext Pump	Power Supply			
022-030	in.	22.3	26.3	48.4	1.9	6.9	13.5	16.4	10.2	1" Swivel	1/2"	5.1	10.8	16.5	5.9	3.3
	cm.	56.6	66.8	122.9	4.8	17.5	34.3	41.7	25.9		Female	13.0	27.4	41.9	15.0	8.4
036-038	in.	25.4	31.4	50.4	2.3	7.3	15.9	18.9	10.6	1" Swivel	1/2"	6.5	12.2	17.9	5.9	3.3
	cm.	64.5	79.8	128.0	5.8	18.5	40.4	48.0	26.9		Female	16.5	31.0	45.5	15.0	8.4
042-049	in.	25.4	31.4	54.4	2.3	7.3	15.9	18.9	10.6	1" Swivel	1/2"	6.5	12.2	17.9	5.9	3.3
	cm.	64.5	79.8	138.2	5.8	18.5	40.4	48.0	26.9		Female	16.5	31.0	45.5	15.0	8.4
060-072	in.	25.4	31.4	58.4	2.3	7.3	15.9	18.9	10.6	1" Swivel	1/2"	6.5	12.2	17.9	5.9	3.3
	cm.	64.5	79.8	148.3	5.8	18.5	40.4	48.0	26.9		Female	16.5	31.0	45.5	15.0	8.4

Vertical Topflow Model	Discharge Connection duct flange installed (±0.10 in)						Return Connection using std deluxe filter rack (±0.10 in)					
	P	Q	R	S	T	U	V	W	X	Y	Z	
	Supply Width	Supply Depth					Return Depth	Return Height				
022-030	in.	14.0	14.0	6.2	0.8	2.7	2.3	22.1	26.1	2.0	1.0	25.7
	cm.	35.6	35.6	15.7	2.0	6.9	5.8	56.1	66.3	5.1	2.5	65.3
036-038	in.	18.0	18.0	6.9	1.1	3.8	1.7	28.1	26.0	2.0	1.0	28.7
	cm.	45.7	45.7	17.5	2.8	9.7	4.3	71.4	66.0	5.1	2.5	72.9
042-049	in.	18.0	18.0	6.9	1.1	3.8	1.7	28.1	30.0	2.0	1.0	28.7
	cm.	45.7	45.7	17.5	2.8	9.7	4.3	71.4	76.2	5.1	2.5	72.9
060-072	in.	18.0	18.0	6.9	1.1	3.8	1.7	28.1	34.0	2.0	1.0	28.7
	cm.	45.7	45.7	17.5	2.8	9.7	4.3	71.4	86.4	5.1	2.5	72.9

Condensate is 3/4 in/ PVC female glue socket and is switchable from side to front.

Unit is shipped with deluxe 2 in. (field adjustable to 1 in.) duct collar/filter rack extending from unit 3.5 in. and is suitable for duct connection.


Discharge flange is field installed and extends 1 in. [25.4 mm] from cabinet.

Water connections extend 1.2 in. [30.5 mm] beyond front of cabinet.

3/18/11

Vertical Dimensional Data cont.

Bottomflow

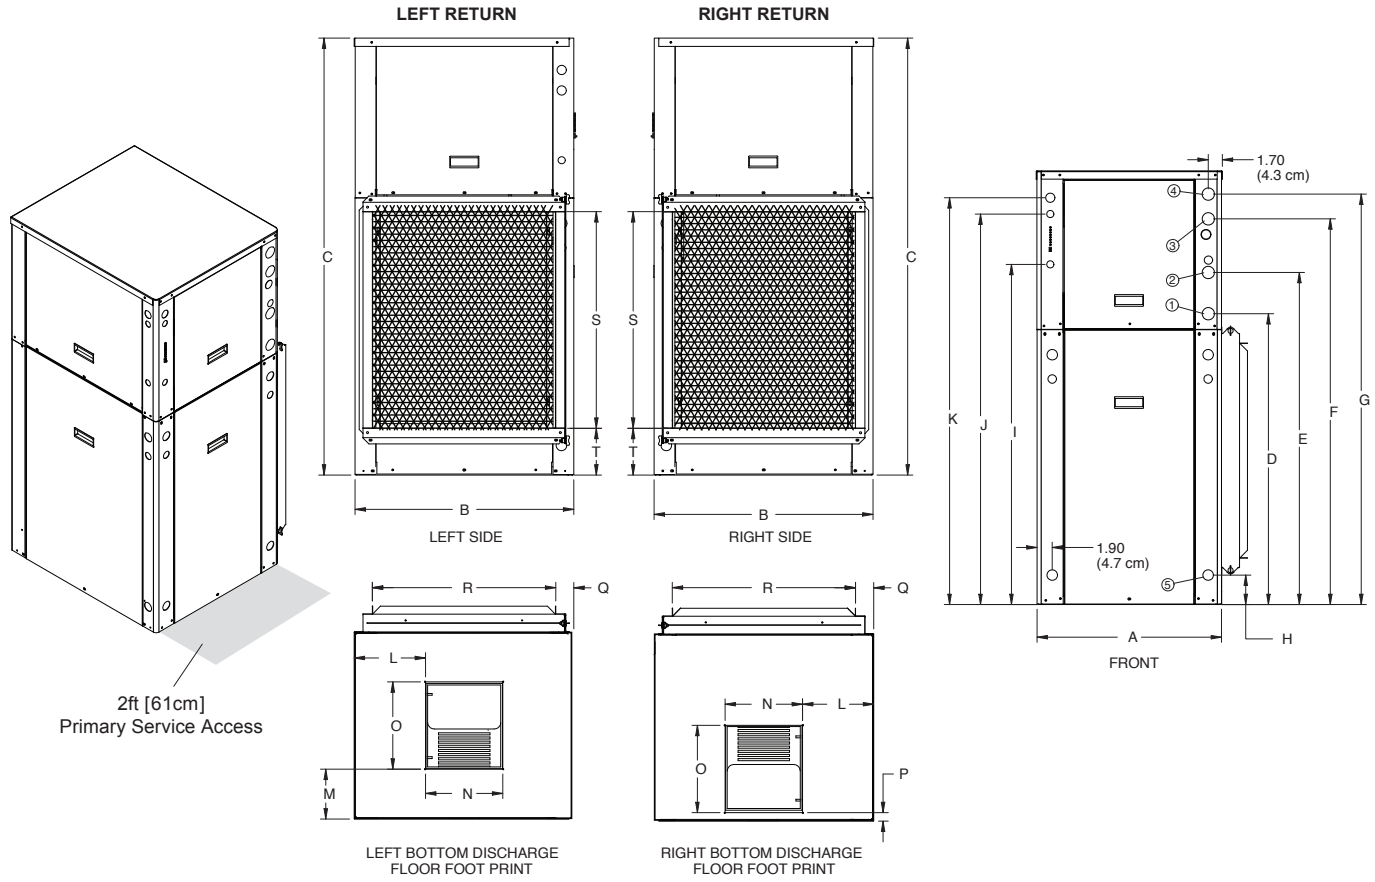

Bottomflow Models	Overall Cabinet			Water Connections					Electrical Knockouts					
	A	B	C	1	2	3	4	5	Loop Water FPT	HWG Sweat (I.D.)	I	J	K	
	Width	Depth	Height	D	E	F	G	H			1/2" cond Low Voltage	1/2" cond Ext Pump	3/4" cond Power Supply	
022-030	in.	22.5	26.5	52.5	35.3	40.2	46.7	49.7	3.6	1" Swivel	1/2" female	41.9	43.6	45.1
	cm.	57.2	67.3	133.4	89.7	102.1	118.6	126.2	9.1			106.4	110.7	114.6
036-072	in.	25.5	31.5	62.5	43.4	48.4	57.0	60.0	3.6	1" Swivel	1/2" female	48.9	50.8	52.2
	cm.	64.8	80.0	158.8	110.2	122.9	144.8	152.4	9.1			124.2	129.0	132.6

Bottomflow Models	Discharge Connection duct flange installed (±0.10 in)					Return Connection using std deluxe filter rack (±0.10 in)				
	L	M	N	O	P	Q	R	S	T	
			Supply Width	Supply Depth			Return Depth	Return Height		
022-030	in.	8.6	6.0	9.3	10.5	1.0	2.2	22.2	26.0	5.6
	cm.	21.8	15.2	23.6	26.7	2.5	5.6	56.4	66.0	14.2
036-072	in.	9.1	4.8	13.4	13.6	1.5	1.8	28.1	34.0	5.6
	cm.	23.1	12.2	34.0	34.5	3.8	4.6	71.4	86.4	14.2

Condensate is 3/4 in/ PVC female glue socket and is switchable from side to front.


Unit is shipped with deluxe 2 in. (field adjustable to 1 in.) duct collar/filter rack extending from unit 3.5 in. and is suitable for duct connection.

Water connections extend 1.2 in. [30.5 mm] beyond front of cabinet.

3/18/11


Vertical Dimensional Data cont.

Rear Air Discharge

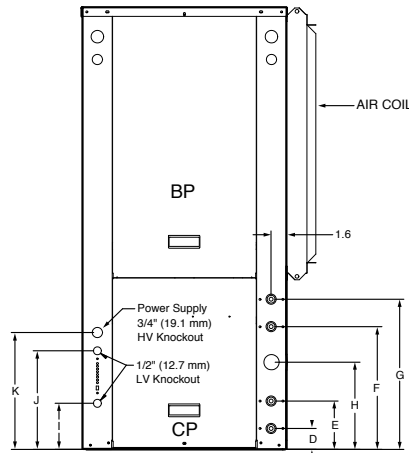


FRONT VIEW
Right Return


Legend
 AP = Alternate Service Panel
 BP = Blower Service Panel
 CP = Control Access Panel
 CMP = Compressor Service Panel

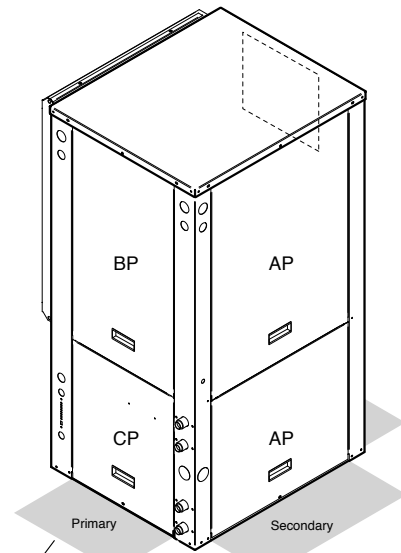


2ft [61cm]
Service Access Points

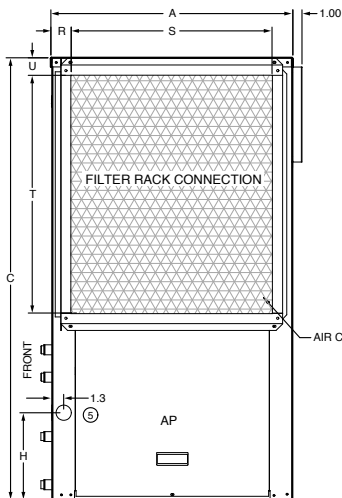


SIDE VIEW
Right Return

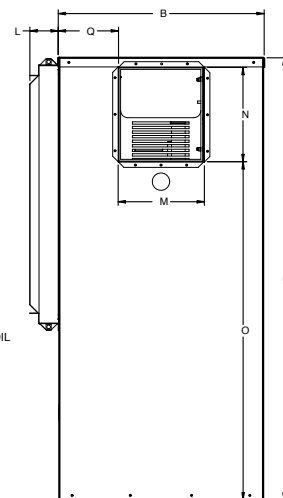

REAR VIEW
Right Return

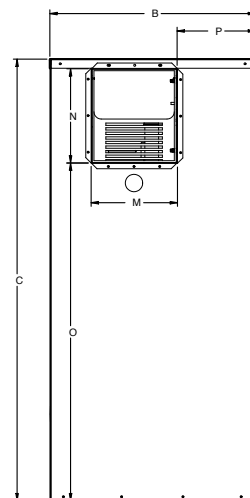

REAR VIEW
Left Return

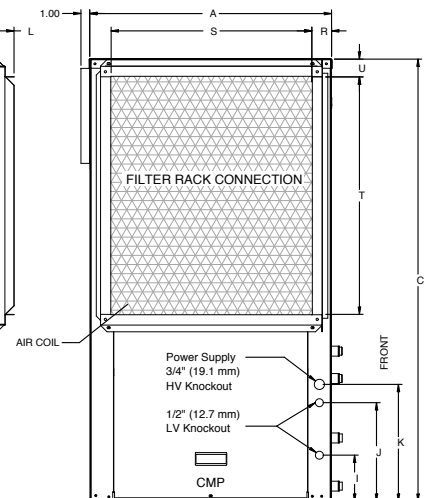

SIDE VIEW
Left Return


Vertical Top Flow Model	Overall Cabinet			Water Connections						Electrical Connections			
	A	B	C	D	E	F	G	H	Loop Water FPT	HWG Sweat (I.D.)	I	J	K
	Width	Depth	Height	Loop In	Loop Out	HWG In	HWG Out	Condensate			1/2" cond Low Voltage	1/2" cond Ext Pump	3/4" cond Power Supply
042-049	in. 25.6 cm. 65.0	in. 31.6 cm. 80.3	in. 54.4 cm. 138.2	in. 2.3 cm. 5.8	in. 7.3 cm. 18.5	in. 15.9 cm. 40.4	in. 18.9 cm. 48.0	in. 10.6 cm. 26.9	1" Swivel	1/2" female	in. 6.5 cm. 16.5	in. 12.3 cm. 31.2	in. 17.9 cm. 45.5
060-072	in. 25.6 cm. 65.0	in. 31.6 cm. 80.3	in. 58.4 cm. 148.3	in. 2.3 cm. 5.8	in. 7.3 cm. 18.5	in. 15.9 cm. 40.4	in. 18.9 cm. 48.0	in. 10.6 cm. 26.9	1" Swivel	1/2" female	in. 6.5 cm. 16.5	in. 12.3 cm. 31.2	in. 17.9 cm. 45.5

Vertical Top Flow Model	Discharge Connection duct flange installed (±0.10 in)					Return Connection using std deluxe filter rack (±0.10 in)				
	L	M	N	O	P	Q	R	S	T	U
	Supply Width	Supply Depth				Return Depth	Return Height			
042-049	in. 3.2 cm. 8.1	in. 13.3 cm. 33.8	in. 13.6 cm. 34.5	in. 39.4 cm. 100.1	in. 9.1 cm. 23.1	in. 8.0 cm. 20.3	in. 1.7 cm. 4.3	in. 28.1 cm. 71.4	in. 30.0 cm. 76.2	in. 1.5 cm. 3.8
060-072	in. 3.2 cm. 8.1	in. 13.3 cm. 33.8	in. 13.6 cm. 34.5	in. 43.2 cm. 109.7	in. 9.1 cm. 23.1	in. 8.0 cm. 20.3	in. 1.7 cm. 4.3	in. 28.1 cm. 71.4	in. 34.0 cm. 86.4	in. 1.5 cm. 3.8

Condensate is 3/4 in/ PVC female glue socket and is switchable from side to front.
 Unit is shipped with deluxe 2 in. (field adjustable to 1 in.) duct collar/filter rack extending from unit 3.5 in. and is suitable for duct connection.
 Discharge flange is field installed and extends 1 in. [25.4 mm] from cabinet.
 Water connections extend 1.2 in. [30.5 mm] beyond front of cabinet.

3/30/11

Horizontal Dimensional Data

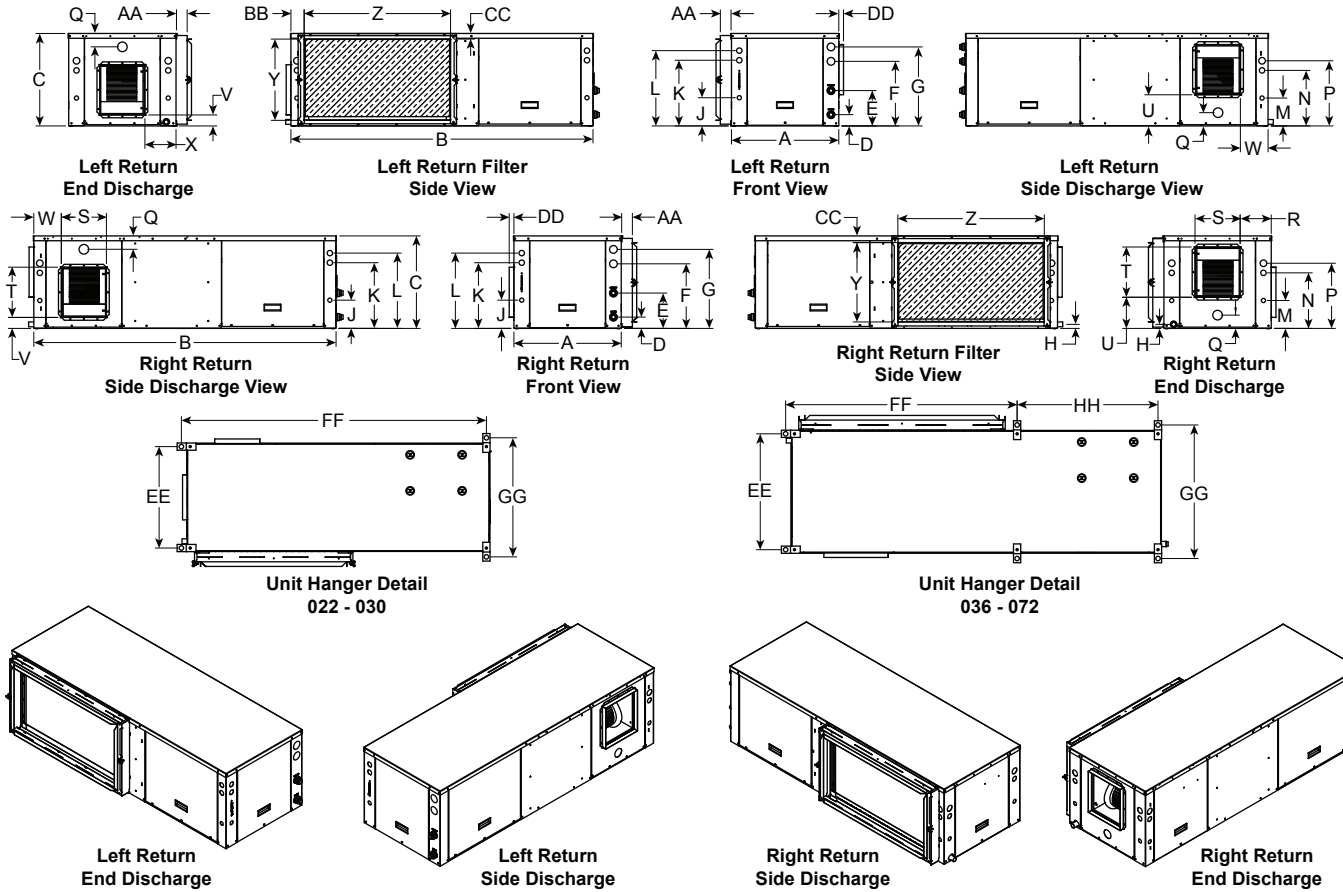

Horizontal Models	Overall Cabinet			Water Connections								Electrical Knockouts						
	A	B	C	D	E	F	G	H	Loop	HWG	J	K	L	M	N	P	Q	
	Width	Depth	Height*	Loop In	Loop Out	HWG In	HWG Out	Condensate	Water FPT	Sweat (I.D.)	Low Voltage	Ext Pump	Power Supply	Low Voltage	Ext Pump	Power Supply	Elec. Heat	
022-030	in.	22.5	63.0	19.2	2.4	7.4	13.4	16.4	1.1	1"	1/2"	5.9	13.7	15.7	5.8	11.6	13.6	2.5
	cm.	57.2	160.0	48.8	6.1	18.8	34.0	41.7	2.8	Swivel	Female	15.0	34.8	39.9	14.7	29.5	34.5	6.4
036-038	in.	25.5	72.0	21.2	2.2	7.2	15.8	18.8	1.1	1"	1/2"	5.9	13.7	15.7	5.8	13.7	15.7	2.5
	cm.	64.8	182.9	53.8	5.6	18.3	40.1	47.8	2.8	Swivel	Female	15.0	34.8	39.9	14.7	34.8	39.9	6.4
042-049	in.	25.5	77.0	21.2	2.2	7.2	15.8	18.8	1.1	1"	1/2"	5.9	13.7	15.7	5.9	13.7	15.7	2.5
	cm.	64.8	195.6	53.8	5.6	18.3	40.1	47.8	2.8	Swivel	Female	15.0	34.8	39.9	15.0	34.8	39.9	6.4
060-072	in.	25.5	82.0	21.2	2.2	7.2	15.8	18.8	1.1	1"	1/2"	5.9	13.7	15.7	5.9	13.7	15.7	2.5
	cm.	64.8	208.3	53.8	5.6	18.3	40.1	47.8	2.8	Swivel	Female	15.0	34.8	39.9	15.0	34.8	39.9	6.4

Horizontal Models	Discharge Connection duct flange installed (±0.10 in)								Return Connection using deluxe filter rack option (±0.10 in)				Unit Hanger Dimensions				PVC Drain Size		
	R	S	T	U	V	W	X	Y	Z	AA	BB	CC	DD	EE	FF	GG		HH	
		Supply Height	Supply Depth					Return Height	Return Depth										
022-030	in.	6.5	9.4	10.5	6.5	2.3	5.7	6.5	16.9	30.5	2.2	2.8	1.0	1.0	21.1	63.4	24.8	N/A	3/4"
	cm.	16.5	23.9	26.7	16.5	5.8	14.5	16.5	42.9	77.5	5.6	7.1	2.5	2.5	53.6	161.0	63.0		1.9
036-038	in.	4.5	13.4	13.7	4.8	2.8	6.8	7.5	18.7	35.5	2.2	2.8	1.0	1.0	24.1	43.1	27.8	29.3	3/4"
	cm.	11.4	34.0	34.8	12.2	7.1	17.3	19.1	47.5	90.2	5.6	7.1	2.5	2.5	61.2	109.5	70.6	74.4	1.9
042-049	in.	4.5	13.4	13.7	4.8	2.8	6.8	7.5	18.7	40.5	2.2	2.8	1.0	1.0	24.1	48.1	27.8	29.3	3/4"
	cm.	11.4	34.0	34.8	12.2	7.1	17.3	19.1	47.5	102.9	5.6	7.1	2.5	2.5	61.2	122.2	70.6	74.4	1.9
060-072	in.	4.5	13.4	13.7	4.8	2.8	6.8	7.5	18.7	45.5	2.2	2.8	1.0	1.0	24.1	53.1	27.8	29.3	3/4"
	cm.	11.4	34.0	34.8	12.2	7.1	17.3	19.1	47.5	115.6	5.6	7.1	2.5	2.5	61.2	134.9	70.6	74.4	1.9

Condensate is 3/4 in/ PVC female glue socket and is switchable from side to front.

Unit is shipped with deluxe 2 in. (field adjustable to 1 in.) duct collar/filter rack extending from unit 3.5 in. and is suitable for duct connection.

Discharge flange is field installed and extends 1 in. [25.4 mm] from cabinet.

Water connections extend 1.2 in. [30.5 mm] beyond front of cabinet.

3/24/11

Physical Data - Single Stage

Model	T1GX Single Stage							
	022	030	036	042	048	060	070	
Compressor (1 each)	Single Stage Scroll							
Factory Charge R-410A, oz [kg] Vertical	58 [1.64]	62 [1.76]	82 [2.32]	82 [2.32]	98 [2.78]	110 [3.12]	146 [4.14]	
Factory Charge R-410A, oz [kg] Horizontal	60 [1.70]	66 [1.87]	82 [2.32]	82 [2.32]	98 [2.78]	94 [2.67]	122 [3.46]	
Blower Motor & Blower								
Blower Motor Type/Speeds	ECM2.3	ECM2.3 Variable Speed						
	PSC	PSC 3 Speeds						
Blower Motor- hp [W]	ECM2.3	1/2 [373]	1/2 [373]	1/2 [373]	1/2 [373]	1/2 [373]	1 [746]	1 [746]
	PSC	1/5 [149]	1/3 [249]	1/2 [373]	1/2 [373]	1/2 [373]	1 [746]	1 [746]
Optional - Oversized PSC Blower Motor - hp [W]	PSC	1/3 [249]	1/3 [249]	1/2 [373]	3/4 [560]	3/4 [560]	N/A	N/A
Blower Wheel Size (Dia x W), in. [mm]	ECM2.3	9 x 7 [229 x 178]	9 x 7 [229 x 178]	11 x 10 [279 x 254]	11 x 10 [279 x 254]	11 x 10 [279 x 254]	11 x 10 [279 x 254]	11 x 10 [279 x 254]
	PSC	9 x 7 [229 x 178]	9 x 7 [229 x 178]	10 x 10 [254 x 254]	10 x 10 [254 x 254]	10 x 10 [254 x 254]	11 x 10 [279 x 254]	11 x 10 [279 x 254]
Coax and Water Piping								
Water Connections Size - Swivel - in [mm]	1" [25.4]	1" [25.4]	1" [25.4]	1" [25.4]	1" [25.4]	1" [25.4]	1" [25.4]	
HWG Connection Size - Female Sweat (I.D.) - in [mm]	1/2" [12.7]	1/2" [12.7]	1/2" [12.7]	1/2" [12.7]	1/2" [12.7]	1/2" [12.7]	1/2" [12.7]	
Coax & Piping Water Volume - gal [l]	0.7 [2.6]	1.0 [3.8]	1.3 [4.9]	1.3 [4.9]	1.6 [6.1]	1.6 [6.1]	2.3 [8.7]	
Vertical								
Air Coil Dimensions (H x W), in. [mm]	28 x 20 [711 x 542]	28 x 20 [711 x 542]	28 x 25 [711 x 635]	32 x 25 [813 x 635]	32 x 25 [813 x 635]	36 x 25 [914 x 635]	36 x 25 [914 x 635]	
Air Coil Total Face Area, ft ² [m ²]	3.9 [0.362]	3.9 [0.362]	4.9 [0.451]	5.6 [0.570]	5.6 [0.570]	6.3 [0.641]	6.3 [0.641]	
Air Coil Tube Size, in [mm]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	
Air Coil Number of rows	3	3	3	3	3	4	4	
Filter Standard - 2" [51mm] Pleated MERV11 Throwaway, in [mm]	28 x 24 [712 x 610]	28 x 24 [712 x 610]	28 x 30 [712 x 762]	32 x 30 [813 x 762]	32 x 30 [813 x 762]	36 x 30 [914 x 762]	36 x 30 [914 x 762]	
Weight - Operating, lb [kg]	303 [137]	318 [144]	363 [165]	378 [171]	418 [189]	453 [205]	478 [217]	
Weight - Packaged, lb [kg]	313 [142]	328 [149]	373 [169]	388 [176]	428 [194]	463 [210]	488 [221]	
Horizontal								
Air Coil Dimensions (H x W), in. [mm]	18 x 30 [457 x 762]	18 x 30 [457 x 762]	20 x 35 [508 x 889]	20 x 40 [508 x 1016]	20 x 40 [508 x 1016]	20 x 45 [508 x 1143]	20 x 45 [508 x 1143]	
Air Coil Total Face Area, ft ² [m ²]	3.9 [0.362]	3.9 [0.362]	4.9 [0.451]	5.6 [0.570]	5.6 [0.570]	6.3 [0.641]	6.3 [0.641]	
Air Coil Tube Size, in [mm]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	
Air Coil Number of rows	3	3	3	3	3	3	3	
Filter Standard - 2" [51mm] Pleated MERV11 Throwaway, in [mm]	1 - 18 x 32 [457 x 813]	1 - 18 x 32 [457 x 813]	1 - 20 x 37 [686 x 940]	1 - 20 x 20 [508 x 508] 1 - 20 x 22 [508 x 559]	1 - 20 x 20 [508 x 508] 1 - 20 x 22 [508 x 559]	1 - 20 x 25 [508 x 635] 1 - 20 x 22 [508 x 559]	1 - 20 x 25 [508 x 635] 1 - 20 x 22 [508 x 559]	
Weight - Operating, lb [kg]	305 [138]	320 [145]	368 [167]	383 [174]	423 [192]	458 [208]	483 [219]	
Weight - Packaged, lb [kg]	320 [145]	335 [152]	383 [174]	398 [180]	438 [199]	473 [214]	498 [226]	

3/23/11

Physical Data - Dual Stage

Model	T2GX Dual Stage				
	026	038	049	064	072
Compressor (1 each)	Two-Stage Scroll				
Factory Charge R-410A, oz [kg] Vertical	62 [1.76]	78 [2.21]	89 [2.52]	122 [3.46]	140 [3.97]
Factory Charge R-410A, oz [kg] Horizontal	60 [1.70]	76 [2.16]	89 [2.52]	124 [3.52]	160 [4.54]
ECM2.3 Blower Motor & Blower					
Blower Motor Type/Speeds	ECM2.3 Variable Speed				
Blower Motor- hp [W]	1/2 [373]	1/2 [373]	1/2 [373]	1 [746]	1 [746]
Blower Wheel Size (Dia x W), in. [mm]	9 x 7 [229 x 178]	11 x 10 [279 x 254]	11 x 10 [279 x 254]	11 x 10 [279 x 254]	11 x 10 [279 x 254]
Coax and Water Piping					
Water Connections Size - Swivel - in [mm]	1" [25.4]	1" [25.4]	1" [25.4]	1" [25.4]	1" [25.4]
HWG Connection Size - Female Sweat (I.D.) - in [mm]	1/2" [12.7]	1/2" [12.7]	1/2" [12.7]	1/2" [12.7]	1/2" [12.7]
Coax & Piping Water Volume - gal [l]	0.7 [2.6]	1.3 [4.9]	1.6 [6.1]	1.6 [6.1]	2.3 [8.7]
Vertical					
Air Coil Dimensions (H x W), in. [mm]	28 x 20 [711 x 542]	28 x 25 [711 x 635]	32 x 25 [813 x 635]	36 x 25 [914 x 635]	36 x 25 [914 x 635]
Air Coil Total Face Area, ft ² [m ²]	3.9 [0.362]	4.9 [0.451]	5.6 [0.570]	6.3 [0.641]	6.3 [0.641]
Air Coil Tube Size, in [mm]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]
Air Coil Number of rows	3	3	3	4	4
Filter Standard - 2" [51mm] Pleated MERV11 Throwaway, in [mm]	28 x 24 [712 x 610]	28 x 30 [712 x 762]	32 x 30 [813 x 762]	36 x 30 [914 x 762]	36 x 30 [914 x 762]
Weight - Operating, lb [kg]	303 [137]	368 [167]	418 [189]	463 [210]	478 [217]
Weight - Packaged, lb [kg]	313 [142]	378 [171]	428 [194]	473 [214]	488 [221]
Horizontal					
Air Coil Dimensions (H x W), in. [mm]	18 x 30 [457 x 762]	20 x 35 [508 x 889]	20 x 40 [508 x 1016]	20 x 45 [508 x 1143]	20 x 45 [508 x 1143]
Air Coil Total Face Area, ft ² [m ²]	3.9 [0.362]	4.9 [0.451]	5.6 [0.570]	6.3 [0.641]	6.3 [0.641]
Air Coil Tube Size, in [mm]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]	3/8 [9.5]
Air Coil Number of rows	3	3	3	4	4
Filter Standard - 2" [51mm] Pleated MERV11 Throwaway, in [mm]	1 - 18 x 32 [457 x 813]	1 - 20 x 37 [686 x 940]	1 - 20 x 20 [508 x 508] 1 - 20 x 22 [508 x 559]	1 - 20 x 25 [508 x 635] 1 - 20 x 22 [508 x 559]	1 - 20 x 25 [508 x 635] 1 - 20 x 22 [508 x 559]
Weight - Operating, lb [kg]	305 [138]	373 [169]	423 [192]	468 [212]	483 [219]
Weight - Packaged, lb [kg]	320 [145]	388 [176]	438 [199]	483 [219]	498 [226]

Electrical Data

ECM2.3 Motor

Model	Rated Voltage	Voltage Min/Max	Compressor			Blower Motor FLA	Total Unit FLA	Min Circ Amp	Max Fuse/HACR
			MCC	RLA	LRA				
T1GX022	208-230/60/1	197/253	14.0	9.0	48.0	4.0	13.0	15.2	20
T1GX030	208-230/60/1	197/253	20.0	12.8	58.3	4.0	16.8	20.0	30
T1GX036	208-230/60/1	197/253	22.0	14.1	73.0	4.0	18.1	21.6	35
T1GX036*	208-230/60/1	197/253	22.0	14.1	73.0	7.0	21.1	24.6	35
T1GX042	208-230/60/1	197/253	26.0	16.6	79.0	4.0	20.6	24.8	40
T1GX042*	208-230/60/1	197/253	26.0	16.6	79.0	7.0	23.6	27.8	40
T1GX048	208-230/60/1	197/253	31.0	19.8	109.0	4.0	23.8	28.8	45
T1GX048*	208-230/60/1	197/253	31.0	19.8	109.0	7.0	26.8	31.8	50
T1GX060	208-230/60/1	197/253	41.2	26.4	134.0	7.0	33.4	40.0	60
T1GX070	208-230/60/1	197/253	47.0	30.1	158.0	7.0	37.1	44.6	70
T2GX026	208-230/60/1	197/253	16.0	10.2	52.0	4.0	14.2	16.8	25
T2GX038	208-230/60/1	197/253	26.0	16.6	82.0	4.0	20.6	24.8	40
T2GX038*	208-230/60/1	197/253	26.0	16.6	82.0	7.0	23.6	27.8	40
T2GX049	208-230/60/1	197/253	33.0	21.1	96.0	4.0	25.1	30.4	50
T2GX049*	208-230/60/1	197/253	33.0	21.1	96.0	7.0	28.1	33.4	50
T2GX064	208-230/60/1	197/253	40.0	25.6	118.0	7.0	32.6	39.0	60
T2GX072	208-230/60/1	197/253	42.5	27.2	150.0	7.0	34.2	41.0	60

HACR circuit breaker in USA only

03/11

*With optional 1 HP ECM2.3 motor

Electrical Data cont.

PSC Motor

Model	Rated Voltage	Voltage Min/Max	Compressor			Blower Motor FLA	Total Unit FLA	Min Circ Amp	Max Fuse/HACR
			MCC	RLA	LRA				
T1GX022	208-230/60/1	197/253	14.0	9.0	48.0	1.2	10.2	12.4	20
T1GX022**	208-230/60/1	197/253	14.0	9.0	48.0	1.5	10.5	12.7	20
T1GX030	208-230/60/1	197/253	20.0	12.8	58.3	1.5	14.3	17.5	30
T1GX030**	208-230/60/1	197/253	20.0	12.8	58.3	2.2	15.0	18.2	30
T1GX036	208-230/60/1	197/253	22.0	14.1	73.0	2.8	16.9	20.4	30
T1GX036**	208-230/60/1	197/253	22.0	14.1	73.0	3.5	17.6	21.1	35
T1GX042	208-230/60/1	197/253	26.0	16.6	79.0	3.5	20.1	24.3	40
T1GX042**	208-230/60/1	197/253	26.0	16.6	79.0	4.6	21.2	25.4	40
T1GX048	208-230/60/1	197/253	31.0	19.8	109.0	3.5	23.3	28.3	45
T1GX048**	208-230/60/1	197/253	31.0	19.8	109.0	4.6	24.4	29.4	45
T1GX060	208-230/60/1	197/253	41.2	26.4	134.0	5.9	32.3	38.9	60
T1GX070	208-230/60/1	197/253	47.0	30.1	158.0	5.9	36.0	43.5	70

HACR circuit breaker in USA only

03/11

**With optional High-static PSC motor

Auxiliary Heat Ratings

Model	KW		Stages	BTU/HR		Min CFM	T1GX, T2GX Series Compatibility			
	208V	230V		208V	230V		022	026 - 030	036 - 042	048 - 072
EAM(H)5	3.6	4.8	1	12,300	16,300	450	•	•		
EAM(H)8	5.7	7.6	2	19,400	25,900	550	•	•		
EAM(H)10	7.2	9.6	2	24,600	32,700	650		•		
EAL(H)10	7.2	9.6	2	24,600	32,700	1100			•	•
EAL(H)15	10.8	14.4	3	36,900	49,100	1250			•	•
EAL(H)15-3	10.8	14.4	3	36,900	49,100	1250			•	•
EAL(H)20	14.4	19.2	4	49,200	65,500	1500				•

"H" is used in part number for horizontal units

Auxiliary Heat Electrical Data

Model	Supply Circuit	Heater Amps		Min Circuit Amp		Max Fuse (USA)		Max Fuse (CAN)		Max CKT BRK	
		208 V	240 V	208 V	240 V	208 V	240 V	208 V	240 V	208 V	240 V
Single Stage											
EAM(H)5	Single	17.3	20	26.7	30	30	30	30	30	30	30
EAM(H)8	Single	27.5	31.7	39.3	44.6	40	45	40	45	40	50
EAM(H)10	Single	34.7	40	48.3	55	50	60	50	60	50	60
EAL(H)10	Single	34.7	40	53.3	60	60	60	60	60	60	60
EAL(H)15	Single	52.0	60	75	85	80	90	80	90	70	100
	L1/L2	34.7	40	53.3	60	60	60	60	60	60	60
	L3/L4	17.3	20	21.7	25	25	25	25	25	20	30
EAL(H)20	Single	69.3	80	96.7	110	100	110	100	110	100	100
	L1/L2	34.7	40	53.3	60	60	60	60	60	60	60
	L3/L4	34.7	40	43.3	50	45	50	45	50	40	50
Dual Stage											
EAL(H)10	Single	34.7	40	53.3	60	60	60	60	60	60	60
EAL(H)15	Single	52.0	60	75	85	80	90	80	90	70	100
	L1/L2	34.7	40	53.3	60	60	60	60	60	60	60
	L3/L4	17.3	20	21.7	25	25	25	25	25	20	30
EAL(H)20	Single	69.3	80	96.7	110	100	110	100	110	100	100
	L1/L2	34.7	40	53.3	60	60	60	60	60	60	60
	L3/L4	34.7	40	43.3	50	45	50	45	50	40	50

All heaters rated single phase 60 cycle and include unit blower load
 All fuses type "D" time delay (or HACR circuit breaker in USA)
 Wire length based on one-way measurement with 2% voltage drop
 Wire sizes based on 60°C (*90°C) copper conductor
 "H" is used in part numbers for horizontal units

Blower Performance Data - PSC

Standard PSC Motor T1GX

Model	Blower Spd	Blower Size	Motor	Airflow (cfm) at External Static Pressure (in. wg)															
				0	0.05	0.10	0.15	0.20	0.25	0.30	0.35	0.40	0.45	0.50	0.60	0.70	0.80	0.90	1.00
022	H	9 x 7	1/5	1110	1095	1080	1065	1045	1020	995	970	945	915	880	810	-	-	-	-
	M			850	845	835	825	815	805	795	775	755	735	715	-	-	-	-	
	L			750	745	740	735	725	715	700	685	670	650	630	-	-	-	-	
030	H	9 x 7	1/3	1290	1270	1245	1220	1190	1160	1125	1090	1055	1020	985	880	760	-	-	-
	M			1100	1090	1075	1060	1045	1020	995	970	940	910	875	785	625	-	-	-
	L			910	905	900	895	885	875	865	850	835	810	780	710	560	-	-	-
036	H	10 x 10	1/2	1665	1640	1610	1580	1550	1515	1480	1450	1415	1315	1215	1090	980	-	-	-
	M			1465	1445	1425	1400	1375	1350	1325	1260	1190	1140	1090	990	890	-	-	-
	L			1130	1115	1100	1090	1075	1035	995	965	930	895	860	795	730	-	-	-
042	H	10 x 10	1/2	2010	1975	1940	1905	1870	1825	1780	1735	1690	1640	1590	1470	1210	-	-	-
	M			1670	1650	1630	1610	1590	1560	1530	1495	1460	1425	1390	1190	1080	-	-	-
	L			1220	1215	1210	1295	1200	1180	1160	1130	1100	1060	1020	930	-	-	-	-
048	H	10 x 10	1/2	2010	1975	1940	1905	1870	1825	1780	1735	1690	1640	1590	1470	1210	-	-	-
	M			1670	1650	1630	1610	1590	1560	1530	1495	1460	1425	1390	1190	1080	-	-	-
	L			1220	1215	1210	1295	1200	1180	1160	1130	1100	1060	1020	930	-	-	-	-
060	H	11 x 10	1	2430	2400	2365	2330	2290	2255	2215	2180	2140	2095	2045	1945	1835	1715	1510	1330
	M			2265	2235	2205	2175	2145	2110	2070	2035	2000	1960	1915	1825	1730	1605	1440	1260
	L			2075	2050	2020	1995	1965	1940	1915	1885	1850	1820	1785	1720	1610	1505	1335	1175
070	H	11 x 10	1	2430	2400	2365	2330	2290	2255	2215	2180	2140	2095	2045	1945	1835	1715	1510	1330
	M			2265	2235	2205	2175	2145	2110	2070	2035	2000	1960	1915	1825	1730	1605	1440	1260
	L			2075	2050	2020	1995	1965	1940	1915	1885	1850	1820	1785	1720	1610	1505	1335	1175

Factory settings are in Bold

3/21/11

Air flow values are with dry coil and standard filter

For wet coil performance first calculate the face velocity of the air coil (Face Velocity [fpm] = Airflow [cfm] / Face Area [sq ft]).

Then for velocities of 200 fpm reduce the static capability by 0.03 in. wg, 300 fpm by 0.08 in. wg, 400 fpm by 0.12in. wg, and 500 fpm by 0.16 in. wg.

Optional High Static PSC Motor T1GX

Model	Blower Spd	Blower Size	Motor HP	Airflow (cfm) at External Static Pressure (in. wg)															
				0	0.05	0.10	0.15	0.20	0.25	0.30	0.35	0.40	0.45	0.50	0.60	0.70	0.80	0.90	1.00
022	H	9 x 7	1/3	1290	1270	1245	1220	1190	1160	1125	1090	1055	1020	985	880	760	-	-	-
	M			1100	1090	1075	1060	1045	1020	995	970	940	910	875	785	625	-	-	-
	L			910	905	900	895	885	875	865	850	835	810	780	710	560	-	-	-
030	H	9 x 7	1/2	1365	1340	1325	1305	1280	1250	1215	1180	1140	1100	1055	960	850	-	-	-
	M			1040	1040	1035	1030	1020	1005	990	970	945	915	885	810	735	-	-	-
	L			880	880	880	880	875	870	860	840	820	800	775	730	480	-	-	-
036	H	10 x 10	1/2	1930	1905	1875	1840	1805	1765	1725	1680	1635	1530	1425	1270	1150	1025	-	-
	M			1635	1620	1600	1580	1555	1530	1505	1465	1425	1335	1240	1135	1035	775	-	-
	L			1230	1230	1225	1215	1200	1165	1130	1095	1060	1035	1005	935	795	675	-	-
042	H	10 x 10	3/4	2115	2075	2035	1980	1920	1900	1880	1840	1795	1730	1660	1390	1225	1070	-	-
	M			2005	1980	1950	1910	1865	1815	1765	1725	1685	1585	1485	1315	1140	1025	-	-
	L			1860	1835	1805	1780	1750	1715	1675	1635	1590	1540	1490	1260	1115	980	-	-
048	H	10 x 10	3/4	2115	2075	2035	1980	1920	1900	1880	1840	1795	1730	1660	1390	1225	1070	-	-
	M			2005	1980	1950	1910	1865	1815	1765	1725	1685	1585	1485	1315	1140	1025	-	-
	L			1860	1835	1805	1780	1750	1715	1675	1635	1590	1540	1490	1260	1115	980	-	-

Factory settings are in Bold

3/21/11

High-Static option not available for T1GX060 and T1GX070

Air flow values are with dry coil and standard filter

For wet coil performance first calculate the face velocity of the air coil (Face Velocity [fpm] = Airflow [cfm] / Face Area [sq ft]).

Then for velocities of 200 fpm reduce the static capability by 0.03 in. wg, 300 fpm by 0.08 in. wg, 400 fpm by 0.12in. wg, and 500 fpm by 0.16 in. wg.

Blower Performance Data - ECM2.3

Single Stage T1GX

MODEL	MAX ESP	AIR FLOW DIP SWITCH SETTINGS											
		1	2	3	4	5	6	7	8	9	10	11	12
022	0.50		400	500 L	600 M	700	800 H	900	1000	1100	1200		
030	0.50		400	500 L	600	700 M	800	900 H	1000	1100	1200		
036	0.50	650	750	850 L	1000	1100 M	1200	1300 H	1400	1500			
36 w/1hp*	0.75	800	1000 L	1100 M	1300 H	1500	1600	1800					
042	0.50	650	800	900 L	1050	1150 M	1250	1350 H	1450	1550			
42 w/1hp*	0.75	800	900 L	1000	1200 M	1400 H	1600	1700	1850	2000	2200	2300	2400
048	0.50	650	800	900	1050 L	1150	1250	1350 M	1450	1550 H			
48 w/1hp*	0.75	800	900	1000 L	1200	1400 M	1600 H	1700	1850	2000	2200	2300	2400
060	0.75	800	950	1100 L	1300	1500 M	1750	1950 H	2100	2300			
070	0.75	800	950	1100 L	1300	1500	1750 M	1950	2100 H	2300			

Factory settings are at recommended L-M-H DIP switch locations
 M-H settings MUST be located within boldface CFM range
 Lowest and Highest DIP switch settings are assumed to be L and H respectively

CFM is controlled within ±5% up to the maximum ESP
 Max ESP includes allowance for wet coil and standard filter

5/25/07

Dual Stage T2GX

MODEL	MAX ESP	AIR FLOW DIP SWITCH SETTINGS											
		1	2	3	4	5	6	7	8	9	10	11	12
026	0.50		400	500 L	600	700 M	800	900 H	1000	1100	1200		
038	0.50	650	750 L	850	1000	1100 M	1200	1300 H	1400	1500			
38 w/1hp*	0.75	800	1000 L	1100 M	1300 H	1500	1600	1800					
049	0.50	650	800 L	900	1050	1150	1250	1350 M	1450	1550 H			
49 w/1hp*	0.75	800	900 L	1000	1200	1400 M	1600 H	1700	1850	2000	2200	2300	2400
064	0.75	800	950 L	1100	1300	1500 M	1750	1950 H	2100	2300			
072	0.75	800	950	1100 L	1300	1500	1750 M	1950	2100 H	2300			

Factory settings are at recommended L-M-H DIP switch locations
 M-H settings MUST be located within boldface CFM range
 Lowest and Highest DIP switch settings are assumed to be L and H respectively

CFM is controlled within ±5% up to the maximum ESP
 Max ESP includes allowance for wet coil and standard filter


5/30/06

A 12-position DIP switch package on the control allows the airflow levels to be set for low, medium, and high speed when using the ECM2.3 blower motor. Only three of the DIP switches can be in the "on" position.

- The first "on" switch (the lowest position number) determines the low speed blower setting.
- The second "on" switch determines the medium speed blower setting.
- The third "on" switch determines the high speed blower setting.

The example to the right shows SW1 on the control board configured for the following 042 airflow settings.

- Low Speed Blower: 900 CFM
- Medium Speed Blower: 1150 CFM
- High Speed Blower: 1450 CFM

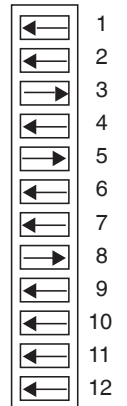

Reference Calculations

Heating Calculations:	Cooling Calculations:
$LWT = EWT - \frac{HE}{GPM \times 500}$	$LWT = EWT + \frac{HR}{GPM \times 500}$
$LAT = EAT + \frac{HC}{CFM \times 1.08}$	$LAT (DB) = EAT (DB) - \frac{SC}{CFM \times 1.08}$
$TH = HC + HW$	$LC = TC - SC$
	$S/T = \frac{SC}{TC}$

Legend and Notes

ABBREVIATIONS AND DEFINITIONS:

CFM = airflow, cubic feet/minute

EWT = entering water temperature, Fahrenheit

GPM = water flow in gallons/minute

WPD = water pressure drop, PSI and feet of water

EAT = entering air temperature, Fahrenheit (dry bulb/wet bulb)

HC = air heating capacity, MBTUH

TC = total cooling capacity, MBTUH

SC = sensible cooling capacity, MBTUH

KW = total power unit input, kilowatts

HR = total heat of rejection, MBTUH

HE = total heat of extraction, MBTUH

HW = hot water generator capacity, MBTUH

EER = Energy Efficient Ratio
= BTU output/Watt input

COP = Coefficient of Performance
= BTU output/BTU input

LWT = leaving water temperature, °F

LAT = leaving air temperature, °F

TH = total heating capacity, MBTUH

LC = latent cooling capacity, MBTUH

S/T = sensible to total cooling ratio

Notes to Performance Data Tables

The following notes apply to all capacity data tables:

- Performance ratings are based on 80°F DB / 67°F WB EAT for cooling and 70°F DB EAT for heating.
- Three flow rates are shown for each unit. The lowest flow rate shown is used for geothermal open loop/well water systems with a minimum of 50°F EWT. The middle flow rate shown is the minimum geothermal closed loop flow rate. The highest flow rate shown is optimum for geothermal closed loop systems and the suggested flow rate for boiler/tower applications.
- The hot water generator numbers are based on a flow rate of 0.4 GPM/ton of rated capacity with an EWT of 90°F.
- Entering water temperatures below 40°F assumes 15% antifreeze solution.
- For non-standard EAT conditions, apply the appropriate correction factors found in the Correction Factors tables.
- Interpolation between EWT, GPM and CFM data is permissible, extrapolation is not.

Operating Limits

Operating Limits	Cooling		Heating	
	(°F)	(°C)	(°F)	(°C)
Air Limits				
Min. Ambient Air	45	7.2	45	7.2
Rated Ambient Air	80	26.7	70	21.1
Max. Ambient Air	100	37.8	85	29.4
Min. Entering Air	50	10.0	40	4.4
Rated Entering Air db/wb	80.6/66.2	27/19	68	20.0
Max. Entering Air db/wb	110/83	43/28.3	80	26.7
Water Limits				
Min. Entering Water	30	-1.1	20	-6.7
Normal Entering Water	50-110	10-43.3	30-70	-1.1
Max. Entering Water	120	48.9	90	32.2

NOTE: Minimum/maximum limits are only for start-up conditions, and are meant for bringing the space up to occupancy temperature. Units are not designed to operate at the minimum/maximum conditions on a regular basis. The operating limits are dependent upon three primary factors: 1) water temperature, 2) return air temperature, and 3) ambient temperature. When any of the factors are at the minimum or maximum levels, the other two factors must be at the normal level for proper and reliable unit operation.

Correction Factor Tables

Air Flow Corrections (Dual Stage Part Load)

Airflow		Cooling				Heating		
CFM Per Ton of Clg	% of Nominal	Total Cap	Sens Cap	Power	Heat of Rej	Htg Cap	Power	Heat of Ext
240	60	0.922	0.778	0.956	0.924	0.943	1.239	0.879
275	69	0.944	0.830	0.962	0.944	0.958	1.161	0.914
300	75	0.957	0.866	0.968	0.958	0.968	1.115	0.937
325	81	0.970	0.900	0.974	0.970	0.977	1.075	0.956
350	88	0.982	0.933	0.981	0.980	0.985	1.042	0.972
375	94	0.991	0.968	0.991	0.991	0.993	1.018	0.988
400	100	1.000	1.000	1.000	1.000	1.000	1.000	1.000
425	106	1.007	1.033	1.011	1.008	1.007	0.990	1.010
450	113	1.013	1.065	1.023	1.015	1.012	0.987	1.018
475	119	1.017	1.099	1.037	1.022	1.018	0.984	1.025
500	125	1.020	1.132	1.052	1.027	1.022	0.982	1.031
520	130	1.022	1.159	1.064	1.030	1.025	0.979	1.034

5/30/06

Air Flow Corrections (Dual Stage Full Load & Single Stage)

Airflow		Cooling				Heating		
CFM Per Ton of Clg	% of Nominal	Total Cap	Sens Cap	Power	Heat of Rej	Htg Cap	Power	Heat of Ext
240	60	0.922	0.786	0.910	0.920	0.943	1.150	0.893
275	69	0.944	0.827	0.924	0.940	0.958	1.105	0.922
300	75	0.959	0.860	0.937	0.955	0.968	1.078	0.942
325	81	0.971	0.894	0.950	0.967	0.977	1.053	0.959
350	88	0.982	0.929	0.964	0.978	0.985	1.031	0.973
375	94	0.992	0.965	0.982	0.990	0.993	1.014	0.988
400	100	1.000	1.000	1.000	1.000	1.000	1.000	1.000
425	106	1.007	1.034	1.020	1.010	1.007	0.990	1.011
450	113	1.012	1.065	1.042	1.018	1.013	0.983	1.020
475	119	1.017	1.093	1.066	1.026	1.018	0.980	1.028
500	125	1.019	1.117	1.092	1.033	1.023	0.978	1.034
520	130	1.020	1.132	1.113	1.038	1.026	0.975	1.038

5/30/06

Cooling Capacity Corrections

Entering Air WB °F	Total Clg Cap	Sensible Cooling Capacity Multipliers - Entering DB °F										Power Input	Heat of Rejection
		60	65	70	75	80	80.6	85	90	95	100		
55	0.898	0.723	0.866	1.048	1.185	*	*	*	*	*	*	0.985	0.913
60	0.912		0.632	0.880	1.078	1.244	1.260	*	*	*	*	0.994	0.927
65	0.967			0.694	0.881	1.079	1.085	1.270	*	*	*	0.997	0.972
66.2	0.983			0.655	0.842	1.040	1.060	1.232	*	*	*	0.999	0.986
67	1.000			0.616	0.806	1.000	1.023	1.193	1.330	*	*	1.000	1.000
70	1.053				0.693	0.879	0.900	1.075	1.250	1.404	*	1.003	1.044
75	1.168					0.687	0.715	0.875	1.040	1.261	1.476	1.007	1.141

NOTE: *Sensible capacity equals total capacity at conditions shown.

11/10/09

Heating Capacity Corrections

Ent Air DB °F	Heating Corrections		
	Htg Cap	Power	Heat of Ext
45	1.062	0.739	1.158
50	1.050	0.790	1.130
55	1.037	0.842	1.096
60	1.025	0.893	1.064
65	1.012	0.945	1.030
68	1.005	0.976	1.012
70	1.000	1.000	1.000
75	0.987	1.048	0.970
80	0.975	1.099	0.930

11/10/09

T1GX022 - Performance Data

Single Stage PSC (700 CFM)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	EAT	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	EAT	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh
20	3.0	0.9	2.2	Operation not recommended							Operation not recommended							
	4.5	1.8	4.2	Operation not recommended							Operation not recommended							
	6.0	2.9	6.8	70	12.9	1.32	8.4	87.1	2.87	1.5								
30	3.0	0.9	2.1	Operation not recommended							Operation not recommended							
	4.5	1.7	4.0	70	15.2	1.33	10.7	90.1	3.35	1.6	80/67	23.4	17.4	0.75	0.83	26.2	28.3	---
	6.0	2.8	6.6	70	15.4	1.34	10.8	90.4	3.36	1.6	80/67	23.7	17.4	0.74	0.80	26.4	29.5	---
40	3.0	0.9	2.0	Operation not recommended							Operation not recommended							
	4.5	1.7	3.9	70	17.8	1.36	13.2	93.6	3.86	1.8	80/67	24.2	17.4	0.72	0.89	27.2	27.3	---
	6.0	2.8	6.4	70	18.1	1.37	13.5	94.0	3.89	1.8	80/67	24.5	17.4	0.71	0.86	27.4	28.4	---
50	3.0	0.9	2.0	70	19.4	1.36	14.7	95.6	4.18	2.0	80/67	24.7	17.1	0.69	1.01	28.2	24.4	1.2
	4.5	1.6	3.8	70	20.3	1.38	15.6	96.8	4.29	2.0	80/67	25.0	17.3	0.69	0.97	28.3	25.8	1.1
	6.0	2.7	6.2	70	20.7	1.39	15.9	97.3	4.35	2.1	80/67	25.2	17.3	0.68	0.94	28.4	26.7	1.1
60	3.0	0.8	1.9	70	21.8	1.39	17.1	98.9	4.60	2.2	80/67	23.9	16.9	0.71	1.11	27.7	21.4	1.4
	4.5	1.6	3.7	70	22.9	1.42	18.0	100.3	4.72	2.3	80/67	24.1	17.1	0.71	1.06	27.8	22.7	1.3
	6.0	2.6	6.0	70	23.3	1.43	18.4	100.8	4.77	2.3	80/67	24.4	17.1	0.70	1.04	27.9	23.5	1.3
70	3.0	0.8	1.8	70	24.3	1.43	19.4	102.2	4.99	2.5	80/67	23.6	16.7	0.71	1.25	27.8	18.9	1.7
	4.5	1.5	3.6	70	25.5	1.46	20.5	103.8	5.11	2.5	80/67	23.8	16.9	0.71	1.19	27.9	20.1	1.7
	6.0	2.5	5.8	70	25.9	1.47	20.9	104.3	5.15	2.6	80/67	24.0	16.9	0.70	1.15	28.0	20.8	1.6
80	3.0	0.8	1.8	70	26.6	1.48	21.5	105.1	5.27	2.8	80/67	22.6	16.4	0.73	1.39	27.3	16.2	2.2
	4.5	1.5	3.4	70	27.8	1.51	22.7	106.8	5.41	2.8	80/67	22.8	16.6	0.73	1.32	27.3	17.3	2.1
	6.0	2.4	5.6	70	28.3	1.52	23.1	107.4	5.45	2.9	80/67	23.0	16.6	0.72	1.29	27.4	17.9	2.0
90	3.0	0.7	1.7	70	28.8	1.53	23.6	108.1	5.53	3.1	80/67	20.9	15.9	0.76	1.55	26.2	13.5	2.7
	4.5	1.4	3.3	70	30.1	1.55	24.8	109.8	5.67	3.2	80/67	21.1	16.1	0.77	1.47	26.1	14.3	2.6
	6.0	2.3	5.4	70	30.7	1.57	25.3	110.5	5.71	3.3	80/67	21.3	16.1	0.76	1.44	26.2	14.8	2.4
100	3.0	0.7	1.7	Operation not recommended							Operation not recommended							
	4.5	1.4	3.2	Operation not recommended							Operation not recommended							
	6.0	2.2	5.2	Operation not recommended							Operation not recommended							
110	3.0	0.7	1.6	Operation not recommended							Operation not recommended							
	4.5	1.3	3.1	Operation not recommended							Operation not recommended							
	6.0	2.2	5.0	Operation not recommended							Operation not recommended							
120	3.0	0.7	1.5	Operation not recommended							Operation not recommended							
	4.5	1.3	2.9	Operation not recommended							Operation not recommended							
	6.0	2.1	4.8	Operation not recommended							Operation not recommended							

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T1GX030 - Performance Data

Single Stage PSC (900 CFM)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	EAT	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	EAT	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh
20	4.0	1.5	3.5	Operation not recommended							Operation not recommended							
	6.0	3.1	7.2	Operation not recommended							Operation not recommended							
	8.0	5.2	12.1	70	17.6	1.67	11.9	88.1	3.09	2.0								
30	4.0	1.5	3.4	Operation not recommended							Operation not recommended							
	6.0	3.0	7.0	70	20.2	1.66	14.6	90.8	3.57	2.2	80/67	26.4	18.9	0.71	1.06	30.0	24.9	---
	8.0	5.1	11.8	70	20.7	1.68	14.9	91.2	3.61	2.2	80/67	26.9	18.8	0.70	1.03	30.4	26.1	---
40	4.0	1.4	3.3	Operation not recommended							Operation not recommended							
	6.0	2.9	6.8	70	23.7	1.70	17.9	94.4	4.07	2.4	80/67	28.7	20.4	0.71	1.14	32.6	25.1	---
	8.0	4.9	11.4	70	24.2	1.72	18.3	94.9	4.12	2.5	80/67	29.1	20.3	0.70	1.11	32.9	26.1	---
50	4.0	1.4	3.2	70	25.9	1.74	20.0	96.6	4.36	2.6	80/67	30.7	21.8	0.71	1.29	35.1	23.8	1.5
	6.0	2.8	6.6	70	26.8	1.75	20.8	97.6	4.49	2.7	80/67	30.8	21.9	0.71	1.25	35.0	24.7	1.4
	8.0	4.8	11.1	70	27.4	1.76	21.3	98.1	4.55	2.8	80/67	31.2	21.9	0.70	1.22	35.3	25.5	1.4
60	4.0	1.4	3.1	70	29.1	1.80	23.0	99.9	4.75	3.0	80/67	30.0	21.4	0.72	1.40	34.7	21.4	1.8
	6.0	2.8	6.4	70	30.1	1.81	23.9	101.0	4.89	3.0	80/67	30.0	21.5	0.71	1.35	34.7	22.2	1.7
	8.0	4.6	10.7	70	30.7	1.82	24.5	101.6	4.93	3.1	80/67	30.4	21.5	0.71	1.32	34.9	22.9	1.6
70	4.0	1.3	3.0	70	32.4	1.87	26.0	103.3	5.08	3.3	80/67	30.1	21.7	0.72	1.54	35.4	19.5	2.2
	6.0	2.7	6.2	70	33.5	1.88	27.1	104.5	5.22	3.4	80/67	30.2	21.7	0.72	1.49	35.3	20.3	2.1
	8.0	4.5	10.4	70	34.1	1.90	27.6	105.1	5.24	3.5	80/67	30.6	21.8	0.71	1.46	35.5	20.9	2.0
80	4.0	1.3	2.9	70	35.1	1.93	28.5	106.1	5.32	3.7	80/67	28.9	21.4	0.74	1.70	34.7	17.0	2.8
	6.0	2.6	5.9	70	36.4	1.95	29.7	107.4	5.46	3.8	80/67	29.0	21.4	0.74	1.64	34.6	17.7	2.7
	8.0	4.3	10.0	70	36.9	1.98	30.2	108.0	5.48	3.9	80/67	29.3	21.5	0.73	1.61	34.8	18.2	2.5
90	4.0	1.2	2.8	70	37.9	2.01	31.0	108.9	5.51	4.2	80/67	26.7	20.2	0.76	1.87	33.1	14.3	3.5
	6.0	2.5	5.7	70	39.3	2.04	32.3	110.4	5.64	4.3	80/67	26.9	20.2	0.75	1.80	33.0	14.9	3.3
	8.0	4.2	9.6	70	39.9	2.06	32.8	111.0	5.66	4.4	80/67	27.1	20.3	0.75	1.77	33.2	15.3	3.2
100	4.0	1.2	2.7	Operation not recommended							Operation not recommended							
	6.0	2.4	5.5	Operation not recommended							Operation not recommended							
	8.0	4.0	9.3	Operation not recommended							Operation not recommended							
110	4.0	1.1	2.6	Operation not recommended							Operation not recommended							
	6.0	2.3	5.3	Operation not recommended							Operation not recommended							
	8.0	3.9	8.9	Operation not recommended							Operation not recommended							
120	4.0	1.1	2.5	Operation not recommended							Operation not recommended							
	6.0	2.2	5.1	Operation not recommended							Operation not recommended							
	8.0	3.7	8.6	Operation not recommended							Operation not recommended							

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T1GX036 - Performance Data

Single Stage PSC (1250 CFM)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	EAT	HC kBTuh	Power kW	HE kBTuh	LAT °F	COP	HWC kBTuh	EAT	TC kBTuh	SC kBTuh	S/T Ratio	Power kW	HR kBTuh	EER	HWC kBTuh
20	5.0	1.0	2.4	Operation not recommended							Operation not recommended							
	7.0	2.1	4.9	Operation not recommended							Operation not recommended							
	9.0	3.6	8.2	70	21.8	1.99	15.0	86.1	3.21	2.4	Operation not recommended							
30	5.0	1.0	2.3	Operation not recommended							Operation not recommended							
	7.0	2.1	4.7	70	24.5	1.99	17.7	88.1	3.60	2.6	80/67	30.3	21.8	0.72	1.27	34.7	23.9	---
	9.0	3.5	8.0	70	25.0	2.01	18.1	88.5	3.64	2.7	80/67	30.8	21.7	0.70	1.23	35.0	25.1	---
40	5.0	1.0	2.3	Operation not recommended							Operation not recommended							
	7.0	2.0	4.6	70	28.4	2.04	21.5	91.1	4.09	3.0	80/67	33.3	24.2	0.73	1.37	38.0	24.3	---
	9.0	3.4	7.8	70	29.0	2.07	22.0	91.5	4.14	3.0	80/67	33.8	24.1	0.71	1.33	38.3	25.3	---
50	5.0	1.0	2.2	70	30.9	2.07	23.8	92.9	4.37	3.2	80/67	35.9	26.2	0.73	1.55	41.2	23.3	1.7
	7.0	1.9	4.5	70	32.0	2.08	24.9	93.7	4.51	3.3	80/67	36.0	26.3	0.73	1.49	41.1	24.1	1.6
	9.0	3.3	7.5	70	32.6	2.10	25.5	94.2	4.56	3.4	80/67	36.5	26.3	0.72	1.46	41.5	25.0	1.6
60	5.0	0.9	2.1	70	34.7	2.11	27.5	95.7	4.81	3.6	80/67	35.7	26.8	0.75	1.67	41.4	21.4	2.1
	7.0	1.9	4.3	70	35.9	2.12	28.6	96.6	4.95	3.7	80/67	35.8	26.8	0.75	1.61	41.2	22.2	2.0
	9.0	3.1	7.3	70	36.6	2.15	29.2	97.1	4.99	3.8	80/67	36.2	26.9	0.74	1.58	41.6	22.9	1.9
70	5.0	0.9	2.1	70	38.6	2.16	31.3	98.6	5.24	4.1	80/67	36.2	27.8	0.77	1.83	42.4	19.7	2.6
	7.0	1.8	4.2	70	40.0	2.18	32.6	99.6	5.38	4.2	80/67	36.3	27.8	0.77	1.77	42.3	20.5	2.5
	9.0	3.0	7.0	70	40.7	2.20	33.2	100.1	5.41	4.3	80/67	36.7	27.9	0.76	1.73	42.6	21.2	2.4
80	5.0	0.9	2.0	70	41.8	2.20	34.3	101.0	5.57	4.6	80/67	35.3	27.7	0.78	2.01	42.1	17.6	3.3
	7.0	1.7	4.0	70	43.4	2.23	35.8	102.1	5.71	4.7	80/67	35.4	27.7	0.78	1.93	42.0	18.3	3.1
	9.0	2.9	6.8	70	44.1	2.25	36.4	102.6	5.73	4.8	80/67	35.8	27.8	0.78	1.90	42.3	18.9	3.0
90	5.0	0.8	1.9	70	45.3	2.25	37.6	103.5	5.89	5.1	80/67	33.1	26.8	0.81	2.19	40.6	15.1	4.1
	7.0	1.7	3.9	70	47.0	2.28	39.2	104.8	6.03	5.3	80/67	33.3	26.8	0.81	2.11	40.5	15.8	3.9
	9.0	2.8	6.6	70	47.7	2.31	39.8	105.3	6.05	5.4	80/67	33.6	27.0	0.80	2.08	40.7	16.2	3.7
100	5.0	0.8	1.8	Operation not recommended							Operation not recommended							
	7.0	1.6	3.8	Operation not recommended							Operation not recommended							
	9.0	2.7	6.3	Operation not recommended							80/67	32.3	26.6	0.82	2.34	40.3	13.8	4.8
110	5.0	0.8	1.8	Operation not recommended							Operation not recommended							
	7.0	1.6	3.6	Operation not recommended							Operation not recommended							
	9.0	2.6	6.1	Operation not recommended							80/67	29.1	24.7	0.85	2.57	37.8	11.3	5.9
120	5.0	0.7	1.7	Operation not recommended							Operation not recommended							
	7.0	1.5	3.5	Operation not recommended							Operation not recommended							
	9.0	2.5	5.8	Operation not recommended							80/67	27.2	24.4	0.89	2.84	36.9	9.6	7.1
				Operation not recommended							Operation not recommended							
				Operation not recommended							80/67	27.6	24.4	0.89	2.78	37.0	9.9	6.7

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T1GX042 - Performance Data

Single Stage PSC (1350 CFM)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	EAT	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	EAT	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh
20	5.0	0.8	1.9	Operation not recommended							Operation not recommended							
	8.0	2.3	5.3	Operation not recommended							Operation not recommended							
	11.0	4.4	10.3	70	25.4	2.41	17.1	87.4	3.09	3.7	Operation not recommended							
30	5.0	0.8	1.8	Operation not recommended							Operation not recommended							
	8.0	2.2	5.1	70	29.3	2.45	21.0	90.1	3.51	3.9	80/67	41.0	28.4	0.69	1.76	47.0	23.3	---
	11.0	4.3	10.0	70	29.7	2.45	21.4	90.4	3.56	4.0	80/67	41.4	28.4	0.68	1.72	47.3	24.1	---
40	5.0	0.8	1.8	Operation not recommended							Operation not recommended							
	8.0	2.1	4.9	70	33.3	2.52	24.7	92.9	3.88	4.3	80/67	42.7	30.3	0.71	1.85	49.0	23.1	---
	11.0	4.2	9.7	70	33.9	2.52	25.3	93.3	3.94	4.4	80/67	43.1	30.3	0.70	1.80	49.3	23.9	---
50	5.0	0.7	1.7	70	35.8	2.52	27.2	94.6	4.16	4.7	80/67	43.3	31.3	0.72	2.05	50.3	21.1	2.6
	8.0	2.1	4.8	70	37.3	2.57	28.5	95.6	4.26	4.8	80/67	43.8	31.6	0.72	1.97	50.5	22.2	2.5
	11.0	4.1	9.4	70	38.0	2.58	29.3	96.1	4.33	5.0	80/67	44.2	31.6	0.71	1.92	50.8	23.0	2.4
60	5.0	0.7	1.7	70	39.3	2.57	30.5	97.0	4.48	5.3	80/67	43.1	32.0	0.74	2.22	50.6	19.4	3.2
	8.0	2.0	4.6	70	41.1	2.63	32.1	98.2	4.58	5.4	80/67	43.6	32.4	0.74	2.12	50.9	20.5	3.0
	11.0	3.9	9.1	70	42.0	2.65	33.0	98.8	4.66	5.6	80/67	44.1	32.4	0.73	2.07	51.1	21.3	2.9
70	5.0	0.7	1.6	70	42.7	2.63	33.7	99.3	4.76	6.0	80/67	43.1	33.1	0.77	2.41	51.4	17.9	4.0
	8.0	1.9	4.5	70	44.8	2.70	35.5	100.7	4.86	6.1	80/67	43.8	33.4	0.76	2.31	51.7	19.0	3.8
	11.0	3.8	8.8	70	45.9	2.73	36.6	101.5	4.94	6.3	80/67	44.3	33.4	0.75	2.25	51.9	19.7	3.6
80	5.0	0.7	1.6	70	45.9	2.65	36.9	101.5	5.09	6.7	80/67	41.4	32.3	0.78	2.64	50.4	15.6	5.1
	8.0	1.9	4.3	70	48.4	2.73	39.0	103.2	5.18	6.9	80/67	42.1	32.6	0.77	2.52	50.7	16.7	4.8
	11.0	3.7	8.5	70	49.8	2.77	40.3	104.1	5.28	7.1	80/67	42.6	32.6	0.77	2.46	50.9	17.3	4.6
90	5.0	0.7	1.5	70	49.1	2.68	40.0	103.7	5.37	7.5	80/67	39.0	31.4	0.80	2.91	48.9	13.4	6.4
	8.0	1.8	4.2	70	51.8	2.78	42.4	105.6	5.47	7.8	80/67	39.8	31.7	0.80	2.77	49.3	14.4	6.1
	11.0	3.5	8.2	70	53.5	2.82	43.9	106.7	5.57	8.0	80/67	40.2	31.7	0.79	2.70	49.4	14.9	5.8
100	5.0	0.6	1.5	Operation not recommended							Operation not recommended							
	8.0	1.7	4.0	Operation not recommended							80/67	38.2	31.1	0.81	3.04	48.6	12.6	7.5
	11.0	3.4	7.9	Operation not recommended							80/67	38.6	31.1	0.81	2.96	48.7	13.0	7.2
110	5.0	0.6	1.4	Operation not recommended							Operation not recommended							
	8.0	1.7	3.9	Operation not recommended							80/67	34.6	28.8	0.83	3.35	46.1	10.3	9.2
	11.0	3.3	7.6	Operation not recommended							80/67	35.0	28.8	0.82	3.26	46.1	10.7	8.8
120	5.0	0.6	1.3	Operation not recommended							Operation not recommended							
	8.0	1.6	3.7	Operation not recommended							80/67	32.5	28.4	0.88	3.68	45.1	8.8	11.1
	11.0	3.2	7.3	Operation not recommended							80/67	32.8	28.4	0.87	3.58	45.1	9.2	10.6

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T1GX048 - Performance Data

Single Stage PSC (1500 CFM)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	EAT	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	EAT	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh
20	6.0	1.1	2.6	Operation not recommended							Operation not recommended							
	9.0	2.3	5.4	Operation not recommended							Operation not recommended							
	12.0	4.0	9.2	70	32.8	3.05	22.4	90.2	3.15	4.8	Operation not recommended							
30	6.0	1.1	2.5	Operation not recommended							Operation not recommended							
	9.0	2.3	5.3	70	37.5	3.13	26.8	93.1	3.51	5.2	80/67	49.7	34.1	0.69	1.94	56.3	25.6	---
	12.0	3.9	9.0	70	38.0	3.13	27.3	93.5	3.56	5.3	80/67	50.2	34.1	0.68	1.89	56.6	26.6	---
40	6.0	1.1	2.5	Operation not recommended							Operation not recommended							
	9.0	2.2	5.1	70	43.0	3.23	32.0	96.6	3.90	5.7	80/67	51.5	36.0	0.70	2.10	58.7	24.5	---
	12.0	3.8	8.7	70	43.8	3.24	32.7	97.0	3.96	5.8	80/67	52.1	36.0	0.69	2.05	59.0	25.5	---
50	6.0	1.0	2.4	70	46.2	3.26	35.1	98.5	4.16	6.2	80/67	52.5	37.4	0.71	2.40	60.7	21.9	3.1
	9.0	2.1	4.9	70	48.1	3.32	36.7	99.7	4.25	6.4	80/67	53.1	37.8	0.71	2.30	60.9	23.1	2.9
	12.0	3.7	8.4	70	49.0	3.33	37.7	100.3	4.31	6.5	80/67	53.6	37.8	0.70	2.24	61.3	23.9	2.8
60	6.0	1.0	2.3	70	50.8	3.33	39.5	101.4	4.48	7.0	80/67	51.1	37.0	0.72	2.63	60.1	19.4	3.7
	9.0	2.1	4.8	70	53.1	3.41	41.5	102.8	4.57	7.2	80/67	51.8	37.3	0.72	2.52	60.4	20.6	3.6
	12.0	3.5	8.2	70	54.4	3.43	42.7	103.6	4.64	7.4	80/67	52.3	37.3	0.71	2.45	60.7	21.4	3.4
70	6.0	1.0	2.2	70	55.5	3.41	43.9	104.3	4.78	7.9	80/67	50.8	37.4	0.74	2.91	60.7	17.4	4.7
	9.0	2.0	4.6	70	58.2	3.51	46.3	105.9	4.87	8.1	80/67	51.5	37.8	0.73	2.78	61.0	18.6	4.5
	12.0	3.4	7.9	70	59.7	3.54	47.7	106.9	4.95	8.3	80/67	52.1	37.8	0.73	2.70	61.3	19.3	4.2
80	6.0	0.9	2.1	70	59.4	3.46	47.5	106.6	5.03	8.8	80/67	48.5	36.6	0.75	3.23	59.5	15.0	5.9
	9.0	1.9	4.5	70	62.5	3.58	50.3	108.6	5.11	9.1	80/67	49.4	36.9	0.75	3.07	59.8	16.1	5.6
	12.0	3.3	7.6	70	64.3	3.62	51.9	109.7	5.20	9.4	80/67	49.9	36.9	0.74	2.99	60.1	16.7	5.4
90	6.0	0.9	2.1	70	63.2	3.52	51.2	109.0	5.26	9.9	80/67	45.1	34.9	0.77	3.57	57.3	12.6	7.4
	9.0	1.9	4.3	70	66.8	3.66	54.3	111.2	5.35	10.2	80/67	46.0	35.2	0.77	3.39	57.6	13.6	7.1
	12.0	3.2	7.4	70	68.9	3.71	56.2	112.5	5.44	10.6	80/67	46.5	35.2	0.76	3.30	57.7	14.1	6.7
100	6.0	0.9	2.0	Operation not recommended							Operation not recommended							
	9.0	1.8	4.2	Operation not recommended							Operation not recommended							
	12.0	3.1	7.1	Operation not recommended							80/67	44.3	34.8	0.78	3.76	57.1	11.8	8.8
110	6.0	0.8	1.9	Operation not recommended							Operation not recommended							
	9.0	1.7	4.0	Operation not recommended							Operation not recommended							
	12.0	3.0	6.8	Operation not recommended							80/67	39.9	32.3	0.81	4.15	54.0	9.6	10.8
120	6.0	0.8	1.8	Operation not recommended							Operation not recommended							
	9.0	1.7	3.8	Operation not recommended							Operation not recommended							
	12.0	2.8	6.6	Operation not recommended							80/67	37.6	31.7	0.84	4.59	53.3	8.2	13.0
				Operation not recommended							Operation not recommended							
				Operation not recommended							80/67	38.0	31.7	0.83	4.46	53.2	8.5	12.4

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T1GX060 - Performance Data

Single Stage PSC (2000 CFM)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT	EAT	HC kBTuh	Power kW	HE kBTuh	LAT °F	COP	HWC kBTuh	EAT	TC kBTuh	SC kBTuh	S/T Ratio	Power kW	HR kBTuh	EER	HWC kBTuh
20	9.0	2.5	5.7	Operation not recommended							Operation not recommended							
	12.0	4.0	9.2	Operation not recommended							Operation not recommended							
	15.0	5.9	13.5	70	39.6	4.02	25.9	88.3	2.89	5.8	Operation not recommended							
30	9.0	2.4	5.5	Operation not recommended							Operation not recommended							
	12.0	3.9	8.9	70	44.5	4.02	30.8	90.6	3.24	6.2	80/67	70.2	48.6	0.69	2.91	80.2	24.2	---
	15.0	5.7	13.1	70	45.9	4.12	31.8	91.2	3.26	6.4	80/67	71.4	48.1	0.67	2.74	80.8	26.1	---
40	9.0	2.3	5.3	Operation not recommended							Operation not recommended							
	12.0	3.7	8.7	70	52.5	4.19	38.2	94.3	3.67	6.9	80/67	71.7	49.8	0.69	3.10	82.3	23.1	---
	15.0	5.5	12.7	70	53.7	4.26	39.2	94.9	3.70	7.1	80/67	72.6	49.6	0.68	2.95	82.6	24.6	---
50	9.0	2.2	5.2	70	57.8	4.30	43.1	96.7	3.93	7.5	80/67	72.9	50.5	0.69	3.44	84.6	21.2	4.1
	12.0	3.6	8.4	70	59.2	4.34	44.4	97.4	4.00	7.7	80/67	72.9	51.0	0.70	3.38	84.4	21.6	3.9
	15.0	5.3	12.3	70	60.3	4.38	45.3	97.9	4.03	7.9	80/67	73.6	51.0	0.69	3.23	84.7	22.8	3.7
60	9.0	2.2	5.0	70	64.1	4.42	49.0	99.7	4.25	8.4	80/67	70.5	49.4	0.70	3.63	82.9	19.4	5.0
	12.0	3.5	8.1	70	65.5	4.47	50.3	100.3	4.30	8.7	80/67	70.8	49.6	0.70	3.53	82.9	20.1	4.8
	15.0	5.2	11.9	70	67.3	4.53	51.9	101.2	4.36	8.9	80/67	71.2	49.9	0.70	3.41	82.8	20.9	4.6
70	9.0	2.1	4.9	70	70.6	4.56	55.1	102.7	4.54	9.5	80/67	69.2	49.4	0.71	3.97	82.7	17.4	6.3
	12.0	3.4	7.9	70	71.9	4.60	56.2	103.3	4.58	9.8	80/67	69.9	49.4	0.71	3.83	83.0	18.2	6.0
	15.0	5.0	11.6	70	74.6	4.69	58.6	104.5	4.66	10.0	80/67	69.9	49.9	0.71	3.73	82.6	18.7	5.7
80	9.0	2.0	4.7	70	75.2	4.66	59.3	104.8	4.73	10.7	80/67	66.1	48.0	0.73	4.35	80.9	15.2	8.0
	12.0	3.3	7.6	70	77.8	4.68	61.8	106.0	4.87	11.0	80/67	66.8	48.0	0.72	4.16	81.0	16.0	7.6
	15.0	4.8	11.2	70	79.9	4.82	63.5	107.0	4.86	11.3	80/67	67.1	48.5	0.72	4.05	80.9	16.6	7.2
90	9.0	2.0	4.5	70	80.0	4.78	63.7	107.1	4.91	12.0	80/67	61.6	45.8	0.74	4.74	77.7	13.0	10.0
	12.0	3.2	7.3	70	83.9	4.78	67.6	108.8	5.14	12.4	80/67	62.2	45.8	0.74	4.49	77.5	13.8	9.5
	15.0	4.7	10.8	70	85.5	4.97	68.5	109.6	5.04	12.8	80/67	62.8	46.3	0.74	4.37	77.7	14.4	9.1
100	9.0	1.9	4.4	Operation not recommended							Operation not recommended							
	12.0	3.1	7.1	Operation not recommended							80/67	59.7	45.0	0.75	4.99	76.7	11.9	11.8
	15.0	4.5	10.4	Operation not recommended							80/67	60.3	45.5	0.76	4.87	76.9	12.4	11.2
110	9.0	1.8	4.2	Operation not recommended							Operation not recommended							
	12.0	2.9	6.8	Operation not recommended							80/67	54.5	41.8	0.77	5.43	73.0	10.0	14.5
	15.0	4.3	10.0	Operation not recommended							80/67	55.1	42.3	0.77	5.30	73.1	10.4	13.8
120	9.0	1.7	4.0	Operation not recommended							Operation not recommended							
	12.0	2.8	6.5	Operation not recommended							80/67	50.8	41.5	0.82	6.09	71.6	8.3	17.5
	15.0	4.2	9.6	Operation not recommended							80/67	51.7	41.9	0.81	5.92	71.9	8.7	16.7

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T1GX070 - Performance Data

Single Stage PSC (2200 CFM)

EWT °F	Flow gpm	WPD		HEATING - EAT 70°F							COOLING - EAT 80/67 °F											
		PSI	FT	EAT	HC kBTuh	Power kW	HE kBTuh	LAT °F	COP	HWC kBTuh	EAT	TC kBTuh	SC kBTuh	S/T Ratio	Power kW	HR kBTuh	EER	HWC kBTuh				
20	12.0	3.0	7.0	Operation not recommended											Operation not recommended							
	15.0	4.4	10.2	Operation not recommended											Operation not recommended							
	18.0	6.0	13.9	70	46.0	4.54	30.5	89.4	2.97	6.9												
30	12.0	3.0	6.8	Operation not recommended											Operation not recommended							
	15.0	4.3	9.9	70	53.0	4.65	37.2	92.3	3.34	7.4	80/67	73.6	49.7	0.68	2.87	83.4	25.6	---				
	18.0	5.8	13.5	70	53.2	4.66	37.3	92.4	3.34	7.6	80/67	74.0	49.1	0.66	2.86	83.8	25.8	---				
40	12.0	2.9	6.6	Operation not recommended											Operation not recommended							
	15.0	4.1	9.6	70	61.8	4.80	45.5	96.0	3.77	8.2	80/67	77.3	52.8	0.68	3.11	87.9	24.9	---				
	18.0	5.7	13.1	70	62.2	4.82	45.8	96.2	3.78	8.4	80/67	77.9	52.6	0.67	3.09	88.5	25.2	---				
50	12.0	2.8	6.4	70	68.1	4.91	51.4	98.7	4.07	8.9	80/67	80.7	55.5	0.69	3.51	92.7	23.0	4.5				
	15.0	4.0	9.3	70	69.5	4.95	52.7	99.3	4.12	9.2	80/67	81.2	55.7	0.69	3.41	92.8	23.8	4.3				
	18.0	5.5	12.7	70	70.1	4.97	53.2	99.5	4.13	9.4	80/67	82.0	56.0	0.68	3.38	93.5	24.3	4.1				
60	12.0	2.7	6.2	70	75.6	5.06	58.3	101.8	4.38	10.0	80/67	77.3	53.7	0.69	3.81	90.3	20.3	5.5				
	15.0	3.9	9.0	70	77.8	5.11	60.3	102.7	4.46	10.3	80/67	77.7	53.9	0.69	3.70	90.3	21.0	5.2				
	18.0	5.3	12.3	70	78.7	5.14	61.2	103.1	4.48	10.6	80/67	78.7	54.6	0.69	3.65	91.1	21.5	5.0				
70	12.0	2.6	6.0	70	83.4	5.22	65.6	105.1	4.69	11.3	80/67	76.8	54.5	0.71	4.19	91.1	18.3	6.9				
	15.0	3.8	8.7	70	86.4	5.29	68.4	106.4	4.79	11.6	80/67	77.1	54.6	0.71	4.08	91.0	18.9	6.6				
	18.0	5.1	11.9	70	87.7	5.33	69.5	106.9	4.82	11.9	80/67	78.2	55.8	0.71	4.01	91.9	19.5	6.3				
80	12.0	2.5	5.8	70	89.2	5.36	70.9	107.5	4.88	12.7	80/67	73.3	52.2	0.71	4.61	89.1	15.9	8.7				
	15.0	3.6	8.4	70	93.3	5.46	74.6	109.3	5.00	13.1	80/67	73.6	52.2	0.71	4.49	88.9	16.4	8.3				
	18.0	5.0	11.5	70	94.9	5.51	76.1	109.9	5.05	13.5	80/67	74.8	53.8	0.72	4.40	89.8	17.0	7.9				
90	12.0	2.4	5.6	70	95.4	5.52	76.5	110.1	5.06	14.3	80/67	67.0	48.5	0.72	5.06	84.3	13.2	10.9				
	15.0	3.5	8.1	70	100.5	5.64	81.2	112.3	5.22	14.7	80/67	67.2	48.4	0.72	4.93	84.0	13.6	10.4				
	18.0	4.8	11.1	70	102.5	5.70	83.0	113.1	5.27	15.2	80/67	68.6	50.3	0.73	4.81	85.0	14.2	9.9				
100	12.0	2.3	5.4	Operation not recommended											Operation not recommended							
	15.0	3.4	7.8	Operation not recommended											80/67	65.0	47.8	0.74	5.47	83.7	11.9	13.0
	18.0	4.6	10.7	Operation not recommended											80/67	66.4	50.2	0.75	5.33	84.6	12.5	12.3
110	12.0	2.2	5.2	Operation not recommended											Operation not recommended							
	15.0	3.3	7.5	Operation not recommended											80/67	57.4	42.5	0.74	6.03	77.9	9.5	15.9
	18.0	4.4	10.2	Operation not recommended											80/67	58.8	45.0	0.77	5.85	78.8	10.1	15.1
120	12.0	2.2	5.0	Operation not recommended											Operation not recommended							
	15.0	3.1	7.2	Operation not recommended											80/67	54.2	43.1	0.79	6.69	77.1	8.1	19.2
	18.0	4.3	9.8	Operation not recommended											80/67	55.7	46.0	0.83	6.47	77.8	8.6	18.2

T1GX022 - Performance Data

Single Stage ECM2.3 (700 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT/HD	Airflow CFM	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	Airflow CFM	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh
20	3.0	0.9	2.2	Operation not recommended							Operation not recommended							
	4.5	1.8	4.2	Operation not recommended							Operation not recommended							
	6.0	2.9	6.8	600 700	12.3 12.5	1.18 1.19	8.3 8.4	89.0 86.5	3.06 3.08	1.6 1.5								
30	3.0	0.9	2.1	Operation not recommended							Operation not recommended							
	4.5	1.7	4.0	600 700	14.5 14.8	1.19 1.20	10.4 10.7	92.3 89.5	3.56 3.61	1.7 1.6	600 700	23.4 23.8	15.8 17.3	0.68 0.73	0.66 0.69	25.7 26.2	35.6 34.4	---
	6.0	2.8	6.6	600 700	14.8 15.0	1.20 1.21	10.7 10.8	92.8 89.8	3.61 3.62	1.8 1.6	600 700	23.6 24.1	15.8 17.3	0.67 0.72	0.64 0.67	25.7 26.4	36.9 36.0	---
40	3.0	0.9	2.0	Operation not recommended							Operation not recommended							
	4.5	1.7	3.9	600 700	17.0 17.4	1.22 1.22	12.9 13.2	96.3 93.0	4.10 4.17	1.9 1.8	600 700	24.2 24.6	15.8 17.3	0.65 0.70	0.72 0.75	26.7 27.2	33.6 32.7	---
	6.0	2.8	6.4	600 700	17.3 17.7	1.23 1.23	13.1 13.5	96.8 93.4	4.12 4.20	2.0 1.8	600 700	24.4 24.9	15.8 17.3	0.65 0.69	0.70 0.73	26.8 27.4	34.9 34.2	---
50	3.0	0.9	2.0	600 700	18.5 18.9	1.22 1.22	14.3 14.7	98.6 95.0	4.43 4.52	2.1 2.0	600 700	24.6 25.2	15.6 17.0	0.63 0.67	0.84 0.88	27.5 28.2	29.2 28.7	1.1 1.2
	4.5	1.6	3.8	600 700	19.5 19.8	1.25 1.25	15.2 15.6	100.0 96.2	4.56 4.64	2.2 2.0	600 700	24.9 25.4	15.7 17.1	0.63 0.67	0.80 0.84	27.6 28.3	31.1 30.4	1.0 1.1
	6.0	2.7	6.2	600 700	19.7 20.2	1.27 1.26	15.4 15.9	100.5 96.7	4.56 4.70	2.2 2.1	600 700	25.2 25.7	15.7 17.1	0.63 0.67	0.78 0.81	27.8 28.4	32.4 31.7	1.0 1.1
60	3.0	0.8	1.9	600 700	20.9 21.4	1.27 1.26	16.6 17.1	102.3 98.3	4.82 4.98	2.4 2.2	600 700	23.9 24.3	15.4 16.8	0.65 0.69	0.94 0.98	27.1 27.7	25.3 24.8	1.3 1.4
	4.5	1.6	3.7	600 700	21.9 22.4	1.30 1.29	17.5 18.0	103.8 99.7	4.94 5.10	2.4 2.3	600 700	24.1 24.6	15.6 17.0	0.65 0.69	0.89 0.93	27.1 27.8	26.9 26.4	1.2 1.3
	6.0	2.6	6.0	600 700	22.2 22.8	1.31 1.30	17.8 18.4	104.3 100.2	4.96 5.15	2.5 2.3	600 700	24.3 24.8	15.6 17.0	0.64 0.68	0.87 0.90	27.3 27.9	28.0 27.5	1.1 1.3
70	3.0	0.8	1.8	600 700	23.3 23.9	1.32 1.30	18.8 19.4	106.0 101.6	5.17 5.40	2.7 2.5	600 700	23.6 24.0	15.3 16.6	0.65 0.69	1.07 1.11	27.2 27.8	22.0 21.6	1.6 1.7
	4.5	1.5	3.6	600 700	24.3 25.1	1.35 1.33	19.7 20.5	107.6 103.2	5.29 5.52	2.7 2.5	600 700	23.7 24.3	15.4 16.8	0.65 0.69	1.01 1.05	27.2 27.9	23.5 23.1	1.5 1.7
	6.0	2.5	5.8	600 700	24.8 25.5	1.37 1.34	20.1 20.9	108.3 103.7	5.32 5.57	2.8 2.6	600 700	24.0 24.5	15.4 16.8	0.64 0.69	0.99 1.02	27.4 28.0	24.4 24.0	1.4 1.6
80	3.0	0.8	1.8	600 700	25.4 26.1	1.38 1.34	20.7 21.5	109.1 104.5	5.40 5.70	3.0 2.8	600 700	22.5 23.0	15.0 16.2	0.66 0.71	1.21 1.26	26.7 27.3	18.6 18.3	2.0 2.2
	4.5	1.5	3.4	600 700	26.5 27.3	1.41 1.37	21.7 22.7	110.8 106.2	5.51 5.84	3.1 2.8	600 700	22.7 23.3	15.1 16.4	0.66 0.71	1.15 1.19	26.7 27.3	19.8 19.6	1.9 2.1
	6.0	2.4	5.6	600 700	26.9 27.8	1.42 1.39	22.1 23.1	111.6 106.8	5.54 5.88	3.2 2.9	600 700	23.0 23.4	15.1 16.4	0.66 0.70	1.11 1.15	26.8 27.4	20.7 20.3	1.8 2.0
90	3.0	0.7	1.7	600 700	27.5 28.4	1.44 1.40	22.5 23.6	112.4 107.5	5.59 5.96	3.3 3.1	600 700	20.9 21.4	14.6 15.8	0.70 0.74	1.38 1.42	25.6 26.2	15.2 15.0	2.5 2.7
	4.5	1.4	3.3	600 700	28.6 29.7	1.47 1.42	23.6 24.8	114.2 109.2	5.70 6.11	3.4 3.2	600 700	21.1 21.5	14.8 16.0	0.70 0.74	1.31 1.34	25.5 26.1	16.1 16.1	2.4 2.6
	6.0	2.3	5.4	600 700	29.1 30.2	1.49 1.44	24.0 25.3	114.9 109.9	5.72 6.15	3.5 3.3	600 700	21.4 21.7	14.8 16.0	0.69 0.74	1.26 1.31	25.7 26.2	16.9 16.7	2.2 2.4
100	3.0	0.7	1.7	Operation not recommended							Operation not recommended							
	4.5	1.4	3.2	Operation not recommended							Operation not recommended							
	6.0	2.2	5.2	600 700	20.2 20.6	14.4 15.6	0.71 0.76	1.48 1.52	25.2 25.8	13.6 13.5	2.9 3.2	600 700	20.4 20.8	14.4 15.6	0.70 0.75	1.43 1.48	25.3 25.9	14.2 14.1
110	3.0	0.7	1.6	Operation not recommended							Operation not recommended							
	4.5	1.3	3.1	Operation not recommended							Operation not recommended							
	6.0	2.2	5.0	600 700	18.1 18.5	13.8 15.0	0.76 0.81	1.67 1.72	23.8 24.3	10.9 10.8	3.6 3.9	600 700	18.3 18.7	13.8 15.0	0.76 0.81	1.62 1.67	23.8 24.3	11.3 11.2
120	3.0	0.7	1.5	Operation not recommended							Operation not recommended							
	4.5	1.3	2.9	Operation not recommended							Operation not recommended							
	6.0	2.1	4.8	600 700	16.8 17.1	13.4 14.5	0.79 0.85	1.89 1.94	23.3 23.8	8.9 8.8	4.3 4.7	600 700	17.0 17.3	13.4 14.5	0.79 0.84	1.83 1.89	23.2 23.8	9.3 9.2

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T1GX030 - Performance Data

Single Stage ECM2.3 (900 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F							COOLING - EAT 80/67 °F								
		PSI	FT/HD	Airflow CFM	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	Airflow CFM	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh	
20	4.0	1.5	3.5	Operation not recommended							Operation not recommended								
	6.0	3.1	7.2	Operation not recommended							Operation not recommended								
	8.0	5.2	12.1	700 900	16.9 17.2	1.52 1.55	11.7 11.9	92.4 87.7	3.26 3.25	2.2 2.0	Operation not recommended								
30	4.0	1.5	3.4	Operation not recommended							Operation not recommended								
	6.0	3.0	7.0	700 900	19.4 19.8	1.51 1.54	14.2 14.6	95.7 90.4	3.77 3.77	2.4 2.2	700 900	26.1 26.8	16.7 18.7	0.64 0.70	0.87 0.94	29.1 30.0	30.0 28.5	---	---
	8.0	5.1	11.8	700 900	19.9 20.2	1.53 1.56	14.7 14.9	96.3 90.8	3.82 3.81	2.4 2.2	700 900	26.3 27.3	16.7 18.7	0.63 0.68	0.85 0.91	29.2 30.4	30.8 30.0	---	---
40	4.0	1.4	3.3	Operation not recommended							Operation not recommended								
	6.0	2.9	6.8	700 900	22.7 23.3	1.56 1.58	17.4 17.9	100.1 93.9	4.27 4.31	2.6 2.4	700 900	28.3 29.1	18.0 20.2	0.64 0.70	0.95 1.02	31.5 32.6	29.7 28.4	---	---
	8.0	4.9	11.4	700 900	23.3 23.8	1.58 1.60	17.9 18.3	100.8 94.5	4.32 4.36	2.7 2.5	700 900	28.5 29.5	18.0 20.2	0.63 0.68	0.93 0.99	31.7 32.9	30.5 29.7	---	---
50	4.0	1.4	3.2	700 900	24.9 25.5	1.60 1.62	19.4 20.0	102.9 96.2	4.55 4.61	2.8 2.6	700 900	30.2 31.1	19.3 21.7	0.64 0.70	1.10 1.17	34.0 35.1	27.5 26.6	1.4 1.5	
	6.0	2.8	6.6	700 900	25.7 26.4	1.61 1.63	20.2 20.8	104.0 97.1	4.68 4.75	2.9 2.7	700 900	30.3 31.2	19.5 21.8	0.64 0.70	1.06 1.13	33.9 35.0	28.6 27.7	1.3 1.4	
	8.0	4.8	11.1	700 900	26.3 26.9	1.63 1.64	20.7 21.3	104.8 97.7	4.72 4.81	3.0 2.8	700 900	30.6 31.6	19.5 21.8	0.64 0.69	1.04 1.10	34.1 35.3	29.5 28.7	1.2 1.4	
60	4.0	1.4	3.1	700 900	27.9 28.7	1.67 1.67	22.2 23.0	107.0 99.5	4.90 5.02	3.2 3.0	700 900	29.5 30.4	18.9 21.3	0.64 0.70	1.21 1.28	33.6 34.7	24.4 23.7	1.7 1.8	
	6.0	2.8	6.4	700 900	28.9 29.7	1.69 1.69	23.1 23.9	108.2 100.6	5.01 5.16	3.3 3.0	700 900	29.6 30.5	19.1 21.3	0.65 0.70	1.16 1.23	33.5 34.7	25.4 24.7	1.6 1.7	
	8.0	4.6	10.7	700 900	29.5 30.3	1.71 1.70	23.6 24.5	109.0 101.1	5.05 5.21	3.4 3.1	700 900	29.9 30.8	19.1 21.4	0.64 0.69	1.14 1.20	33.8 34.9	26.2 25.6	1.5 1.6	
70	4.0	1.3	3.0	700 900	31.1 32.0	1.76 1.75	25.1 26.0	111.1 102.9	5.19 5.36	3.6 3.3	700 900	29.7 30.6	19.2 21.6	0.65 0.71	1.35 1.42	34.3 35.4	22.0 21.5	2.1 2.2	
	6.0	2.7	6.2	700 900	32.1 33.1	1.78 1.76	26.0 27.1	112.5 104.1	5.28 5.50	3.7 3.4	700 900	29.7 30.6	19.3 21.6	0.65 0.70	1.30 1.37	34.2 35.3	22.9 22.4	2.0 2.1	
	8.0	4.5	10.4	700 900	32.7 33.7	1.81 1.78	26.5 27.6	113.2 104.6	5.31 5.53	3.8 3.5	700 900	30.1 31.0	19.3 21.7	0.64 0.70	1.27 1.34	34.4 35.5	23.6 23.1	1.8 2.0	
80	4.0	1.3	2.9	700 900	33.6 34.7	1.84 1.81	27.3 28.5	114.4 105.7	5.36 5.61	4.0 3.7	700 900	28.4 29.3	19.0 21.3	0.67 0.73	1.51 1.58	33.6 34.7	18.9 18.5	2.6 2.8	
	6.0	2.6	5.9	700 900	34.8 36.0	1.87 1.83	28.4 29.7	116.0 107.0	5.46 5.75	4.1 3.8	700 900	28.6 29.4	19.1 21.3	0.67 0.72	1.45 1.52	33.5 34.6	19.7 19.4	2.5 2.7	
	8.0	4.3	10.0	700 900	35.3 36.5	1.89 1.85	28.9 30.2	116.7 107.6	5.47 5.77	4.3 3.9	700 900	28.8 29.7	19.1 21.4	0.66 0.72	1.42 1.49	33.7 34.8	20.3 19.9	2.3 2.5	
90	4.0	1.2	2.8	700 900	36.2 37.4	1.94 1.89	29.6 31.0	117.8 108.5	5.47 5.80	4.5 4.2	700 900	26.3 27.1	18.0 20.1	0.68 0.74	1.68 1.75	32.0 33.1	15.6 15.5	3.3 3.5	
	6.0	2.5	5.7	700 900	37.5 38.9	1.97 1.92	30.8 32.3	119.6 110.0	5.59 5.93	4.6 4.3	700 900	26.5 27.3	18.0 20.1	0.68 0.74	1.62 1.68	32.0 33.0	16.4 16.2	3.1 3.3	
	8.0	4.2	9.6	700 900	38.0 39.5	2.00 1.94	31.2 32.8	120.3 110.6	5.58 5.95	4.8 4.4	700 900	26.7 27.6	18.1 20.2	0.68 0.73	1.58 1.65	32.1 33.2	16.9 16.7	2.8 3.2	
100	4.0	1.2	2.7	Operation not recommended							Operation not recommended								
	6.0	2.4	5.5	Operation not recommended							Operation not recommended								
	8.0	4.0	9.3	700 900	25.3 26.0	1.80 1.77	18.0 18.9	0.71 0.77	1.83 1.89	31.5 32.5	13.8 13.8	3.8 4.1							
110	4.0	1.1	2.6	Operation not recommended							Operation not recommended								
	6.0	2.3	5.3	Operation not recommended							Operation not recommended								
	8.0	3.9	8.9	700 900	21.5 22.2	16.9 18.8	0.79 0.85	2.04 2.10	28.5 29.3	10.6 10.6	4.6 5.0								
120	4.0	1.1	2.5	Operation not recommended							Operation not recommended								
	6.0	2.2	5.1	Operation not recommended							Operation not recommended								
	8.0	3.7	8.6	700 900	20.8 21.4	16.3 18.1	0.78 0.85	2.30 2.35	28.7 29.5	9.1 9.1	5.5 6.0								

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T1GX036 - Performance Data

Single Stage ECM2.3 (1250 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F								COOLING - EAT 80/67 °F							
		PSI	FT/HD	Airflow CFM	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	Airflow CFM	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh	
																			Operation not recommended
20	5.0	1.0	2.4	Operation not recommended								Operation not recommended							
	7.0	2.1	4.9	Operation not recommended								Operation not recommended							
	9.0	3.6	8.2	1050 1250	21.0 21.4	1.83 1.87	14.8 15.0	88.5 85.8	3.36 3.35	2.7 2.4	Operation not recommended								
30	5.0	1.0	2.3	Operation not recommended								Operation not recommended							
	7.0	2.1	4.7	1050 1250	23.6 24.1	1.84 1.88	17.3 17.7	90.8 87.8	3.76 3.76	2.9 2.6	1050 1250	29.9 30.7	19.3 21.6	0.65 0.70	1.06 1.15	33.5 34.7	28.1 26.7	--- ---	
	9.0	3.5	8.0	1050 1250	24.2 24.6	1.86 1.89	17.9 18.1	91.3 88.2	3.82 3.81	3.0 2.7	1050 1250	30.1 31.2	19.2 21.5	0.64 0.69	1.05 1.11	33.7 35.0	28.8 28.1	--- ---	
40	5.0	1.0	2.3	Operation not recommended								Operation not recommended							
	7.0	2.0	4.6	1050 1250	27.4 28.0	1.89 1.92	20.9 21.5	94.2 90.8	4.24 4.28	3.2 3.0	1050 1250	32.7 33.7	21.5 24.1	0.66 0.71	1.17 1.25	36.7 38.0	28.1 26.9	--- ---	
	9.0	3.4	7.8	1050 1250	28.0 28.6	1.92 1.94	21.5 22.0	94.7 91.2	4.29 4.33	3.3 3.0	1050 1250	33.0 34.2	21.4 24.0	0.65 0.70	1.14 1.21	36.9 38.3	28.9 28.1	--- ---	
50	5.0	1.0	2.2	1050 1250	29.8 30.5	1.94 1.95	23.2 23.8	96.3 92.6	4.52 4.58	3.5 3.2	1050 1250	35.3 36.3	23.2 26.1	0.66 0.72	1.34 1.43	39.9 41.2	26.3 25.5	1.7 1.8	
	7.0	1.9	4.5	1050 1250	30.8 31.6	1.94 1.96	24.2 24.9	97.1 93.4	4.64 4.72	3.6 3.3	1050 1250	35.4 36.4	23.4 26.2	0.66 0.72	1.29 1.38	39.8 41.1	27.4 26.5	1.6 1.7	
	9.0	3.3	7.5	1050 1250	31.5 32.2	1.97 1.98	24.7 25.5	97.7 93.9	4.68 4.78	3.7 3.4	1050 1250	35.7 36.9	23.4 26.2	0.65 0.71	1.27 1.34	40.0 41.5	28.2 27.5	1.4 1.6	
60	5.0	0.9	2.1	1050 1250	33.4 34.3	1.99 1.99	26.6 27.5	99.4 95.4	4.92 5.04	3.9 3.6	1050 1250	35.0 36.1	23.7 26.7	0.68 0.74	1.46 1.55	40.0 41.4	23.9 23.2	2.0 2.1	
	7.0	1.9	4.3	1050 1250	34.5 35.5	2.01 2.01	27.6 28.6	100.4 96.3	5.03 5.18	4.0 3.7	1050 1250	35.1 36.2	23.9 26.7	0.68 0.74	1.41 1.49	39.9 41.2	24.9 24.2	1.9 2.0	
	9.0	3.1	7.3	1050 1250	35.2 36.2	2.04 2.03	28.2 29.2	101.0 96.8	5.06 5.23	4.2 3.8	1050 1250	35.5 36.6	23.9 26.8	0.67 0.73	1.38 1.46	40.2 41.6	25.7 25.0	1.7 1.9	
70	5.0	0.9	2.1	1050 1250	37.1 38.2	2.05 2.04	30.1 31.3	102.8 98.3	5.31 5.48	4.4 4.1	1050 1250	35.5 36.6	24.7 27.7	0.69 0.76	1.62 1.71	41.0 42.4	21.9 21.3	2.5 2.6	
	7.0	1.8	4.2	1050 1250	38.4 39.6	2.09 2.06	31.3 32.6	103.9 99.3	5.40 5.63	4.5 4.2	1050 1250	35.6 36.7	24.8 27.7	0.70 0.76	1.57 1.65	40.9 42.3	22.7 22.3	2.3 2.5	
	9.0	3.0	7.0	1050 1250	39.1 40.3	2.11 2.09	31.9 33.2	104.5 99.8	5.43 5.66	4.7 4.3	1050 1250	36.0 37.1	24.8 27.8	0.69 0.75	1.53 1.62	41.2 42.6	23.5 23.0	2.2 2.4	
80	5.0	0.9	2.0	1050 1250	40.1 41.4	2.11 2.08	32.9 34.3	105.4 100.7	5.57 5.83	4.9 4.6	1050 1250	34.6 35.7	24.6 27.5	0.71 0.77	1.80 1.89	40.8 42.1	19.2 18.9	3.1 3.3	
	7.0	1.7	4.0	1050 1250	41.6 43.0	2.15 2.11	34.3 35.8	106.7 101.8	5.68 5.97	5.1 4.7	1050 1250	34.8 35.8	24.6 27.5	0.71 0.77	1.73 1.81	40.7 42.0	20.0 19.8	2.9 3.1	
	9.0	2.9	6.8	1050 1250	42.2 43.7	2.18 2.13	34.8 36.4	107.2 102.3	5.69 6.00	5.2 4.8	1050 1250	35.1 36.2	24.7 27.6	0.70 0.76	1.70 1.78	40.9 42.3	20.7 20.3	2.7 3.0	
90	5.0	0.8	1.9	1050 1250	43.3 44.9	2.18 2.13	35.9 37.6	108.2 103.2	5.82 6.16	5.5 5.1	1050 1250	32.5 33.5	23.9 26.7	0.74 0.80	1.99 2.07	39.2 40.6	16.3 16.1	3.9 4.1	
	7.0	1.7	3.9	1050 1250	45.0 46.6	2.22 2.17	37.4 39.2	109.6 104.5	5.95 6.31	5.7 5.3	1050 1250	32.7 33.7	23.9 26.7	0.73 0.79	1.92 1.99	39.2 40.5	17.0 16.9	3.6 3.9	
	9.0	2.8	6.6	1050 1250	45.5 47.3	2.25 2.19	37.9 39.8	110.2 105.0	5.93 6.32	5.9 5.4	1050 1250	33.0 34.0	24.0 26.8	0.73 0.79	1.87 1.96	39.4 40.7	17.6 17.4	3.4 3.7	
100	5.0	0.8	1.8	Operation not recommended								Operation not recommended							
	7.0	1.6	3.8	1050 1250	31.8 32.7	23.8 26.5	0.75 0.81	2.15 2.22	39.1 40.3	14.8 14.8	4.5 4.8	1050 1250	32.0 33.1	23.9 26.6	0.75 0.81	2.10 2.18	39.2 40.5	15.3 15.2	4.1 4.6
	9.0	2.7	6.3	Operation not recommended								Operation not recommended							
110	5.0	0.8	1.8	Operation not recommended								Operation not recommended							
	7.0	1.6	3.6	Operation not recommended								Operation not recommended							
	9.0	2.6	6.1	1050 1250	28.6 29.5	22.1 24.6	0.77 0.84	2.38 2.45	36.7 37.8	12.0 12.0	5.4 5.9	1050 1250	28.8 29.8	22.2 24.7	0.77 0.83	2.32 2.39	36.8 38.0	12.4 12.4	5.0 5.6
120	5.0	0.7	1.7	Operation not recommended								Operation not recommended							
	7.0	1.5	3.5	1050 1250	26.9 27.6	21.8 24.2	0.81 0.88	2.66 2.72	35.9 36.9	10.1 10.1	6.5 7.1	1050 1250	27.0 28.0	22.0 24.3	0.81 0.87	2.60 2.66	35.9 37.0	10.4 10.5	6.1 6.7
	9.0	2.5	5.8	Operation not recommended								Operation not recommended							

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T1GX042 - Performance Data

Single Stage ECM2.3 (1350 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT/HD	Airflow CFM	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	Airflow CFM	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh
20	5.0	0.8	1.9	Operation not recommended							Operation not recommended							
	8.0	2.3	5.3	Operation not recommended							Operation not recommended							
	11.0	4.4	10.3	1150 1350	24.0 24.3	2.12 2.10	16.8 17.1	89.3 86.7	3.32 3.39	4.1 3.7	Operation not recommended							
30	5.0	0.8	1.8	Operation not recommended							Operation not recommended							
	8.0	2.2	5.1	1150 1350	27.9 28.3	2.16 2.14	20.6 21.0	92.5 89.4	3.80 3.87	4.3 3.9	1150 1350	40.2 42.1	25.0 28.1	0.62 0.67	1.37 1.45	44.9 47.0	29.3 29.0	---
	11.0	4.3	10.0	1150 1350	28.3 28.7	2.16 2.14	21.0 21.4	92.8 89.7	3.85 3.93	4.4 4.0	1150 1350	40.6 42.5	25.0 28.1	0.62 0.66	1.33 1.41	45.1 47.3	30.5 30.2	---
40	5.0	0.8	1.8	Operation not recommended							Operation not recommended							
	8.0	2.1	4.9	1150 1350	31.8 32.3	2.24 2.21	24.1 24.7	95.6 92.1	4.15 4.28	4.7 4.3	1150 1350	41.9 43.8	26.7 30.0	0.64 0.68	1.46 1.54	46.9 49.0	28.7 28.4	---
	11.0	4.2	9.7	1150 1350	32.4 32.9	2.25 2.21	24.7 25.3	96.1 92.5	4.21 4.35	4.9 4.4	1150 1350	42.3 44.2	26.7 30.0	0.63 0.68	1.42 1.49	47.2 49.3	29.9 29.6	---
50	5.0	0.7	1.7	1150 1350	34.2 34.8	2.26 2.21	26.5 27.2	97.5 93.8	4.44 4.61	5.1 4.7	1150 1350	42.6 44.4	27.5 30.9	0.65 0.70	1.65 1.74	50.3 48.3	25.8 25.5	2.5 2.6
	8.0	2.1	4.8	1150 1350	35.6 36.2	2.31 2.26	27.7 28.5	98.7 94.8	4.52 4.71	5.3 4.8	1150 1350	43.1 44.8	27.8 31.3	0.65 0.70	1.58 1.66	48.4 50.5	27.3 27.0	2.3 2.5
	11.0	4.1	9.4	1150 1350	36.3 37.0	2.32 2.27	28.4 29.3	99.3 95.4	4.58 4.78	5.4 5.0	1150 1350	43.5 45.3	27.8 31.3	0.64 0.69	1.53 1.61	48.7 50.8	28.4 28.1	2.1 2.4
60	5.0	0.7	1.7	1150 1350	37.5 38.3	2.32 2.26	29.6 30.5	100.2 96.2	4.73 4.96	5.7 5.3	1150 1350	42.5 44.1	28.2 31.7	0.66 0.72	1.82 1.91	48.7 50.6	23.4 23.1	3.0 3.2
	8.0	2.0	4.6	1150 1350	39.2 40.0	2.39 2.32	31.0 32.1	101.6 97.4	4.80 5.06	5.9 5.4	1150 1350	43.0 44.7	28.5 32.0	0.66 0.72	1.73 1.81	48.9 50.9	24.9 24.6	2.8 3.0
	11.0	3.9	9.1	1150 1350	40.1 41.0	2.41 2.34	31.9 33.0	102.3 98.1	4.87 5.14	6.1 5.6	1150 1350	43.4 45.1	28.5 32.0	0.66 0.71	1.68 1.76	49.2 51.1	25.9 25.6	2.6 2.9
70	5.0	0.7	1.6	1150 1350	40.7 41.6	2.40 2.32	32.5 33.7	102.8 98.6	4.97 5.26	6.4 6.0	1150 1350	42.6 44.2	29.1 32.7	0.68 0.74	2.01 2.10	49.5 51.4	21.2 21.0	3.8 4.0
	8.0	1.9	4.5	1150 1350	42.7 43.7	2.48 2.39	34.2 35.5	104.4 100.0	5.04 5.36	6.6 6.1	1150 1350	43.3 44.9	29.4 33.1	0.68 0.74	1.91 2.00	49.8 51.7	22.7 22.5	3.5 3.8
	11.0	3.8	8.8	1150 1350	43.8 44.9	2.51 2.42	35.2 36.6	105.2 100.8	5.11 5.45	6.8 6.3	1150 1350	43.7 45.3	29.4 33.1	0.67 0.73	1.85 1.94	50.0 51.9	23.6 23.4	3.3 3.6
80	5.0	0.7	1.6	1150 1350	43.7 44.9	2.44 2.34	35.4 36.9	105.2 100.8	5.26 5.63	7.2 6.7	1150 1350	41.0 42.4	28.5 32.0	0.69 0.75	2.24 2.33	48.7 50.4	18.4 18.2	4.8 5.1
	8.0	1.9	4.3	1150 1350	46.0 47.3	2.54 2.42	37.4 39.0	107.0 102.4	5.32 5.72	7.5 6.9	1150 1350	41.8 43.2	28.8 32.3	0.69 0.75	2.12 2.21	49.0 50.7	19.7 19.5	4.5 4.8
	11.0	3.7	8.5	1150 1350	47.3 48.7	2.57 2.46	38.6 40.3	108.1 103.4	5.39 5.82	7.7 7.1	1150 1350	42.2 43.6	28.8 32.3	0.68 0.74	2.06 2.15	49.2 50.9	20.5 20.3	4.1 4.6
90	5.0	0.7	1.5	1150 1350	46.7 48.0	2.48 2.37	38.2 40.0	107.6 102.9	5.51 5.95	8.1 7.5	1150 1350	38.9 40.1	27.6 31.1	0.71 0.78	2.50 2.60	47.4 48.9	15.6 15.4	6.0 6.4
	8.0	1.8	4.2	1150 1350	49.2 50.8	2.60 2.47	40.4 42.4	109.6 104.8	5.55 6.03	8.4 7.8	1150 1350	39.7 40.9	27.9 31.4	0.70 0.77	2.36 2.46	47.7 49.3	16.8 16.6	5.6 6.1
	11.0	3.5	8.2	1150 1350	50.8 52.4	2.64 2.51	41.8 43.9	110.9 106.0	5.63 6.14	8.6 8.0	1150 1350	40.1 41.3	27.9 31.4	0.70 0.76	2.29 2.39	47.9 49.4	17.5 17.3	5.2 5.8
100	5.0	0.6	1.5	Operation not recommended							Operation not recommended							
	8.0	1.7	4.0	Operation not recommended							1150 1350	38.2 39.2	27.4 30.8	0.72 0.78	2.63 2.73	47.1 48.6	14.5 14.4	6.9 7.5
	11.0	3.4	7.9	Operation not recommended							1150 1350	38.5 39.6	27.4 30.8	0.71 0.78	2.55 2.65	47.3 48.7	15.1 15.0	6.4 7.2
110	5.0	0.6	1.4	Operation not recommended							Operation not recommended							
	8.0	1.7	3.9	Operation not recommended							1150 1350	34.8 35.7	25.3 28.5	0.73 0.80	2.93 3.04	44.8 46.1	11.9 11.7	8.5 9.2
	11.0	3.3	7.6	Operation not recommended							1150 1350	35.1 36.0	25.3 28.5	0.72 0.79	2.85 2.95	44.9 46.1	12.3 12.2	7.9 8.8
120	5.0	0.6	1.3	Operation not recommended							Operation not recommended							
	8.0	1.6	3.7	Operation not recommended							1150 1350	32.8 33.5	25.0 28.1	0.76 0.84	3.26 3.37	43.9 45.1	10.1 9.9	10.3 11.1
	11.0	3.2	7.3	Operation not recommended							1150 1350	33.1 33.9	25.0 28.1	0.76 0.83	3.17 3.27	43.9 45.1	10.5 10.4	9.5 10.6

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T1GX048 - Performance Data

Single Stage ECM2.3 (1500 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F							COOLING - EAT 80/67 °F														
		PSI	FT/HD	Airflow CFM	HC kBtu/h	Power kW	HE kBtu/h	LAT °F	COP	HWC kBtu/h	Airflow CFM	TC kBtu/h	SC kBtu/h	S/T Ratio	Power kW	HR kBtu/h	EER	HWC kBtu/h							
20	6.0	1.1	2.6	Operation not recommended							Operation not recommended														
	9.0	2.3	5.4	Operation not recommended							Operation not recommended														
	12.0	4.0	9.2	1300	31.6	2.84	21.9	92.5	3.26	5.3	1500	32.0	2.82	22.4	89.7	3.33	4.8								
30	6.0	1.1	2.5	Operation not recommended							Operation not recommended														
	9.0	2.3	5.3	1300	36.3	2.92	26.3	95.8	3.64	5.6	1500	36.7	2.90	26.8	92.6	3.71	5.2	1300	48.2	30.2	0.63	1.61	53.7	29.9	---
	12.0	3.9	9.0	1300	36.8	2.93	26.8	96.2	3.68	5.8	1500	37.2	2.90	27.3	93.0	3.76	5.3	1300	48.7	30.2	0.62	1.56	54.0	31.2	---
40	6.0	1.1	2.5	Operation not recommended							Operation not recommended														
	9.0	2.2	5.1	1300	41.7	3.05	31.3	99.7	4.00	6.2	1500	42.2	3.00	32.0	96.1	4.13	5.7	1300	50.1	31.9	0.64	1.77	56.1	28.3	---
	12.0	3.8	8.7	1300	42.4	3.06	31.9	100.2	4.06	6.4	1500	43.0	3.01	32.7	96.5	4.19	5.8	1300	50.6	31.9	0.63	1.72	56.5	29.5	---
50	6.0	1.0	2.4	1300	44.7	3.09	34.1	101.8	4.24	6.7	1500	45.4	3.02	35.1	98.0	4.40	6.2	1300	51.2	33.1	0.65	2.06	58.2	24.9	2.9
	9.0	2.1	4.9	1300	46.5	3.16	35.7	103.1	4.32	6.9	1500	47.3	3.08	36.7	99.2	4.49	6.4	1300	51.7	33.4	0.65	1.96	58.4	26.3	2.7
	12.0	3.7	8.4	1300	47.4	3.18	36.6	103.8	4.37	7.2	1500	48.2	3.10	37.7	99.8	4.56	6.5	1300	52.2	33.4	0.64	1.91	58.7	27.4	2.5
60	6.0	1.0	2.3	1300	49.1	3.18	38.2	105.0	4.52	7.6	1500	50.0	3.10	39.5	100.9	4.74	7.0	1300	50.0	32.7	0.65	2.29	57.8	21.9	3.5
	9.0	2.1	4.8	1300	51.3	3.28	40.1	106.5	4.59	7.8	1500	52.3	3.18	41.5	102.3	4.83	7.2	1300	50.6	33.0	0.65	2.17	58.0	23.3	3.3
	12.0	3.5	8.2	1300	52.5	3.31	41.2	107.4	4.65	8.0	1500	53.6	3.20	42.7	103.1	4.91	7.4	1300	51.1	33.0	0.65	2.11	58.3	24.2	3.0
70	6.0	1.0	2.2	1300	53.6	3.29	42.4	108.2	4.78	8.5	1500	54.7	3.17	43.9	103.8	5.05	7.9	1300	49.7	33.1	0.66	2.56	58.5	19.4	4.4
	9.0	2.0	4.6	1300	56.1	3.40	44.5	110.0	4.84	8.8	1500	57.4	3.27	46.3	105.5	5.14	8.1	1300	50.5	33.4	0.66	2.43	58.8	20.8	4.1
	12.0	3.4	7.9	1300	57.6	3.44	45.8	111.0	4.91	9.0	1500	59.0	3.31	47.7	106.4	5.22	8.3	1300	51.0	33.4	0.65	2.36	59.1	21.6	3.8
80	6.0	0.9	2.1	1300	57.1	3.37	45.6	110.7	4.97	9.6	1500	58.6	3.23	47.5	106.2	5.32	8.8	1300	47.7	32.3	0.68	2.87	57.5	16.6	5.6
	9.0	1.9	4.5	1300	60.1	3.50	48.1	112.8	5.03	9.8	1500	61.7	3.35	50.3	108.1	5.40	9.1	1300	48.5	32.7	0.67	2.71	57.8	17.9	5.2
	12.0	3.3	7.6	1300	61.8	3.55	49.7	114.0	5.10	10.1	1500	63.5	3.39	51.9	109.2	5.49	9.4	1300	49.0	32.7	0.67	2.64	58.0	18.6	4.8
90	6.0	0.9	2.1	1300	60.7	3.45	48.9	113.2	5.16	10.7	1500	62.4	3.29	51.2	108.5	5.56	9.9	1300	44.5	30.8	0.69	3.20	55.4	13.9	7.0
	9.0	1.9	4.3	1300	64.1	3.61	51.7	115.6	5.20	11.1	1500	66.0	3.43	54.3	110.7	5.64	10.2	1300	45.4	31.2	0.69	3.03	55.7	15.0	6.5
	12.0	3.2	7.4	1300	66.1	3.67	53.5	117.0	5.27	11.4	1500	68.1	3.48	56.2	112.0	5.74	10.6	1300	45.9	31.2	0.68	2.94	55.9	15.6	6.1
100	6.0	0.9	2.0	Operation not recommended							Operation not recommended														
	9.0	1.8	4.2	Operation not recommended							Operation not recommended														
	12.0	3.1	7.1	1300	43.9	30.7	0.70	3.39	55.4	12.9	8.1	1500	45.1	34.5	0.77	3.52	57.1	12.8	8.8						
110	6.0	0.8	1.9	Operation not recommended							Operation not recommended														
	9.0	1.7	4.0	Operation not recommended							Operation not recommended														
	12.0	3.0	6.8	1300	39.7	28.5	0.72	3.78	52.5	10.5	9.9	1500	40.7	32.0	0.79	3.91	54.0	10.4	10.8						
120	6.0	0.8	1.8	Operation not recommended							Operation not recommended														
	9.0	1.7	3.8	Operation not recommended							Operation not recommended														
	12.0	2.8	6.6	1300	37.6	28.0	0.74	4.21	51.9	8.9	12.0	1500	38.4	31.4	0.82	4.36	53.3	8.8	13.0						

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T1GX060 - Performance Data

Single Stage ECM2.3 (2000 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT/HD	Airflow CFM	HC kBtu/h	Power kW	HE kBtu/h	LAT °F	COP	HWC kBtu/h	Airflow CFM	TC kBtu/h	SC kBtu/h	S/T Ratio	Power kW	HR kBtu/h	EER	HWC kBtu/h
20	9.0	2.5	5.7	Operation not recommended							Operation not recommended							
	12.0	4.0	9.2	Operation not recommended							Operation not recommended							
	15.0	5.9	13.5	1500 2000	37.9 38.6	3.66 3.73	25.4 25.9	93.4 87.9	3.03 3.03	6.5 5.8								
30	9.0	2.4	5.5	Operation not recommended							Operation not recommended							
	12.0	3.9	8.9	1500 2000	42.7 43.5	3.66 3.73	30.2 30.8	96.3 90.1	3.41 3.42	6.8 6.2	1500 2000	73.6 71.2	46.9 48.3	0.64 0.68	2.16 2.61	81.0 80.2	34.1 27.3	--- ---
	15.0	5.7	13.1	1500 2000	44.0 44.9	3.76 3.83	31.2 31.8	97.2 90.8	3.43 3.44	7.0 6.4	1500 2000	74.3 72.4	47.0 47.8	0.63 0.66	2.16 2.44	81.7 80.8	34.4 29.6	--- ---
40	9.0	2.3	5.3	Operation not recommended							Operation not recommended							
	12.0	3.7	8.7	1500 2000	50.3 51.5	3.82 3.90	37.3 38.2	101.1 93.8	3.86 3.87	7.5 6.9	1500 2000	73.4 72.7	47.4 49.5	0.65 0.68	2.40 2.81	81.6 82.3	30.6 25.9	--- ---
	15.0	5.5	12.7	1500 2000	51.7 52.7	3.91 3.97	38.4 39.2	101.9 94.4	3.88 3.89	7.8 7.1	1500 2000	74.1 73.6	47.6 49.3	0.64 0.67	2.39 2.65	82.3 82.6	31.0 27.7	--- ---
50	9.0	2.2	5.2	1500 2000	56.2 56.8	3.96 4.01	42.7 43.1	104.7 96.3	4.15 4.15	8.1 7.5	1500 2000	73.6 73.9	48.4 50.2	0.66 0.68	2.81 3.15	83.2 84.6	26.2 23.5	3.9 4.1
	12.0	3.6	8.4	1500 2000	56.8 58.3	3.95 4.05	43.3 44.4	105.0 97.0	4.21 4.21	8.4 7.7	1500 2000	73.8 73.9	48.5 50.7	0.66 0.69	2.71 3.09	83.0 84.4	27.2 23.9	3.6 3.9
	15.0	5.3	12.3	1500 2000	58.2 59.3	4.04 4.09	44.4 45.3	105.9 97.5	4.23 4.25	8.6 7.9	1500 2000	74.5 74.6	48.7 50.7	0.65 0.68	2.70 2.94	83.7 84.7	27.6 25.4	3.4 3.7
60	9.0	2.2	5.0	1500 2000	62.1 63.6	4.10 4.11	48.1 49.5	108.3 109.3	4.44 4.53	9.1 9.4	1500 2000	69.9 71.5	46.2 49.1	0.66 0.69	3.04 3.33	80.3 82.9	23.0 21.4	4.7 5.0
	12.0	3.5	8.1	1500 2000	63.6 64.5	4.11 4.17	49.5 50.3	109.3 99.9	4.53 4.53	9.4 8.7	1500 2000	70.1 71.8	46.4 49.3	0.66 0.69	2.93 3.24	80.1 82.9	23.9 22.2	4.4 4.8
	15.0	5.2	11.9	1500 2000	65.0 66.3	4.19 4.24	50.7 51.9	110.1 100.7	4.55 4.59	9.7 8.9	1500 2000	70.8 72.2	46.7 49.6	0.66 0.69	2.91 3.12	80.7 82.8	24.4 23.2	4.1 4.6
70	9.0	2.1	4.9	1500 2000	68.2 69.6	4.25 4.27	53.7 55.1	112.1 102.2	4.71 4.78	10.3 9.5	1500 2000	67.2 70.2	45.2 49.1	0.67 0.70	3.42 3.68	78.9 82.7	19.7 19.1	5.9 6.3
	12.0	3.4	7.9	1500 2000	70.6 70.9	4.29 4.31	56.0 56.2	113.6 102.8	4.83 4.82	10.6 9.8	1500 2000	67.5 70.9	45.5 49.1	0.67 0.69	3.29 3.54	78.7 83.0	20.5 20.0	5.5 6.0
	15.0	5.0	11.6	1500 2000	72.0 73.6	4.35 4.40	57.1 58.6	114.4 104.1	4.84 4.90	10.9 10.0	1500 2000	68.2 70.9	45.8 49.6	0.67 0.70	3.25 3.44	79.3 82.6	21.0 20.6	5.1 5.7
80	9.0	2.0	4.7	1500 2000	72.9 74.2	4.36 4.37	58.0 59.3	115.0 104.4	4.90 4.98	11.5 10.7	1500 2000	65.4 67.1	44.6 47.7	0.68 0.71	3.81 4.06	78.4 80.9	17.2 16.5	7.5 8.0
	12.0	3.3	7.6	1500 2000	76.2 76.8	4.44 4.39	61.0 61.8	117.0 105.6	5.03 5.13	11.9 11.0	1500 2000	65.8 67.8	45.0 47.7	0.68 0.70	3.66 3.87	78.2 81.0	18.0 17.5	7.0 7.6
	15.0	4.8	11.2	1500 2000	77.4 78.9	4.49 4.53	62.0 63.5	117.8 106.5	5.05 5.11	12.2 11.3	1500 2000	66.4 68.1	45.4 48.2	0.68 0.71	3.60 3.76	78.7 80.9	18.4 18.1	6.5 7.2
90	9.0	2.0	4.5	1500 2000	77.8 79.0	4.49 4.49	62.4 63.7	118.0 106.6	5.07 5.16	13.0 12.0	1500 2000	62.1 62.6	43.2 45.5	0.70 0.73	4.20 4.45	76.4 77.7	14.8 14.1	9.4 10.0
	12.0	3.2	7.3	1500 2000	81.9 82.9	4.60 4.49	66.2 67.6	120.6 108.4	5.22 5.41	13.4 12.4	1500 2000	62.6 63.2	43.7 45.5	0.70 0.72	4.03 4.20	76.3 77.5	15.5 15.0	8.8 9.5
	15.0	4.7	10.8	1500 2000	83.0 84.5	4.65 4.68	67.1 68.5	121.2 109.1	5.24 5.30	13.8 12.8	1500 2000	63.2 63.8	44.1 46.0	0.70 0.72	3.96 4.08	76.7 77.7	16.0 15.7	8.2 9.1
100	9.0	1.9	4.4	Operation not recommended							Operation not recommended							
	12.0	3.1	7.1	1500 2000	60.1 60.7	42.9 44.7	0.71 0.74	4.59 4.70	75.7 76.7	13.1 12.9	10.9 11.8							
	15.0	4.5	10.4	1500 2000	60.7 61.3	43.4 45.2	0.72 0.74	4.49 4.58	76.0 76.9	13.5 13.4	10.1 11.2							
110	9.0	1.8	4.2	Operation not recommended							Operation not recommended							
	12.0	2.9	6.8	Operation not recommended							Operation not recommended							
	15.0	4.3	10.0	1500 2000	54.9 55.5	39.9 41.5	0.73 0.75	5.08 5.14	72.3 73.0	10.8 10.8	13.4 14.5							
120	9.0	1.7	4.0	Operation not recommended							Operation not recommended							
	12.0	2.8	6.5	Operation not recommended							Operation not recommended							
	15.0	4.2	9.6	1500 2000	53.4 52.7	41.1 41.7	0.77 0.79	5.62 5.63	72.6 71.9	9.5 9.4	15.0 16.7							

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T1GX070 - Performance Data

Single Stage ECM2.3 (2200 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F							COOLING - EAT 80/67 °F																						
		PSI	FT/HD	Airflow CFM	HC kBTuh	Power kW	HE kBTuh	LAT °F	COP	HWC kBTuh	Airflow CFM	TC kBTuh	SC kBTuh	S/T Ratio	Power kW	HR kBTuh	EER	HWC kBTuh															
																			Operation not recommended														
20	12.0	3.0	7.0	Operation not recommended							Operation not recommended																						
	15.0	4.4	10.2	Operation not recommended							Operation not recommended																						
	18.0	6.0	13.9	1700	44.7	4.37	29.8	94.3	3.00	7.7	2200	45.7	4.46	30.5	89.2	3.01	6.9	Operation not recommended															
30	12.0	3.0	6.8	Operation not recommended							Operation not recommended																						
	15.0	4.3	9.9	1700	51.5	4.47	36.2	98.0	3.38	8.1	2200	52.7	4.57	37.2	92.2	3.38	7.4	1700	69.3	43.4	0.63	2.39	77.5	29.0	---	2200	73.9	49.6	0.67	2.79	83.4	26.5	---
	18.0	5.8	13.5	1700	51.7	4.49	36.4	98.2	3.38	8.4	2200	52.9	4.58	37.3	92.3	3.39	7.6	1700	69.7	42.9	0.62	2.38	77.8	29.3	---	2200	74.3	49.0	0.66	2.78	83.8	26.7	---
40	12.0	2.9	6.6	Operation not recommended							Operation not recommended																						
	15.0	4.1	9.6	1700	60.1	4.66	44.2	102.7	3.78	8.9	2200	61.5	4.72	45.5	95.9	3.82	8.2	1700	73.1	46.1	0.63	2.63	82.1	27.8	---	2200	77.6	52.7	0.68	3.03	87.9	25.6	---
	18.0	5.7	13.1	1700	60.5	4.69	44.5	102.9	3.78	9.2	2200	62.0	4.74	45.8	96.1	3.83	8.4	1700	73.7	45.9	0.62	2.61	82.6	28.2	---	2200	78.2	52.5	0.67	3.01	88.5	26.0	---
50	12.0	2.8	6.4	1700	66.2	4.81	49.8	106.1	4.04	9.7	2200	67.9	4.83	51.4	98.6	4.12	8.9	1700	76.7	48.4	0.63	3.01	86.9	25.5	4.3	2200	81.0	55.4	0.68	3.43	92.7	23.6	4.5
	15.0	4.0	9.3	1700	67.6	4.85	51.0	106.8	4.08	10.0	2200	69.2	4.86	52.7	99.1	4.17	9.2	1700	77.0	48.7	0.63	2.92	87.0	26.4	4.0	2200	81.4	55.7	0.68	3.33	92.8	24.5	4.3
	18.0	5.5	12.7	1700	68.2	4.89	51.5	107.1	4.09	10.3	2200	69.9	4.89	53.2	99.4	4.19	9.4	1700	77.8	48.9	0.63	2.89	87.7	26.9	3.7	2200	82.3	55.9	0.68	3.29	93.5	25.0	4.1
60	12.0	2.7	6.2	1700	73.4	5.00	56.4	110.0	4.30	10.8	2200	75.3	4.97	58.3	101.7	4.44	10.0	1700	73.7	46.9	0.64	3.31	85.0	22.3	5.2	2200	77.6	53.6	0.69	3.72	90.3	20.8	5.5
	15.0	3.9	9.0	1700	75.5	5.07	58.3	111.1	4.37	11.2	2200	77.5	5.03	60.3	102.6	4.52	10.3	1700	74.1	47.0	0.63	3.22	85.0	23.0	4.8	2200	78.0	53.8	0.69	3.62	90.3	21.6	5.2
	18.0	5.3	12.3	1700	76.4	5.11	59.0	111.6	4.38	11.5	2200	78.4	5.06	61.2	103.0	4.54	10.6	1700	75.0	47.6	0.64	3.17	85.8	23.6	4.5	2200	78.9	54.5	0.69	3.57	91.1	22.1	5.0
70	12.0	2.6	6.0	1700	81.0	5.21	63.2	114.1	4.56	12.2	2200	83.1	5.13	65.6	105.0	4.75	11.3	1700	73.5	47.5	0.65	3.69	86.1	19.9	6.5	2200	77.1	54.4	0.71	4.11	91.1	18.8	6.9
	15.0	3.8	8.7	1700	83.9	5.30	65.8	115.7	4.64	12.6	2200	86.2	5.21	68.4	106.3	4.85	11.6	1700	73.8	47.6	0.65	3.59	86.0	20.6	6.1	2200	77.4	54.5	0.70	3.99	91.0	19.4	6.6
	18.0	5.1	11.9	1700	85.1	5.35	66.8	116.3	4.66	13.0	2200	87.4	5.25	69.5	106.8	4.88	11.9	1700	74.9	48.7	0.65	3.53	86.9	21.2	5.6	2200	78.5	55.7	0.71	3.93	91.9	20.0	6.3
80	12.0	2.5	5.8	1700	86.5	5.40	68.0	117.1	4.69	13.7	2200	88.9	5.27	70.9	107.4	4.94	12.7	1700	70.5	45.5	0.65	4.12	84.5	17.1	8.2	2200	73.6	52.1	0.71	4.53	89.1	16.3	8.7
	15.0	3.6	8.4	1700	90.4	5.52	71.6	119.2	4.80	14.1	2200	93.0	5.38	74.6	109.1	5.07	13.1	1700	70.7	45.5	0.64	4.00	84.4	17.7	7.7	2200	73.8	52.1	0.71	4.40	88.9	16.8	8.3
	18.0	5.0	11.5	1700	91.8	5.58	72.8	120.0	4.82	14.6	2200	94.6	5.42	76.1	109.8	5.11	13.5	1700	71.9	46.9	0.65	3.92	85.3	18.3	7.1	2200	75.1	53.7	0.72	4.31	89.8	17.4	7.9
90	12.0	2.4	5.6	1700	92.4	5.62	73.2	120.3	4.82	15.4	2200	95.1	5.43	76.5	110.0	5.13	14.3	1700	64.7	42.2	0.65	4.57	80.3	14.2	10.3	2200	67.3	48.4	0.72	4.98	84.3	13.5	10.9
	15.0	3.5	8.1	1700	97.3	5.76	77.6	123.0	4.95	15.9	2200	100.2	5.56	81.2	112.2	5.28	14.7	1700	64.9	42.1	0.65	4.45	80.1	14.6	9.6	2200	67.5	48.3	0.72	4.84	84.0	13.9	10.4
	18.0	4.8	11.1	1700	99.0	5.83	79.1	123.9	4.98	16.4	2200	102.2	5.61	83.0	113.0	5.34	15.2	1700	66.2	43.8	0.66	4.35	81.0	15.2	8.9	2200	68.8	50.3	0.73	4.73	85.0	14.6	9.9
100	12.0	2.3	5.4	Operation not recommended							Operation not recommended																						
	15.0	3.4	7.8	Operation not recommended							Operation not recommended																						
	18.0	4.6	10.7	Operation not recommended							Operation not recommended																						
110	12.0	2.2	5.2	Operation not recommended							Operation not recommended																						
	15.0	3.3	7.5	Operation not recommended							Operation not recommended																						
	18.0	4.4	10.2	Operation not recommended							Operation not recommended																						
120	12.0	2.2	5.0	Operation not recommended							Operation not recommended																						
	15.0	3.1	7.2	Operation not recommended							Operation not recommended																						
	18.0	4.3	9.8	Operation not recommended							Operation not recommended																						

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T2GX026 - Performance Data

Dual Stage ECM2.3 Low Speed (700 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F								COOLING - EAT 80/67 °F							
		PSI	FT/HD	Airflow CFM	HC kBTuh	Power kW	HE kBTuh	LAT °F	COP	HWC kBTuh	Airflow CFM	TC kBTuh	SC kBTuh	S/T Ratio	Power kW	HR kBTuh	EER	HWC kBTuh	
20	3.0	0.8	1.9	Operation not recommended								Operation not recommended							
	5.0	2.0	4.7	Operation not recommended								Operation not recommended							
	7.0	3.7	8.7	500 700	11.9 12.1	1.07 1.08	8.3 8.4	92.0 86.0	3.27 3.28	1.8 1.6	500 700	22.0 22.4	14.6 16.0	0.66 0.71	0.54 0.57	23.9 24.3	40.7 39.3	---	
30	3.0	0.8	1.8	Operation not recommended								Operation not recommended							
	5.0	2.0	4.5	500 700	13.7 14.0	1.08 1.09	10.0 10.2	95.3 88.5	3.71 3.76	1.8 1.6	500 700	22.0 22.4	14.6 16.0	0.66 0.71	0.54 0.57	23.9 24.3	40.7 39.3	---	
	7.0	3.6	8.4	500 700	14.0 14.1	1.09 1.10	10.2 10.4	95.8 88.7	3.76 3.78	1.8 1.6	500 700	22.2 22.7	14.6 16.0	0.66 0.70	0.52 0.55	23.9 24.6	42.2 41.2	---	
40	3.0	0.8	1.8	Operation not recommended								Operation not recommended							
	5.0	1.9	4.4	500 700	16.1 16.4	1.09 1.09	12.4 12.7	99.9 91.8	4.34 4.41	1.8 1.7	500 700	22.9 23.3	15.3 16.6	0.67 0.71	0.59 0.62	24.9 25.4	38.5 37.4	---	
	7.0	3.5	8.2	500 700	16.4 16.7	1.10 1.10	12.6 13.0	100.4 92.1	4.36 4.44	1.9 1.7	500 700	23.0 23.6	15.3 16.6	0.66 0.71	0.58 0.60	25.0 25.6	40.0 39.1	---	
50	3.0	0.7	1.7	500 700	17.4 17.8	1.09 1.09	13.7 14.1	102.3 93.5	4.71 4.80	1.9 1.7	500 700	23.3 23.8	15.6 17.1	0.67 0.72	0.70 0.73	25.7 26.3	33.2 32.6	0.7 0.8	
	5.0	1.8	4.3	500 700	18.3 18.7	1.11 1.11	14.5 14.9	103.9 94.7	4.84 4.93	1.9 1.8	500 700	23.5 24.0	15.8 17.2	0.67 0.72	0.67 0.70	25.8 26.4	35.3 34.6	0.7 0.7	
	7.0	3.4	7.9	500 700	18.6 19.0	1.13 1.12	14.7 15.2	104.4 95.2	4.84 4.99	2.0 1.8	500 700	23.8 24.3	15.8 17.2	0.66 0.71	0.65 0.67	26.0 26.6	36.8 36.0	0.6 0.7	
60	3.0	0.7	1.7	500 700	19.7 20.2	1.10 1.09	16.0 16.4	106.5 96.7	5.23 5.41	2.1 1.9	500 700	22.6 23.0	15.4 16.7	0.68 0.73	0.79 0.82	25.3 25.8	28.5 27.9	1.0 1.0	
	5.0	1.8	4.1	500 700	20.6 21.2	1.13 1.12	16.8 17.4	108.2 98.0	5.37 5.54	2.1 2.0	500 700	22.8 23.3	15.5 16.9	0.68 0.73	0.75 0.78	25.3 25.9	30.3 29.7	0.9 1.0	
	7.0	3.3	7.6	500 700	21.0 21.5	1.14 1.13	17.1 17.7	108.9 98.5	5.39 5.60	2.2 2.0	500 700	23.0 23.5	15.5 16.9	0.67 0.72	0.73 0.76	25.5 26.0	31.5 31.0	0.8 0.9	
70	3.0	0.7	1.6	500 700	22.1 22.7	1.12 1.10	18.3 18.9	111.0 100.0	5.80 6.05	2.3 2.1	500 700	22.6 23.0	15.6 16.9	0.69 0.74	0.90 0.94	25.6 26.2	24.9 24.5	1.3 1.4	
	5.0	1.7	4.0	500 700	23.1 23.8	1.14 1.13	19.2 20.0	112.8 101.5	5.94 6.20	2.4 2.2	500 700	22.7 23.3	15.7 17.1	0.69 0.74	0.85 0.89	25.7 26.3	26.6 26.1	1.3 1.4	
	7.0	3.2	7.4	500 700	23.5 24.2	1.15 1.13	19.6 20.3	113.6 101.9	5.97 6.25	2.4 2.2	500 700	23.0 23.4	15.7 17.1	0.68 0.73	0.83 0.86	25.8 26.4	27.6 27.2	1.2 1.3	
80	3.0	0.7	1.6	500 700	24.0 24.7	1.15 1.12	20.1 20.9	114.5 102.7	6.13 6.47	2.6 2.4	500 700	21.3 21.7	15.0 16.3	0.71 0.75	1.03 1.07	24.8 25.4	20.6 20.3	1.8 1.9	
	5.0	1.7	3.9	500 700	25.1 25.9	1.17 1.15	21.1 22.0	116.4 104.3	6.26 6.63	2.6 2.4	500 700	21.4 21.9	15.2 16.5	0.71 0.75	0.98 1.01	24.8 25.4	21.9 21.7	1.7 1.9	
	7.0	3.1	7.1	500 700	25.5 26.3	1.19 1.16	21.5 22.4	117.2 104.8	6.29 6.68	2.7 2.5	500 700	21.7 22.1	15.2 16.5	0.70 0.75	0.95 0.98	25.0 25.5	22.9 22.5	1.6 1.8	
90	3.0	0.7	1.5	500 700	26.0 26.9	1.18 1.14	22.0 23.0	118.2 105.6	6.50 6.92	2.9 2.7	500 700	19.4 19.9	14.2 15.4	0.73 0.77	1.18 1.22	23.5 24.0	16.4 16.3	2.4 2.6	
	5.0	1.6	3.7	500 700	27.2 28.1	1.20 1.16	23.1 24.2	120.3 107.2	6.62 7.10	3.0 2.8	500 700	19.6 20.1	14.4 15.6	0.73 0.78	1.12 1.15	23.4 24.0	17.5 17.4	2.3 2.5	
	7.0	3.0	6.9	500 700	27.6 28.7	1.22 1.18	23.5 24.6	121.1 107.9	6.65 7.15	3.1 2.8	500 700	19.9 20.2	14.4 15.6	0.72 0.77	1.08 1.12	23.6 24.1	18.4 18.1	2.1 2.4	
100	3.0	0.6	1.5	Operation not recommended								Operation not recommended							
	5.0	1.6	3.6	500 700	18.9 19.3	1.42 1.54	0.75 0.80	1.28 1.32	23.3 23.8	14.8 14.7	3.0 3.2								
	7.0	2.9	6.6	500 700	19.2 19.5	1.42 1.54	0.74 0.79	1.24 1.28	23.4 23.9	15.4 15.2	2.8 3.1								
110	3.0	0.6	1.4	Operation not recommended								Operation not recommended							
	5.0	1.5	3.4	500 700	16.6 17.0	1.31 1.42	0.79 0.84	1.45 1.50	21.6 22.1	11.4 11.3	3.8 4.1								
	7.0	2.8	6.4	500 700	16.8 17.1	1.31 1.42	0.78 0.83	1.41 1.45	21.6 22.1	11.9 11.8	3.5 3.9								
120	3.0	0.6	1.3	Operation not recommended								Operation not recommended							
	5.0	1.4	3.3	500 700	15.9 16.2	1.30 1.41	0.82 0.87	1.65 1.70	21.5 22.0	9.6 9.5	4.7 5.1								
	7.0	2.7	6.1	500 700	16.0 16.4	1.30 1.41	0.81 0.86	1.60 1.65	21.5 22.0	10.0 9.9	4.3 4.8								

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T2GX026 - Performance Data

Dual Stage ECM2.3 High Speed (900 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F								COOLING - EAT 80/67 °F							
		PSI	FT/HD	Airflow CFM	HC kBTuh	Power kW	HE kBTuh	LAT °F	COP	HWC kBTuh	Airflow CFM	TC kBTuh	SC kBTuh	S/T Ratio	Power kW	HR kBTuh	EER	HWC kBTuh	
																			Operation not recommended
20	4.0	1.4	3.2	Operation not recommended								Operation not recommended							
	6.0	2.9	6.6	Operation not recommended								Operation not recommended							
	8.0	4.8	11.1	700 900	16.4 16.6	1.43 1.44	11.5 11.7	91.7 87.1	3.36 3.38	2.1 1.9	Operation not recommended								
30	4.0	1.4	3.2	Operation not recommended								Operation not recommended							
	6.0	2.8	6.4	700 900	18.8 19.2	1.47 1.48	13.8 14.1	94.9 89.7	3.75 3.80	2.3 2.1	700 900	29.2 29.7	19.3 21.1	0.66 0.71	0.96 1.02	32.5 33.2	30.3 29.2	---	
	8.0	4.7	10.8	700 900	19.2 19.4	1.48 1.49	14.1 14.3	95.4 90.0	3.80 3.81	2.3 2.1	700 900	29.4 30.1	19.3 21.1	0.66 0.70	0.94 0.98	32.6 33.5	31.4 30.7	---	
40	4.0	1.3	3.1	Operation not recommended								Operation not recommended							
	6.0	2.7	6.2	700 900	21.9 22.3	1.53 1.53	16.6 17.1	98.9 92.9	4.19 4.26	2.5 2.3	700 900	29.7 30.2	19.8 21.6	0.67 0.72	1.05 1.10	33.2 34.0	28.3 27.5	---	
	8.0	4.5	10.4	700 900	22.2 22.7	1.55 1.55	17.0 17.4	99.4 93.3	4.22 4.30	2.6 2.4	700 900	29.9 30.5	19.8 21.6	0.66 0.71	1.02 1.06	33.4 34.2	29.4 28.7	---	
50	4.0	1.3	3.0	700 900	23.6 24.1	1.57 1.57	18.3 18.7	101.2 94.8	4.42 4.51	2.7 2.5	700 900	29.4 30.1	20.0 21.9	0.68 0.73	1.22 1.27	33.6 34.4	24.1 23.7	1.3 1.4	
	6.0	2.6	6.0	700 900	24.8 25.3	1.60 1.60	19.3 19.8	102.8 96.0	4.54 4.63	2.8 2.6	700 900	29.7 30.4	20.3 22.1	0.68 0.73	1.16 1.21	33.7 34.5	25.6 25.1	1.3 1.4	
	8.0	4.4	10.1	700 900	25.1 25.7	1.62 1.61	19.6 20.2	103.3 96.5	4.54 4.68	2.9 2.7	700 900	30.1 30.7	20.3 22.1	0.67 0.72	1.12 1.17	33.9 34.7	26.7 26.1	1.2 1.3	
60	4.0	1.2	2.9	700 900	26.6 27.1	1.65 1.63	20.9 21.6	105.1 97.9	4.72 4.88	3.1 2.9	700 900	29.1 29.7	19.9 21.7	0.68 0.73	1.33 1.38	33.6 34.4	21.9 21.5	1.6 1.7	
	6.0	2.5	5.8	700 900	27.8 28.5	1.68 1.67	22.1 22.8	106.8 99.3	4.84 5.00	3.2 2.9	700 900	29.4 30.0	20.1 21.9	0.68 0.73	1.26 1.31	33.7 34.5	23.4 22.9	1.5 1.6	
	8.0	4.2	9.8	700 900	28.3 29.0	1.70 1.68	22.4 23.2	107.4 99.8	4.86 5.05	3.3 3.0	700 900	29.7 30.3	20.1 21.9	0.68 0.72	1.22 1.27	33.9 34.6	24.3 23.9	1.4 1.6	
70	4.0	1.2	2.8	700 900	29.6 30.3	1.74 1.70	23.7 24.5	109.2 101.2	5.00 5.22	3.5 3.2	700 900	28.7 29.3	19.9 21.6	0.69 0.74	1.48 1.53	33.8 34.5	19.5 19.1	2.0 2.1	
	6.0	2.4	5.6	700 900	30.9 31.9	1.77 1.75	24.9 25.9	110.9 102.8	5.12 5.34	3.6 3.3	700 900	29.0 29.6	20.0 21.8	0.69 0.74	1.39 1.45	33.7 34.6	20.8 20.4	1.9 2.0	
	8.0	4.1	9.5	700 900	31.5 32.3	1.79 1.76	25.4 26.3	111.7 103.3	5.15 5.39	3.7 3.4	700 900	29.3 29.9	20.0 21.8	0.68 0.73	1.36 1.41	34.0 34.7	21.6 21.2	1.7 1.9	
80	4.0	1.2	2.7	700 900	32.3 33.3	1.84 1.80	26.0 27.1	112.7 104.2	5.14 5.43	3.9 3.6	700 900	27.6 28.2	19.5 21.1	0.71 0.75	1.63 1.69	33.2 34.0	16.9 16.7	2.5 2.7	
	6.0	2.4	5.4	700 900	33.7 34.8	1.88 1.84	27.3 28.6	114.6 105.8	5.25 5.56	4.0 3.7	700 900	27.8 28.5	19.7 21.4	0.71 0.75	1.55 1.60	33.1 33.9	18.0 17.8	2.3 2.5	
	8.0	4.0	9.2	700 900	34.3 35.4	1.90 1.85	27.8 29.1	115.4 106.4	5.28 5.60	4.1 3.8	700 900	28.2 28.7	19.7 21.4	0.70 0.75	1.50 1.55	33.3 34.0	18.8 18.5	2.2 2.4	
90	4.0	1.1	2.6	700 900	35.1 36.3	1.95 1.89	28.5 29.8	116.5 107.3	5.27 5.62	4.3 4.0	700 900	26.1 26.7	18.8 20.4	0.72 0.76	1.81 1.86	32.3 33.1	14.5 14.4	3.1 3.3	
	6.0	2.3	5.2	700 900	36.6 37.9	2.00 1.93	29.8 31.4	118.5 109.0	5.37 5.76	4.5 4.1	700 900	26.4 27.0	19.1 20.7	0.72 0.77	1.71 1.76	32.2 33.0	15.4 15.3	2.9 3.2	
	8.0	3.8	8.8	700 900	37.2 38.6	2.02 1.95	30.3 32.0	119.3 109.8	5.39 5.80	4.6 4.3	700 900	26.7 27.2	19.1 20.7	0.71 0.76	1.65 1.71	32.4 33.1	16.2 15.9	2.7 3.0	
100	4.0	1.1	2.5	Operation not recommended								Operation not recommended							
	6.0	2.2	5.1	Operation not recommended								Operation not recommended							
	8.0	3.7	8.5	700 900	25.1 25.6	18.5 20.1	0.74 0.78	1.92 1.97	31.6 32.3	13.1 13.0	3.6 3.9	700 900	25.4 25.8	18.5 20.1	0.73 0.78	1.86 1.92	31.7 32.4	13.7 13.5	3.3 3.7
110	4.0	1.0	2.4	Operation not recommended								Operation not recommended							
	6.0	2.1	4.9	Operation not recommended								Operation not recommended							
	8.0	3.5	8.2	700 900	23.0 23.2	17.4 19.0	0.76 0.80	2.12 2.12	30.2 30.9	10.8 10.7	4.4 4.7	700 900	23.2 23.7	17.4 19.0	0.75 0.80	2.06 2.12	30.2 30.9	11.3 11.2	4.1 4.5
120	4.0	1.0	2.3	Operation not recommended								Operation not recommended							
	6.0	2.0	4.7	Operation not recommended								Operation not recommended							
	8.0	3.4	7.9	700 900	21.3 21.6	16.7 18.2	0.79 0.84	2.38 2.44	29.4 30.0	8.9 8.9	5.3 5.7	700 900	21.4 21.9	16.7 18.2	0.78 0.83	2.30 2.37	29.3 30.0	9.3 9.2	4.9 5.4

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T2GX038 - Performance Data

Dual Stage ECM2.3 Low Speed (1050 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F							COOLING - EAT 80/67 °F								
		PSI	FT/HD	Airflow CFM	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	Airflow CFM	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh	
																			Operation not recommended
20	4.0	0.9	2.1	Operation not recommended							Operation not recommended								
	6.0	1.7	4.0	Operation not recommended							Operation not recommended								
	8.0	2.9	6.7	900 1050	15.7 16.4	1.37 1.40	11.1 11.6	86.2 84.5	3.37 3.42	2.5 2.3	Operation not recommended								
30	4.0	0.9	2.0	Operation not recommended							Operation not recommended								
	6.0	1.7	3.9	900 1050	17.5 18.2	1.35 1.39	12.9 13.5	88.0 86.1	3.78 3.84	2.4 2.2	900 1050	29.1 29.9	18.4 20.4	0.63 0.68	0.74 0.75	31.6 32.5	39.3 39.6	---	---
	8.0	2.8	6.5	900 1050	18.6 19.4	1.39 1.42	13.9 14.5	89.1 87.1	3.93 3.99	2.5 2.3	900 1050	29.6 30.4	18.9 20.9	0.64 0.69	0.73 0.75	32.1 33.0	40.3 40.6	---	---
40	4.0	0.8	1.9	Operation not recommended							Operation not recommended								
	6.0	1.6	3.8	900 1050	20.6 21.4	1.38 1.41	15.9 16.6	91.2 88.8	4.39 4.45	2.5 2.3	900 1050	30.3 31.1	19.7 21.8	0.65 0.70	0.80 0.82	33.0 33.9	37.8 38.1	---	---
	8.0	2.7	6.3	900 1050	21.8 22.5	1.41 1.44	16.9 17.6	92.4 89.8	4.51 4.58	2.6 2.4	900 1050	30.8 31.7	20.2 22.4	0.66 0.71	0.79 0.81	33.5 34.4	38.8 39.1	---	---
50	4.0	0.8	1.9	900 1050	22.7 23.4	1.40 1.42	17.9 18.6	93.4 90.7	4.75 4.83	2.6 2.4	900 1050	31.3 32.2	21.1 23.4	0.67 0.73	0.91 0.93	34.4 35.3	34.3 34.6	1.0	1.1
	6.0	1.6	3.7	900 1050	23.5 24.2	1.40 1.42	18.7 19.4	94.2 91.4	4.91 5.00	2.7 2.5	900 1050	31.6 32.5	21.2 23.5	0.67 0.72	0.89 0.91	34.6 35.6	35.5 35.8	0.9	1.0
	8.0	2.6	6.1	900 1050	24.6 25.4	1.44 1.46	19.7 20.4	95.4 92.4	5.02 5.11	2.8 2.5	900 1050	32.1 33.0	21.8 24.1	0.68 0.73	0.88 0.90	35.1 36.1	36.4 36.7	0.9	1.0
60	4.0	0.8	1.8	900 1050	25.6 26.3	1.43 1.44	20.8 21.4	96.4 93.2	5.25 5.34	2.9 2.6	900 1050	30.1 30.9	20.3 22.5	0.68 0.73	1.02 1.04	33.5 34.4	29.5 29.7	1.3	1.4
	6.0	1.5	3.6	900 1050	26.7 27.3	1.43 1.44	21.8 22.4	97.4 94.1	5.47 5.57	3.0 2.7	900 1050	30.3 31.2	20.5 22.6	0.67 0.73	0.99 1.01	33.7 34.6	30.5 30.8	1.3	1.4
	8.0	2.5	5.9	900 1050	27.6 28.2	1.46 1.47	22.6 23.2	98.4 94.9	5.54 5.64	3.0 2.8	900 1050	30.8 31.7	21.0 23.2	0.68 0.73	0.98 1.00	34.2 35.1	31.3 31.6	1.2	1.3
70	4.0	0.8	1.8	900 1050	28.5 29.0	1.46 1.46	23.5 24.1	99.3 95.6	5.74 5.84	3.2 2.9	900 1050	29.7 30.5	20.6 22.8	0.69 0.75	1.16 1.18	33.6 34.5	25.7 25.9	1.9	2.0
	6.0	1.5	3.5	900 1050	29.7 30.3	1.45 1.45	24.8 25.3	100.6 96.7	6.01 6.13	3.3 3.0	900 1050	29.9 30.8	20.7 23.0	0.69 0.75	1.13 1.15	33.8 34.7	26.6 26.8	1.7	1.9
	8.0	2.5	5.7	900 1050	30.5 31.0	1.48 1.48	25.4 26.0	101.4 97.4	6.04 6.15	3.4 3.1	900 1050	30.4 31.3	21.3 23.5	0.70 0.75	1.12 1.14	34.2 35.2	27.3 27.5	1.6	1.8
80	4.0	0.7	1.7	900 1050	31.2 31.6	1.48 1.47	26.1 26.6	102.1 97.9	6.16 6.28	3.6 3.3	900 1050	28.6 29.4	20.2 22.4	0.71 0.76	1.32 1.34	33.1 33.9	21.7 21.9	2.5	2.7
	6.0	1.4	3.3	900 1050	32.7 33.0	1.47 1.46	27.6 28.1	103.6 99.1	6.50 6.63	3.7 3.4	900 1050	28.8 29.6	20.3 22.5	0.71 0.76	1.28 1.31	33.2 34.1	22.5 22.7	2.4	2.6
	8.0	2.4	5.5	900 1050	33.1 33.5	1.50 1.49	28.0 28.4	104.1 99.5	6.46 6.58	3.8 3.5	900 1050	29.3 30.1	20.8 23.1	0.71 0.77	1.27 1.30	33.6 34.5	23.0 23.2	2.2	2.5
90	4.0	0.7	1.6	900 1050	33.8 34.1	1.51 1.49	28.7 29.0	104.8 100.1	6.57 6.71	4.0 3.7	900 1050	26.5 27.2	18.9 20.9	0.71 0.77	1.50 1.53	31.6 32.4	17.6 17.8	3.4	3.6
	6.0	1.4	3.2	900 1050	35.5 35.8	1.49 1.47	30.4 30.7	106.6 101.5	6.97 7.12	4.2 3.8	900 1050	26.7 27.4	19.0 21.0	0.71 0.77	1.46 1.49	31.7 32.5	18.3 18.4	3.2	3.4
	8.0	2.3	5.3	900 1050	35.7 35.9	1.52 1.50	30.5 30.7	106.7 101.6	6.87 7.01	4.3 4.0	900 1050	27.1 27.9	19.5 21.6	0.72 0.77	1.45 1.48	32.1 32.9	18.7 18.9	2.9	3.3
100	4.0	0.7	1.6	Operation not recommended							Operation not recommended								
	6.0	1.3	3.1	Operation not recommended							Operation not recommended								
	8.0	2.2	5.1	900 1050	25.8 26.5	1.93 2.14	0.75 0.81	1.67 1.70	31.5 32.3	15.4 15.6	4.1 4.5	900 1050	26.2 26.9	19.8 21.9	0.76 0.81	1.65 1.69	31.8 32.7	15.8 16.0	3.8
110	4.0	0.7	1.5	Operation not recommended							Operation not recommended								
	6.0	1.3	3.0	Operation not recommended							Operation not recommended								
	8.0	2.1	4.9	900 1050	23.1 23.7	18.1 20.1	0.79 0.85	1.90 1.93	29.6 30.3	12.2 12.3	5.2 5.7	900 1050	23.5 24.1	18.6 20.6	0.79 0.85	1.88 1.92	29.9 30.7	12.5 12.6	4.8
120	4.0	0.6	1.5	Operation not recommended							Operation not recommended								
	6.0	1.2	2.9	Operation not recommended							Operation not recommended								
	8.0	2.0	4.7	900 1050	21.9 22.5	18.0 19.9	0.82 0.88	2.15 2.20	29.2 30.0	10.2 10.2	6.5 7.0	900 1050	22.2 22.9	18.4 20.4	0.83 0.89	2.13 2.18	29.5 30.3	10.4 10.5	6.0

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T2GX038 - Performance Data

Dual Stage ECM2.3 High Speed (1250 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F							COOLING - EAT 80/67 °F															
		PSI	FT/HD	Airflow CFM	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	Airflow CFM	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh								
																			Operation not recommended							
20	5.0	1.3	3.0	Operation not recommended							Operation not recommended															
	7.0	2.3	5.2	Operation not recommended							Operation not recommended															
	9.0	3.5	8.1	1050	22.5	1.94	15.9	89.8	3.41	2.9	1250	23.2	1.99	16.4	87.2	3.41	2.6									
30	5.0	1.2	2.9	Operation not recommended							Operation not recommended															
	7.0	2.2	5.1	1050	25.9	1.97	19.2	92.8	3.85	3.1	1250	26.6	2.03	19.7	89.7	3.84	2.8	1050	37.9	22.5	0.59	1.41	42.8	27.0	---	
	9.0	3.4	7.9	1050	26.3	1.99	19.5	93.2	3.87	3.2	1250	27.2	2.05	20.2	90.1	3.88	2.9	1050	38.2	24.8	0.65	1.37	42.9	28.0	---	
40	5.0	1.2	2.8	Operation not recommended							Operation not recommended															
	7.0	2.1	4.9	1050	30.2	2.09	23.1	96.7	4.24	3.4	1250	31.2	2.13	23.9	93.1	4.28	3.1	1050	39.4	24.1	0.61	1.55	44.7	25.4	---	
	9.0	3.3	7.6	1050	30.8	2.11	23.6	97.2	4.29	3.5	1250	31.8	2.15	24.5	93.6	4.33	3.2	1050	39.7	26.1	0.66	1.51	44.9	26.3	---	
50	5.0	1.2	2.7	1050	32.8	2.14	25.5	98.9	4.48	3.7	1250	33.7	2.17	26.3	95.0	4.56	3.4	1050	39.6	25.1	0.63	1.84	45.9	21.5	1.9	
	7.0	2.1	4.8	1050	34.0	2.19	26.5	99.9	4.54	3.8	1250	35.0	2.22	27.5	96.0	4.63	3.5	1050	40.5	25.4	0.63	1.74	46.4	23.3	1.8	
	9.0	3.2	7.4	1050	34.7	2.21	27.2	100.6	4.60	3.9	1250	35.8	2.24	28.2	96.5	4.69	3.6	1050	40.9	27.1	0.66	1.69	46.7	24.1	1.7	
60	5.0	1.1	2.6	1050	36.1	2.25	28.5	101.9	4.71	4.2	1250	37.3	2.26	29.6	97.6	4.83	3.8	1050	39.2	25.7	0.66	1.96	45.9	20.0	2.3	
	7.0	2.0	4.6	1050	37.8	2.31	29.9	103.3	4.79	4.3	1250	38.7	2.33	31.0	98.9	4.91	4.0	1050	40.2	26.0	0.65	1.87	46.5	21.5	2.2	
	9.0	3.1	7.2	1050	38.7	2.33	30.7	104.1	4.85	4.4	1250	39.9	2.34	31.9	99.6	4.99	4.1	1050	40.5	27.4	0.68	1.82	46.8	22.3	2.0	
70	5.0	1.1	2.5	1050	39.6	2.37	31.5	104.9	4.90	4.7	1250	40.9	2.37	32.8	100.3	5.07	4.3	1050	39.2	26.6	0.68	2.15	46.5	18.2	2.9	
	7.0	1.9	4.5	1050	41.6	2.45	33.3	106.7	4.99	4.8	1250	43.0	2.45	34.6	101.8	5.15	4.4	1050	40.2	26.9	0.67	2.06	47.2	19.5	2.7	
	9.0	3.0	6.9	1050	42.7	2.47	34.2	107.6	5.05	5.0	1250	44.1	2.47	35.7	102.7	5.25	4.6	1050	40.6	28.0	0.69	2.01	47.5	20.2	2.5	
80	5.0	1.1	2.5	1050	42.1	2.46	33.7	107.1	5.01	5.2	1250	43.6	2.44	35.2	102.3	5.22	4.8	1050	39.2	26.6	0.68	2.26	46.6	17.2	3.3	
	7.0	1.9	4.3	1050	44.5	2.56	35.8	109.3	5.09	5.4	1250	46.0	2.54	37.4	104.1	5.32	5.0	1050	38.8	26.6	0.68	2.26	46.6	17.2	3.3	
	9.0	2.9	6.7	1050	45.8	2.60	37.0	110.4	5.17	5.6	1250	47.4	2.56	38.7	105.1	5.43	5.1	1050	39.3	27.2	0.69	2.21	46.8	17.7	3.1	
90	5.0	1.0	2.4	1050	44.7	2.58	35.9	109.4	5.08	5.9	1250	46.3	2.54	37.6	104.3	5.34	5.4	1050	35.7	25.5	0.71	2.53	44.3	14.1	4.4	
	7.0	1.8	4.2	1050	47.5	2.69	38.3	111.9	5.17	6.0	1250	49.2	2.64	40.2	106.4	5.45	5.6	1050	36.8	25.9	0.70	2.46	45.1	15.0	4.1	
	9.0	2.8	6.5	1050	49.0	2.73	39.7	113.2	5.26	6.2	1250	50.7	2.66	41.6	107.5	5.58	5.8	1050	37.2	26.1	0.70	2.42	45.4	15.4	3.9	
100	5.0	1.0	2.3	Operation not recommended							Operation not recommended															
	7.0	1.7	4.0	Operation not recommended							Operation not recommended															
	9.0	2.7	6.2	1050	35.4	25.6	0.72	2.74	44.8	12.9	5.1	1250	36.6	28.4	0.78	2.78	46.1	13.1	5.5	1050	35.8	25.6	0.71	2.69	45.0	13.3
110	5.0	1.0	2.2	Operation not recommended							Operation not recommended															
	7.0	1.7	3.9	Operation not recommended							Operation not recommended															
	9.0	2.6	6.0	1050	32.4	24.1	0.74	2.99	42.6	10.8	6.2	1250	33.3	26.7	0.80	3.01	43.6	11.0	6.8	1050	32.7	23.7	0.73	2.94	42.8	11.1
120	5.0	0.9	2.1	Operation not recommended							Operation not recommended															
	7.0	1.6	3.7	Operation not recommended							Operation not recommended															
	9.0	2.5	5.8	1050	30.5	23.6	0.77	3.34	41.9	9.1	7.5	1250	31.2	26.2	0.84	3.34	42.6	9.3	8.1	1050	30.8	23.0	0.75	3.29	42.0	9.4

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T2GX049 - Performance Data

Dual Stage ECM2.3 Low Speed (1350 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT/HD	Airflow CFM	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	Airflow CFM	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh
20	5.0	0.9	2.2	Operation not recommended							Operation not recommended							
	8.0	2.0	4.6	Operation not recommended							Operation not recommended							
	11.0	3.4	7.8	1150 1350	22.5 23.3	2.05 2.08	15.5 16.2	88.1 86.0	3.22 3.29	4.2 3.8	Operation not recommended							
30	5.0	0.9	2.1	Operation not recommended							Operation not recommended							
	8.0	1.9	4.4	1150 1350	25.9 26.7	2.09 2.10	18.8 19.6	90.9 88.3	3.64 3.72	4.3 3.9	1150 1350	36.1 37.3	21.1 24.9	0.59 0.67	1.19 1.27	40.1 41.7	30.2 29.5	---
	11.0	3.3	7.6	1150 1350	26.6 27.5	2.10 2.13	19.4 20.3	91.4 88.9	3.70 3.78	4.4 4.0	1150 1350	36.1 37.1	21.1 24.9	0.58 0.67	1.11 1.18	39.9 41.1	32.5 31.4	---
40	5.0	0.9	2.0	Operation not recommended							Operation not recommended							
	8.0	1.9	4.3	1150 1350	29.8 30.8	2.16 2.16	22.4 23.4	94.0 91.1	4.03 4.17	4.5 4.2	1150 1350	38.1 39.4	23.1 27.2	0.61 0.69	1.31 1.39	42.6 44.1	29.0 28.4	---
	11.0	3.2	7.4	1150 1350	30.8 31.8	2.18 2.19	23.3 24.3	94.8 91.8	4.14 4.25	4.7 4.2	1150 1350	38.3 39.4	23.1 27.2	0.60 0.69	1.23 1.30	42.5 43.8	31.0 30.3	---
50	5.0	0.9	2.0	1150 1350	30.8 31.8	2.16 2.16	23.5 24.5	94.8 91.8	4.19 4.32	4.8 4.4	1150 1350	38.9 40.1	24.7 29.1	0.64 0.73	1.70 1.77	44.6 46.1	22.9 22.7	1.6 1.7
	8.0	1.8	4.2	1150 1350	33.2 34.5	2.23 2.21	25.6 27.0	96.8 93.7	4.37 4.57	4.9 4.5	1150 1350	39.7 40.9	24.8 29.2	0.62 0.71	1.47 1.54	44.7 46.2	27.0 26.6	1.5 1.6
	11.0	3.1	7.2	1150 1350	34.5 35.7	2.24 2.24	26.9 28.0	97.8 94.5	4.51 4.66	5.1 4.6	1150 1350	39.9 41.2	24.8 29.2	0.62 0.71	1.38 1.45	44.7 46.1	28.9 28.3	1.4 1.5
60	5.0	0.8	1.9	1150 1350	33.7 34.9	2.24 2.23	26.1 27.3	97.1 94.0	4.41 4.60	5.2 4.8	1150 1350	38.7 39.9	24.6 29.0	0.64 0.73	1.83 1.91	44.9 46.4	21.2 20.9	2.3 2.4
	8.0	1.8	4.0	1150 1350	36.5 37.9	2.30 2.27	28.6 30.1	99.4 96.0	4.65 4.89	5.4 5.0	1150 1350	39.3 40.5	24.8 29.2	0.63 0.72	1.62 1.70	44.8 46.3	24.2 23.9	2.1 2.3
	11.0	3.0	6.9	1150 1350	38.0 39.4	2.32 2.29	30.1 31.6	100.6 97.0	4.81 5.04	5.5 5.1	1150 1350	39.8 41.0	24.9 29.3	0.63 0.72	1.54 1.61	45.0 46.4	25.8 25.5	1.9 2.2
70	5.0	0.8	1.8	1150 1350	36.4 37.9	2.32 2.29	28.5 30.0	99.3 96.0	4.61 4.84	5.8 5.4	1150 1350	38.9 40.1	25.9 30.5	0.67 0.76	2.01 2.11	45.7 47.3	19.3 19.0	3.2 3.4
	8.0	1.7	3.9	1150 1350	39.6 41.1	2.36 2.32	31.5 33.2	101.8 98.2	4.91 5.19	6.0 5.5	1150 1350	39.3 40.5	26.2 30.7	0.67 0.76	1.82 1.90	45.5 47.0	21.5 21.3	3.0 3.2
	11.0	2.9	6.7	1150 1350	41.4 42.9	2.39 2.33	33.2 35.0	103.3 99.4	5.08 5.39	6.1 5.7	1150 1350	40.0 41.2	26.3 30.9	0.66 0.75	1.74 1.81	45.9 47.4	22.9 22.8	2.8 3.1
80	5.0	0.8	1.8	1150 1350	38.7 40.2	2.38 2.34	30.6 32.2	101.2 97.6	4.77 5.05	6.5 6.0	1150 1350	37.6 38.8	24.8 29.2	0.66 0.75	2.20 2.29	45.1 46.7	17.1 17.0	4.4 4.6
	8.0	1.6	3.8	1150 1350	42.0 43.7	2.40 2.34	33.8 35.7	103.8 100.0	5.13 5.47	6.7 6.1	1150 1350	37.9 39.0	25.1 29.5	0.66 0.76	2.04 2.12	44.8 46.2	18.6 18.4	4.1 4.4
	11.0	2.8	6.5	1150 1350	44.2 45.9	2.43 2.36	35.9 37.9	105.6 101.5	5.33 5.70	6.9 6.3	1150 1350	38.7 39.9	25.3 29.7	0.65 0.74	1.95 2.03	45.4 46.8	19.8 19.6	3.8 4.2
90	5.0	0.7	1.7	1150 1350	40.8 42.4	2.43 2.38	32.5 34.3	102.9 99.1	4.93 5.23	7.2 6.7	1150 1350	35.5 36.6	22.8 26.8	0.64 0.73	2.40 2.50	43.7 45.2	14.8 14.7	5.9 6.2
	8.0	1.6	3.6	1150 1350	44.4 46.2	2.44 2.36	36.1 38.2	105.7 101.7	5.33 5.73	7.4 6.9	1150 1350	35.5 36.5	23.1 27.2	0.65 0.75	2.28 2.36	43.3 44.5	15.6 15.5	5.5 5.9
	11.0	2.7	6.2	1150 1350	46.8 48.8	2.47 2.39	38.4 40.6	107.7 103.5	5.56 5.99	7.7 7.1	1150 1350	36.5 37.6	23.4 27.5	0.64 0.73	2.18 2.28	43.9 45.4	16.7 16.5	5.1 5.6
100	5.0	0.7	1.7	Operation not recommended							Operation not recommended							
	8.0	1.5	3.5	1150 1350	33.9 34.9	23.8 28.0	0.70 0.80	2.56 2.66	42.6 44.0	13.2 13.1	7.1 7.7							
	11.0	2.6	6.0	1150 1350	35.1 36.1	24.2 28.4	0.69 0.79	2.47 2.57	43.5 44.9	14.2 14.1	6.6 7.3							
110	5.0	0.7	1.6	Operation not recommended							Operation not recommended							
	8.0	1.5	3.4	1150 1350	30.4 31.4	22.4 26.4	0.74 0.84	2.85 2.97	40.1 41.5	10.7 10.6	9.0 9.8							
	11.0	2.5	5.8	1150 1350	31.8 32.7	22.8 26.8	0.72 0.82	2.76 2.88	41.2 42.5	11.5 11.4	8.4 9.3							
120	5.0	0.7	1.5	Operation not recommended							Operation not recommended							
	8.0	1.4	3.3	1150 1350	28.0 29.0	21.8 25.6	0.78 0.89	3.18 3.32	38.9 40.3	8.8 8.7	11.2 12.1							
	11.0	2.4	5.6	1150 1350	29.6 30.4	22.2 26.1	0.75 0.86	3.09 3.24	40.2 41.4	9.6 9.4	10.4 11.5							

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T2GX049 - Performance Data

Dual Stage ECM2.3 High Speed (1550 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F							COOLING - EAT 80/67 °F							
		PSI	FT/HD	Airflow CFM	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	Airflow CFM	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh
20	6.0	1.3	3.0	Operation not recommended							Operation not recommended							
	9.0	2.5	5.7	Operation not recommended							Operation not recommended							
	12.0	4.0	9.2	1350 1550	31.3 32.4	2.72 2.80	22.1 22.8	91.5 89.3	3.38 3.38	5.3 4.8	Operation not recommended							
30	6.0	1.2	2.9	Operation not recommended							Operation not recommended							
	9.0	2.4	5.5	1350 1550	35.8 36.9	2.85 2.94	26.1 26.8	94.5 92.0	3.68 3.68	5.6 5.2	1350 1550	47.7 50.6	29.4 32.7	0.62 0.65	1.90 2.02	54.2 57.5	25.1 25.0	--- ---
	12.0	3.9	8.9	1350 1550	36.3 37.5	2.88 2.97	26.5 27.4	94.9 92.4	3.70 3.71	5.8 5.3	1350 1550	48.2 51.0	29.4 32.6	0.61 0.64	1.81 1.93	54.4 57.6	26.7 26.4	--- ---
40	6.0	1.2	2.8	Operation not recommended							Operation not recommended							
	9.0	2.3	5.3	1350 1550	40.8 42.0	2.97 3.04	30.6 31.6	98.0 95.1	4.02 4.04	6.2 5.7	1350 1550	49.5 52.3	31.1 34.6	0.63 0.66	2.10 2.22	56.7 59.9	23.6 23.5	--- ---
	12.0	3.7	8.7	1350 1550	41.5 42.9	3.01 3.07	31.2 32.4	98.5 95.6	4.04 4.09	6.4 5.8	1350 1550	50.0 52.8	31.1 34.6	0.62 0.66	2.01 2.13	56.9 60.0	24.9 24.8	--- ---
50	6.0	1.2	2.7	1350 1550	43.6 45.0	3.08 3.12	33.1 34.4	99.9 96.9	4.15 4.23	6.7 6.2	1350 1550	50.1 52.7	31.9 35.4	0.64 0.67	2.50 2.64	58.6 61.7	20.0 20.0	3.0 3.2
	9.0	2.2	5.2	1350 1550	45.3 46.6	3.14 3.19	34.6 35.8	101.1 97.9	4.23 4.29	6.9 6.4	1350 1550	50.7 53.4	32.4 36.0	0.64 0.67	2.35 2.47	58.7 61.8	21.6 21.7	2.8 3.0
	12.0	3.6	8.4	1350 1550	46.2 47.8	3.18 3.22	35.4 36.8	101.7 98.5	4.27 4.35	7.2 6.5	1350 1550	51.2 53.8	32.5 36.1	0.63 0.67	2.26 2.38	58.9 62.0	22.7 22.7	2.6 2.9
60	6.0	1.1	2.6	1350 1550	47.6 49.1	3.21 3.22	36.7 38.1	102.7 99.3	4.35 4.47	7.6 7.0	1350 1550	49.5 51.9	32.2 35.8	0.65 0.69	2.66 2.78	58.6 61.4	18.6 18.7	3.7 3.9
	9.0	2.2	5.0	1350 1550	49.8 51.3	3.29 3.30	38.6 40.0	104.1 100.6	4.44 4.55	7.8 7.2	1350 1550	50.3 52.8	32.7 36.3	0.65 0.69	2.51 2.62	58.9 61.7	20.0 20.1	3.4 3.7
	12.0	3.5	8.1	1350 1550	50.9 52.6	3.33 3.34	39.6 41.2	104.9 101.4	4.49 4.62	8.0 7.4	1350 1550	50.9 53.3	32.8 36.5	0.65 0.68	2.43 2.54	59.2 62.0	20.9 21.0	3.2 3.5
70	6.0	1.1	2.5	1350 1550	51.5 53.1	3.32 3.31	40.2 41.8	105.4 101.7	4.55 4.70	8.5 7.9	1350 1550	49.2 51.4	32.8 36.5	0.67 0.71	2.91 3.02	59.1 61.7	16.9 17.0	4.6 4.9
	9.0	2.1	4.9	1350 1550	54.1 55.8	3.42 3.41	42.4 44.1	107.1 103.3	4.63 4.79	8.8 8.1	1350 1550	50.3 52.5	33.3 36.9	0.66 0.70	2.77 2.87	59.8 62.3	18.2 18.3	4.3 4.6
	12.0	3.4	7.9	1350 1550	55.5 57.3	3.47 3.45	43.7 45.5	108.1 104.2	4.69 4.87	9.0 8.3	1350 1550	50.8 53.1	33.5 37.2	0.66 0.70	2.69 2.80	60.0 62.7	18.9 19.0	4.0 4.4
80	6.0	1.1	2.5	1350 1550	54.7 56.4	3.49 3.45	42.7 44.7	107.5 103.7	4.58 4.79	9.6 8.8	1350 1550	47.2 49.1	32.1 35.6	0.68 0.73	3.15 3.24	57.9 60.2	15.0 15.1	5.8 6.2
	9.0	2.0	4.7	1350 1550	57.7 59.6	3.62 3.58	45.4 47.4	109.6 105.6	4.67 4.88	9.8 9.1	1350 1550	48.4 50.4	32.5 36.0	0.67 0.71	3.03 3.12	58.7 61.0	16.0 16.2	5.4 5.9
	12.0	3.3	7.6	1350 1550	59.4 61.3	3.66 3.62	46.9 49.0	110.7 106.6	4.75 4.97	10.1 9.4	1350 1550	48.9 50.9	32.7 36.3	0.67 0.71	2.96 3.05	59.0 61.3	16.5 16.7	5.0 5.6
90	6.0	1.0	2.4	1350 1550	57.7 59.7	3.66 3.58	45.2 47.4	109.6 105.6	4.62 4.88	10.7 9.9	1350 1550	44.3 46.0	30.8 34.2	0.70 0.74	3.39 3.46	55.9 57.8	13.1 13.3	7.3 7.7
	9.0	2.0	4.5	1350 1550	61.3 63.3	3.81 3.73	48.3 50.6	112.0 107.8	4.71 4.98	11.1 10.2	1350 1550	45.7 47.4	31.1 34.5	0.68 0.73	3.29 3.36	56.9 58.8	13.9 14.1	6.8 7.4
	12.0	3.2	7.3	1350 1550	63.1 65.3	3.85 3.78	50.0 52.4	113.3 109.0	4.81 5.07	11.4 10.6	1350 1550	46.2 47.8	31.4 34.9	0.68 0.73	3.22 3.29	57.2 59.0	14.3 14.5	6.3 7.0
100	6.0	1.0	2.3	Operation not recommended							Operation not recommended							
	9.0	1.9	4.4	1350 1550	43.6 45.0	30.5 33.7	0.70 0.75	3.66 3.71	56.0 57.7	11.9 12.2	8.4 9.2							
	12.0	3.1	7.1	1350 1550	44.0 45.4	30.8 34.2	0.70 0.75	3.60 3.65	56.3 57.9	12.2 12.5	7.8 8.7							
110	6.0	1.0	2.2	Operation not recommended							Operation not recommended							
	9.0	1.8	4.2	Operation not recommended							Operation not recommended							
	12.0	2.9	6.8	Operation not recommended							Operation not recommended							
120	6.0	0.9	2.1	Operation not recommended							Operation not recommended							
	9.0	1.7	4.0	Operation not recommended							Operation not recommended							
	12.0	2.8	6.5	1350 1550	36.5 37.4	27.2 30.1	0.74 0.80	4.42 4.42	51.6 52.5	8.3 8.5	12.5 13.5							

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T2GX064 - Performance Data

Dual Stage ECM2.3 Low Speed (1500 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F							COOLING - EAT 80/67 °F														
				Airflow CFM	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	Airflow CFM	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh							
		PSI	FT/HD	Operation not recommended							Operation not recommended														
20	6.0	1.0	2.4	Operation not recommended							Operation not recommended														
	10.0	2.7	6.2	Operation not recommended							Operation not recommended														
	14.0	5.1	11.8	1250	26.2	2.55	17.5	89.4	3.01	4.9	1500	27.1	2.59	18.3	86.7	3.07	4.5	Operation not recommended							
30	6.0	1.0	2.3	Operation not recommended							Operation not recommended														
	10.0	2.6	6.0	1250	30.4	2.63	21.4	92.5	3.39	5.0	1500	31.5	2.67	22.4	89.4	3.46	4.6	1250	51.7	30.4	0.59	1.43	56.5	36.0	1.3
	14.0	5.0	11.5	1250	31.5	2.63	22.5	93.3	3.51	5.1	1500	32.6	2.67	23.5	90.1	3.58	4.7	1250	51.8	30.3	0.59	1.40	56.6	37.0	1.2
1500	53.1	34.5	0.65	1.48	58.1	36.0	1.3																		
40	6.0	1.0	2.3	Operation not recommended							Operation not recommended														
	10.0	2.5	5.9	1250	35.9	2.72	26.6	96.6	3.86	5.3	1500	36.9	2.73	27.6	92.8	3.96	4.9	1250	53.2	31.1	0.59	1.57	58.5	33.8	1.4
	14.0	4.8	11.1	1250	37.1	2.73	27.7	97.5	3.98	5.5	1500	38.1	2.74	28.7	93.5	4.07	5.0	1250	53.3	31.1	0.58	1.54	58.6	34.7	1.3
1500	54.8	35.4	0.65	1.65	60.4	33.2	1.6																		
50	6.0	0.9	2.2	1250	40.4	2.76	31.0	99.9	4.28	5.6	1500	41.5	2.76	32.1	95.6	4.40	5.2	1250	54.5	31.5	0.58	1.82	60.7	29.9	2.0
	10.0	2.5	5.7	1250	41.0	2.82	31.4	100.4	4.27	5.7	1500	42.0	2.80	32.4	95.9	4.39	5.3	1250	54.6	31.8	0.58	1.76	60.6	31.1	1.9
	14.0	4.7	10.8	1250	42.3	2.83	32.6	101.3	4.37	5.9	1500	43.2	2.82	33.6	96.7	4.50	5.4	1250	54.7	31.8	0.58	1.72	60.6	31.8	1.7
1500	56.3	36.1	0.64	1.81	62.5	31.2	1.9																		
60	6.0	0.9	2.1	1250	45.0	2.86	35.2	103.3	4.61	6.1	1500	45.9	2.83	36.3	98.3	4.75	5.7	1250	52.5	30.9	0.59	2.04	59.4	25.8	2.8
	10.0	2.4	5.5	1250	46.4	2.91	36.4	104.3	4.67	6.3	1500	47.1	2.87	37.3	99.1	4.82	5.8	1250	52.7	31.1	0.59	1.97	59.5	26.8	2.6
	14.0	4.5	10.4	1250	47.5	2.93	37.5	105.2	4.74	6.5	1500	48.2	2.89	38.3	99.8	4.89	6.0	1250	53.0	31.2	0.59	1.93	59.5	27.4	2.5
1500	54.5	35.2	0.65	2.02	61.4	27.0	2.7																		
70	6.0	0.9	2.0	1250	49.4	2.95	39.3	106.6	4.91	6.8	1500	50.2	2.90	40.4	101.0	5.08	6.3	1250	51.6	31.2	0.61	2.30	59.4	22.4	4.0
	10.0	2.3	5.3	1250	51.5	3.00	41.3	108.1	5.04	7.0	1500	52.1	2.93	42.1	102.1	5.21	6.5	1250	51.9	31.5	0.61	2.23	59.5	23.2	3.7
	14.0	4.4	10.1	1250	52.5	3.03	42.1	108.9	5.08	7.2	1500	53.0	2.96	42.9	102.7	5.25	6.6	1250	52.2	31.6	0.61	2.19	59.7	23.9	3.5
1500	53.8	35.6	0.66	2.28	61.6	23.6	3.9																		
80	6.0	0.9	2.0	1250	53.6	3.04	43.2	109.7	5.17	7.6	1500	54.1	2.97	43.9	103.4	5.33	7.0	1250	49.3	30.1	0.61	2.60	58.2	19.0	5.5
	10.0	2.2	5.1	1250	56.6	3.09	46.1	111.9	5.37	7.8	1500	56.9	3.00	46.6	105.1	5.56	7.2	1250	49.8	30.4	0.61	2.53	58.4	19.6	5.2
	14.0	4.2	9.8	1250	57.3	3.13	46.6	112.4	5.37	8.0	1500	57.5	3.04	47.1	105.5	5.55	7.4	1250	50.1	30.6	0.61	2.49	58.6	20.1	4.8
1500	51.7	34.3	0.66	2.58	60.5	20.0	5.3																		
90	6.0	0.8	1.9	1250	57.6	3.13	46.9	112.7	5.40	8.5	1500	57.7	3.04	47.4	105.6	5.56	7.8	1250	45.7	28.6	0.63	2.94	55.7	15.6	7.4
	10.0	2.1	5.0	1250	61.5	3.18	50.7	115.5	5.67	8.7	1500	61.5	3.06	51.0	108.0	5.89	8.1	1250	47.1	31.8	0.67	3.02	57.4	15.6	7.8
	14.0	4.1	9.4	1250	61.9	3.23	50.9	115.8	5.62	9.0	1500	61.8	3.11	51.1	108.1	5.82	8.3	1250	46.2	28.9	0.62	2.87	56.0	16.1	6.9
1500	46.6	29.1	0.63	2.84	56.2	16.4	6.4																		
100	6.0	0.8	1.8	Operation not recommended							Operation not recommended														
	10.0	2.1	4.8	Operation not recommended							Operation not recommended														
	14.0	3.9	9.1	1250	44.3	29.0	0.65	3.28	55.5	13.5	9.0	1500	45.6	32.0	0.70	3.36	57.1	13.6	9.7						
1500	44.7	29.3	0.66	3.23	55.8	13.8	8.3																		
110	6.0	0.8	1.8	Operation not recommended							Operation not recommended														
	10.0	2.0	4.6	Operation not recommended							Operation not recommended														
	14.0	3.8	8.7	1250	39.9	27.3	0.69	3.71	52.6	10.7	11.3	1500	41.1	30.0	0.73	3.79	54.1	10.9	12.3						
1500	40.4	27.8	0.69	3.66	52.9	11.0	10.5																		
120	6.0	0.7	1.7	Operation not recommended							Operation not recommended														
	10.0	1.9	4.4	Operation not recommended							Operation not recommended														
	14.0	3.6	8.4	1250	37.3	27.5	0.74	4.21	51.6	8.9	14.0	1500	38.4	29.9	0.78	4.26	53.0	9.0	15.2						
1500	37.9	28.0	0.74	4.16	52.0	9.1	13.0																		
1500	39.0	30.5	0.78	4.21	53.4	9.3	14.5																		

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T2GX064 - Performance Data

Dual Stage ECM2.3 High Speed (1800 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F								COOLING - EAT 80/67 °F							
		PSI	FT/HD	Airflow CFM	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	Airflow CFM	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh	
20	8.0	1.8	4.2	Operation not recommended								Operation not recommended							
	12.0	3.8	8.8	Operation not recommended								Operation not recommended							
	16.0	6.5	15.1	1500 1800	39.3 40.3	3.48 3.64	27.5 27.9	94.3 90.7	3.31 3.24	6.2 5.6	Operation not recommended								
30	8.0	1.8	4.1	Operation not recommended								Operation not recommended							
	12.0	3.7	8.6	1500 1800	45.4 46.6	3.49 3.72	33.4 33.9	98.0 94.0	3.81 3.68	6.5 6.0	1500 1800	67.1 67.7	42.9 46.7	0.64 0.69	2.35 2.49	75.1 76.2	28.6 27.2	---	---
	16.0	6.4	14.7	1500 1800	46.0 47.1	3.58 3.75	33.8 34.3	98.4 94.2	3.76 3.68	6.7 6.1	1500 1800	67.8 68.2	43.3 47.1	0.64 0.69	2.31 2.45	75.6 76.6	29.4 27.9	---	---
40	8.0	1.7	4.0	Operation not recommended								Operation not recommended							
	12.0	3.6	8.3	1500 1800	52.2 53.4	3.72 3.88	39.5 40.1	102.2 97.5	4.11 4.03	7.2 6.6	1500 1800	69.7 70.7	44.1 48.0	0.63 0.68	2.70 2.86	78.9 80.5	25.8 24.7	---	---
	16.0	6.2	14.2	1500 1800	53.0 54.2	3.79 3.92	40.1 40.8	102.7 97.9	4.10 4.05	7.4 6.7	1500 1800	70.4 71.4	44.5 48.4	0.63 0.68	2.65 2.82	79.5 81.0	26.6 25.3	---	---
50	8.0	1.7	3.8	1500 1800	55.7 56.8	3.88 4.00	42.4 43.2	104.4 99.2	4.21 4.17	7.8 7.2	1500 1800	70.8 72.3	44.4 48.3	0.63 0.67	3.15 3.35	81.6 83.7	22.5 21.6	4.0 4.2	
	12.0	3.5	8.1	1500 1800	58.9 60.1	3.95 4.05	45.4 46.2	106.3 100.9	4.37 4.35	8.0 7.4	1500 1800	71.6 73.0	44.8 48.8	0.63 0.67	3.09 3.28	82.1 84.2	23.2 22.3	3.7 4.0	
	16.0	6.0	13.8	1500 1800	59.8 61.1	4.00 4.09	46.2 47.2	106.9 101.5	4.39 4.38	8.2 7.5	1500 1800	72.3 73.7	45.3 49.2	0.63 0.67	3.03 3.23	82.6 84.7	23.8 22.9	3.4 3.8	
60	8.0	1.6	3.7	1500 1800	62.4 63.8	4.14 4.21	48.3 49.4	108.5 102.8	4.42 4.44	8.7 8.0	1500 1800	69.2 71.0	44.0 47.8	0.64 0.67	3.40 3.62	80.8 83.3	20.4 19.6	4.8 5.1	
	12.0	3.4	7.8	1500 1800	65.3 66.7	4.21 4.26	50.9 52.2	110.3 104.3	4.54 4.58	9.0 8.3	1500 1800	69.9 71.7	44.4 48.3	0.64 0.67	3.33 3.54	81.3 83.8	21.0 20.2	4.5 4.9	
	16.0	5.8	13.4	1500 1800	66.7 68.2	4.26 4.31	52.2 53.5	111.2 105.1	4.59 4.64	9.2 8.5	1500 1800	70.6 72.4	44.9 48.8	0.64 0.67	3.28 3.48	81.8 84.3	21.5 20.8	4.2 4.6	
70	8.0	1.6	3.6	1500 1800	69.3 70.8	4.44 4.46	54.1 55.6	112.8 106.4	4.58 4.65	9.8 9.0	1500 1800	69.8 72.0	44.4 48.2	0.64 0.67	3.78 4.03	82.7 85.7	18.5 17.9	6.1 6.4	
	12.0	3.3	7.5	1500 1800	71.8 73.4	4.50 4.51	56.4 58.0	114.3 107.8	4.68 4.77	10.1 9.3	1500 1800	70.5 72.8	44.8 48.7	0.64 0.67	3.71 3.94	83.1 86.2	19.0 18.5	5.7 6.1	
	16.0	5.6	12.9	1500 1800	73.6 75.4	4.55 4.55	58.1 59.8	115.5 108.8	4.74 4.85	10.4 9.6	1500 1800	71.2 73.4	45.3 49.2	0.64 0.67	3.64 3.88	83.6 86.7	19.5 18.9	5.3 5.8	
80	8.0	1.5	3.5	1500 1800	76.1 77.9	4.73 4.70	60.0 61.8	117.0 110.1	4.72 4.86	11.0 10.2	1500 1800	65.7 68.2	42.9 46.6	0.65 0.68	4.10 4.37	79.7 83.1	16.0 15.6	7.7 8.1	
	12.0	3.2	7.3	1500 1800	77.9 79.8	4.78 4.74	61.6 63.6	118.1 111.0	4.77 4.94	11.3 10.5	1500 1800	66.4 68.9	43.3 47.0	0.65 0.68	4.02 4.28	80.2 83.5	16.5 16.1	7.1 7.7	
	16.0	5.4	12.5	1500 1800	80.3 82.3	4.84 4.78	63.7 66.0	119.5 112.3	4.86 5.04	11.7 10.8	1500 1800	67.1 69.6	43.8 47.5	0.65 0.68	3.95 4.21	80.6 83.9	17.0 16.5	6.6 7.4	
90	8.0	1.4	3.3	1500 1800	83.0 85.0	5.05 4.97	65.8 68.0	121.2 113.7	4.82 5.01	12.4 11.4	1500 1800	60.5 63.2	41.3 44.9	0.68 0.71	4.40 4.68	75.5 79.1	13.8 13.5	9.6 10.2	
	12.0	3.0	7.0	1500 1800	84.1 86.2	5.10 5.00	66.7 69.1	121.9 114.3	4.83 5.06	12.7 11.8	1500 1800	61.2 63.7	41.7 45.3	0.68 0.71	4.31 4.59	75.9 79.4	14.2 13.9	9.0 9.7	
	16.0	5.2	12.0	1500 1800	87.0 89.3	5.17 5.05	69.4 72.0	123.7 115.9	4.93 5.18	13.1 12.2	1500 1800	61.8 64.4	42.2 45.8	0.68 0.71	4.24 4.51	76.2 79.8	14.6 14.3	8.3 9.2	
100	8.0	1.4	3.2	Operation not recommended								Operation not recommended							
	12.0	2.9	6.8	Operation not recommended								Operation not recommended							
	16.0	5.0	11.6	1500 1800	59.5 62.3	40.6 44.2	0.68 0.71	4.76 5.07	75.7 79.6	12.5 12.3	11.1 12.1								
110	8.0	1.3	3.1	Operation not recommended								Operation not recommended							
	12.0	2.8	6.5	Operation not recommended								Operation not recommended							
	16.0	4.8	11.2	1500 1800	52.6 55.4	37.1 40.3	0.71 0.73	5.09 5.43	69.9 73.9	10.3 10.2	13.6 14.8								
120	8.0	1.3	3.0	Operation not recommended								Operation not recommended							
	12.0	2.7	6.3	Operation not recommended								Operation not recommended							
	16.0	4.6	10.7	1500 1800	51.2 54.6	37.8 41.5	0.74 0.76	5.62 5.90	70.3 74.7	9.1 9.3	16.5 17.0								

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T2GX072 - Performance Data

Dual Stage ECM2.3 Low Speed (1700 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F							COOLING - EAT 80/67 °F												
		PSI	FT/HD	Airflow CFM	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	Airflow CFM	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh					
																			Operation not recommended				
20	10.0	2.3	5.4	Operation not recommended							Operation not recommended												
	13.0	3.6	8.2	Operation not recommended							Operation not recommended												
	16.0	5.0	11.6	1400	32.4	3.36	21.0	91.4	2.83	6.0	1700	34.0	3.40	22.4	88.5	2.93	5.4						
30	10.0	2.3	5.3	Operation not recommended							Operation not recommended												
	13.0	3.5	8.0	1400	36.2	3.38	24.7	93.9	3.14	6.1	1400	55.1	33.7	0.61	1.82	61.3	30.3	---					
	16.0	4.9	11.3	1400	37.8	3.38	26.2	95.0	3.28	6.3	1400	55.2	33.6	0.61	1.75	61.2	31.6	---					
40	10.0	2.2	5.1	Operation not recommended							Operation not recommended												
	13.0	3.4	7.8	1400	42.6	3.48	30.7	98.1	3.58	6.5	1400	57.7	35.7	0.62	2.00	64.5	28.9	---					
	16.0	4.7	11.0	1400	44.4	3.49	32.5	99.1	3.70	6.7	1400	57.8	35.6	0.62	1.93	64.4	29.9	---					
50	10.0	2.1	4.9	1400	47.6	3.52	35.6	101.5	3.96	6.8	1400	59.7	37.3	0.62	2.30	67.6	25.9	2.3					
	13.0	3.3	7.5	1400	48.3	3.56	36.1	101.9	3.98	7.0	1400	59.9	37.6	0.63	2.22	67.5	26.9	2.1					
	16.0	4.6	10.6	1400	50.2	3.54	38.2	97.4	4.16	6.4	1400	61.7	42.7	0.69	2.34	69.7	26.4	2.3					
60	10.0	2.1	4.8	1400	47.6	3.52	35.6	101.5	3.96	6.8	1400	60.0	37.6	0.63	2.16	67.4	27.7	2.0					
	13.0	3.2	7.3	1400	49.7	3.48	37.8	97.1	4.18	6.3	1400	61.6	42.2	0.69	2.42	69.8	25.4	2.4					
	16.0	4.4	10.3	1400	49.7	3.48	37.8	97.1	4.18	6.3	1400	61.9	42.7	0.69	2.28	69.6	27.1	2.2					
70	10.0	2.0	4.6	1400	52.9	3.63	40.5	105.0	4.27	7.5	1400	58.0	36.8	0.63	2.53	66.6	22.9	3.2					
	13.0	3.0	7.0	1400	55.1	3.56	43.0	100.0	4.54	6.9	1400	59.7	37.3	0.65	2.83	67.2	20.4	4.5					
	16.0	4.3	9.9	1400	54.4	3.67	41.9	106.0	4.34	7.7	1400	59.2	42.0	0.71	2.94	69.3	20.2	4.8					
80	10.0	1.9	4.5	1400	54.4	3.67	41.9	106.0	4.34	7.7	1400	57.9	37.8	0.65	2.74	67.3	21.2	4.2					
	13.0	2.9	6.8	1400	60.6	3.80	47.6	110.1	4.67	8.5	1400	59.6	42.5	0.71	2.85	69.3	20.9	4.5					
	16.0	4.2	9.6	1400	61.7	3.86	48.5	110.8	4.69	8.8	1400	58.2	38.0	0.65	2.70	67.5	21.6	3.9					
90	10.0	1.9	4.3	1400	62.9	3.69	50.3	104.3	5.00	7.9	1400	60.1	42.7	0.71	2.79	69.6	21.5	4.3					
	13.0	2.8	6.6	1400	62.9	3.69	50.3	104.3	5.00	7.9	1400	60.1	42.7	0.71	2.79	69.6	21.5	4.3					
	16.0	4.0	9.3	1400	62.9	3.69	50.3	104.3	5.00	7.9	1400	60.1	42.7	0.71	2.79	69.6	21.5	4.3					
100	10.0	1.8	4.2	Operation not recommended							Operation not recommended												
	13.0	2.7	6.3	Operation not recommended							Operation not recommended												
	16.0	3.9	8.9	1400	62.9	3.69	50.3	104.3	5.00	7.9	1400	54.9	36.5	0.66	3.15	65.7	17.4	6.2					
110	10.0	1.7	4.0	Operation not recommended							Operation not recommended												
	13.0	2.6	6.1	Operation not recommended							Operation not recommended												
	16.0	3.7	8.6	1400	66.2	3.91	52.8	113.8	4.97	9.5	1400	55.4	36.9	0.67	3.07	65.9	18.0	5.8					
120	10.0	1.7	3.8	Operation not recommended							Operation not recommended												
	13.0	2.5	5.8	Operation not recommended							Operation not recommended												
	16.0	3.6	8.2	1400	68.5	3.75	55.8	107.3	5.36	8.8	1400	57.0	41.3	0.72	3.16	67.8	18.0	6.3					

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

T2GX072 - Performance Data


Dual Stage ECM2.3 High Speed (2200 CFM)

EWT °F	Flow Rate GPM	Water Pressure Drop		HEATING - EAT 70°F							COOLING - EAT 80/67 °F												
		PSI	FT/HD	Airflow CFM	HC kBtuh	Power kW	HE kBtuh	LAT °F	COP	HWC kBtuh	Airflow CFM	TC kBtuh	SC kBtuh	S/T Ratio	Power kW	HR kBtuh	EER	HWC kBtuh					
20	12.0	3.3	7.6	Operation not recommended							Operation not recommended												
	15.0	4.6	10.7	Operation not recommended							Operation not recommended												
	18.0	6.2	14.3	1850	45.4	4.08	31.4	92.7	3.26	7.9	2200	47.1	4.34	32.2	89.8	3.18	7.1						
30	12.0	3.2	7.4	Operation not recommended							Operation not recommended												
	15.0	4.5	10.4	1850	52.6	4.24	38.1	96.3	3.64	8.3	2200	71.9	43.9	0.61	2.56	80.7	28.1	---					
	18.0	6.0	13.9	1850	53.0	4.28	38.4	96.5	3.63	8.6	2200	72.7	44.7	0.61	2.52	81.2	28.9	---					
40	12.0	3.1	7.1	Operation not recommended							Operation not recommended												
	15.0	4.4	10.1	1850	61.0	4.50	45.6	100.5	3.97	9.2	2200	74.8	46.7	0.62	3.09	85.3	24.2	---					
	18.0	5.8	13.5	1850	61.9	4.55	46.3	101.0	3.98	9.5	2200	75.6	47.6	0.63	3.03	85.9	24.9	---					
50	12.0	3.0	6.9	1850	64.9	4.69	48.9	102.5	4.06	9.9	2200	76.2	48.6	0.64	3.75	89.0	20.3	4.3					
	15.0	4.2	9.8	1850	67.1	4.86	50.5	98.2	4.05	9.2	2200	77.8	52.8	0.68	3.98	91.4	19.5	4.6					
	18.0	5.7	13.1	1850	68.6	4.78	52.3	104.3	4.21	10.3	2200	77.0	49.1	0.64	3.67	89.5	21.0	4.0					
60	12.0	2.9	6.7	1850	69.8	4.84	53.3	104.9	4.23	10.6	2200	78.5	53.4	0.68	3.90	91.8	20.1	4.4					
	15.0	4.1	9.5	1850	72.1	4.99	55.1	100.3	4.24	9.7	2200	77.8	52.8	0.68	3.98	91.4	19.5	4.6					
	18.0	5.5	12.7	1850	73.0	5.00	56.0	106.5	4.28	11.1	2200	75.6	47.6	0.63	3.03	85.9	24.9	---					
70	12.0	2.8	6.5	1850	76.2	5.08	58.9	108.2	4.39	11.5	2200	77.1	53.2	0.69	4.15	91.3	18.6	5.3					
	15.0	4.0	9.1	1850	77.9	5.15	60.4	109.0	4.44	11.8	2200	77.9	53.7	0.69	4.08	91.9	19.1	5.1					
	18.0	5.3	12.2	1850	80.5	5.22	62.7	103.9	4.52	10.9	2200	74.8	48.7	0.65	3.99	88.4	18.8	5.3					
80	12.0	2.7	6.3	1850	81.2	5.31	63.0	110.6	4.48	12.5	2200	76.4	52.6	0.69	4.24	90.9	18.0	5.6					
	15.0	3.8	8.8	1850	83.7	5.35	65.5	105.2	4.59	11.6	2200	75.5	50.2	0.66	4.34	90.3	17.4	6.2					
	18.0	5.1	11.8	1850	84.0	5.39	65.6	112.0	4.56	12.9	2200	77.1	53.9	0.70	4.61	92.8	16.7	6.7					
90	12.0	2.6	6.0	1850	86.2	5.46	67.5	113.1	4.63	13.3	2200	76.4	50.7	0.66	4.26	90.9	17.9	5.7					
	15.0	3.7	8.5	1850	88.3	5.66	69.0	114.2	4.57	14.1	2200	77.9	54.5	0.70	4.54	93.4	17.1	6.4					
	18.0	4.9	11.4	1850	88.3	5.66	72.0	108.4	4.75	13.0	2200	71.5	48.3	0.68	4.76	87.8	15.0	8.4					
100	12.0	2.5	5.8	1850	90.4	5.74	70.8	115.3	4.62	14.5	2200	73.0	49.5	0.68	4.58	88.7	15.9	7.2					
	15.0	3.6	8.2	1850	91.2	5.62	72.0	108.4	4.75	13.0	2200	74.5	53.3	0.71	4.88	91.2	15.3	8.0					
	18.0	4.8	11.0	1850	93.2	5.81	73.3	116.6	4.70	15.0	2200	73.0	49.5	0.68	4.58	88.7	15.9	7.2					
110	12.0	2.4	5.6	1850	95.6	6.03	75.1	117.9	4.65	15.8	2200	66.9	45.9	0.69	4.98	83.9	13.4	10.5					
	15.0	3.4	7.9	1850	98.8	5.90	78.6	111.6	4.90	14.7	2200	68.3	49.9	0.73	5.30	86.4	12.9	11.1					
	18.0	4.6	10.6	1850	97.0	6.09	76.2	118.5	4.67	16.3	2200	67.5	46.4	0.69	4.87	84.2	13.9	9.8					
120	12.0	2.3	5.4	1850	100.1	5.93	79.9	112.1	4.95	15.1	2200	68.9	50.3	0.73	5.19	86.6	13.3	10.6					
	15.0	3.3	7.6	1850	100.3	6.17	79.2	120.2	4.76	16.8	2200	68.3	47.3	0.69	4.80	84.6	14.2	9.1					
	18.0	4.4	10.2	1850	103.6	6.00	83.2	113.6	5.06	15.6	2200	69.7	50.9	0.73	5.11	87.1	13.6	10.1					
130	12.0	2.5	5.8	Operation not recommended							Operation not recommended												
	15.0	3.6	8.2	1850	64.7	45.7	0.71	5.38	83.1	12.0	12.2	2200	66.1	49.4	0.75	5.72	85.6	11.5	13.2				
	18.0	4.8	11.0	1850	65.5	46.4	0.71	5.29	83.5	12.4	11.3	2200	66.8	49.8	0.75	5.63	86.0	11.9	12.5				
140	12.0	2.4	5.6	Operation not recommended							Operation not recommended												
	15.0	3.4	7.9	1850	57.8	42.3	0.73	5.62	77.0	10.3	14.9	2200	59.0	45.5	0.77	5.98	79.4	9.9	16.1				
	18.0	4.6	10.6	1850	58.4	42.7	0.73	5.52	77.3	10.6	13.8	2200	59.6	45.9	0.77	5.88	79.7	10.2	15.3				
150	12.0	2.3	5.4	Operation not recommended							Operation not recommended												
	15.0	3.3	7.6	1850	54.7	41.0	0.75	6.17	75.8	8.9	18.0	2200	55.8	44.3	0.79	6.57	78.2	8.5	19.5				
	18.0	4.4	10.2	1850	55.3	41.5	0.75	6.06	76.0	9.1	16.7	2200	56.5	44.6	0.79	6.44	78.4	8.8	18.5				

IMPORTANT NOTE: Refer to the Notes to Capacity Tables for additional information.

Wiring Schematics - Residential

T1GX Series - Single Stage Wiring Schematic - 208-230/60/1 - PSC




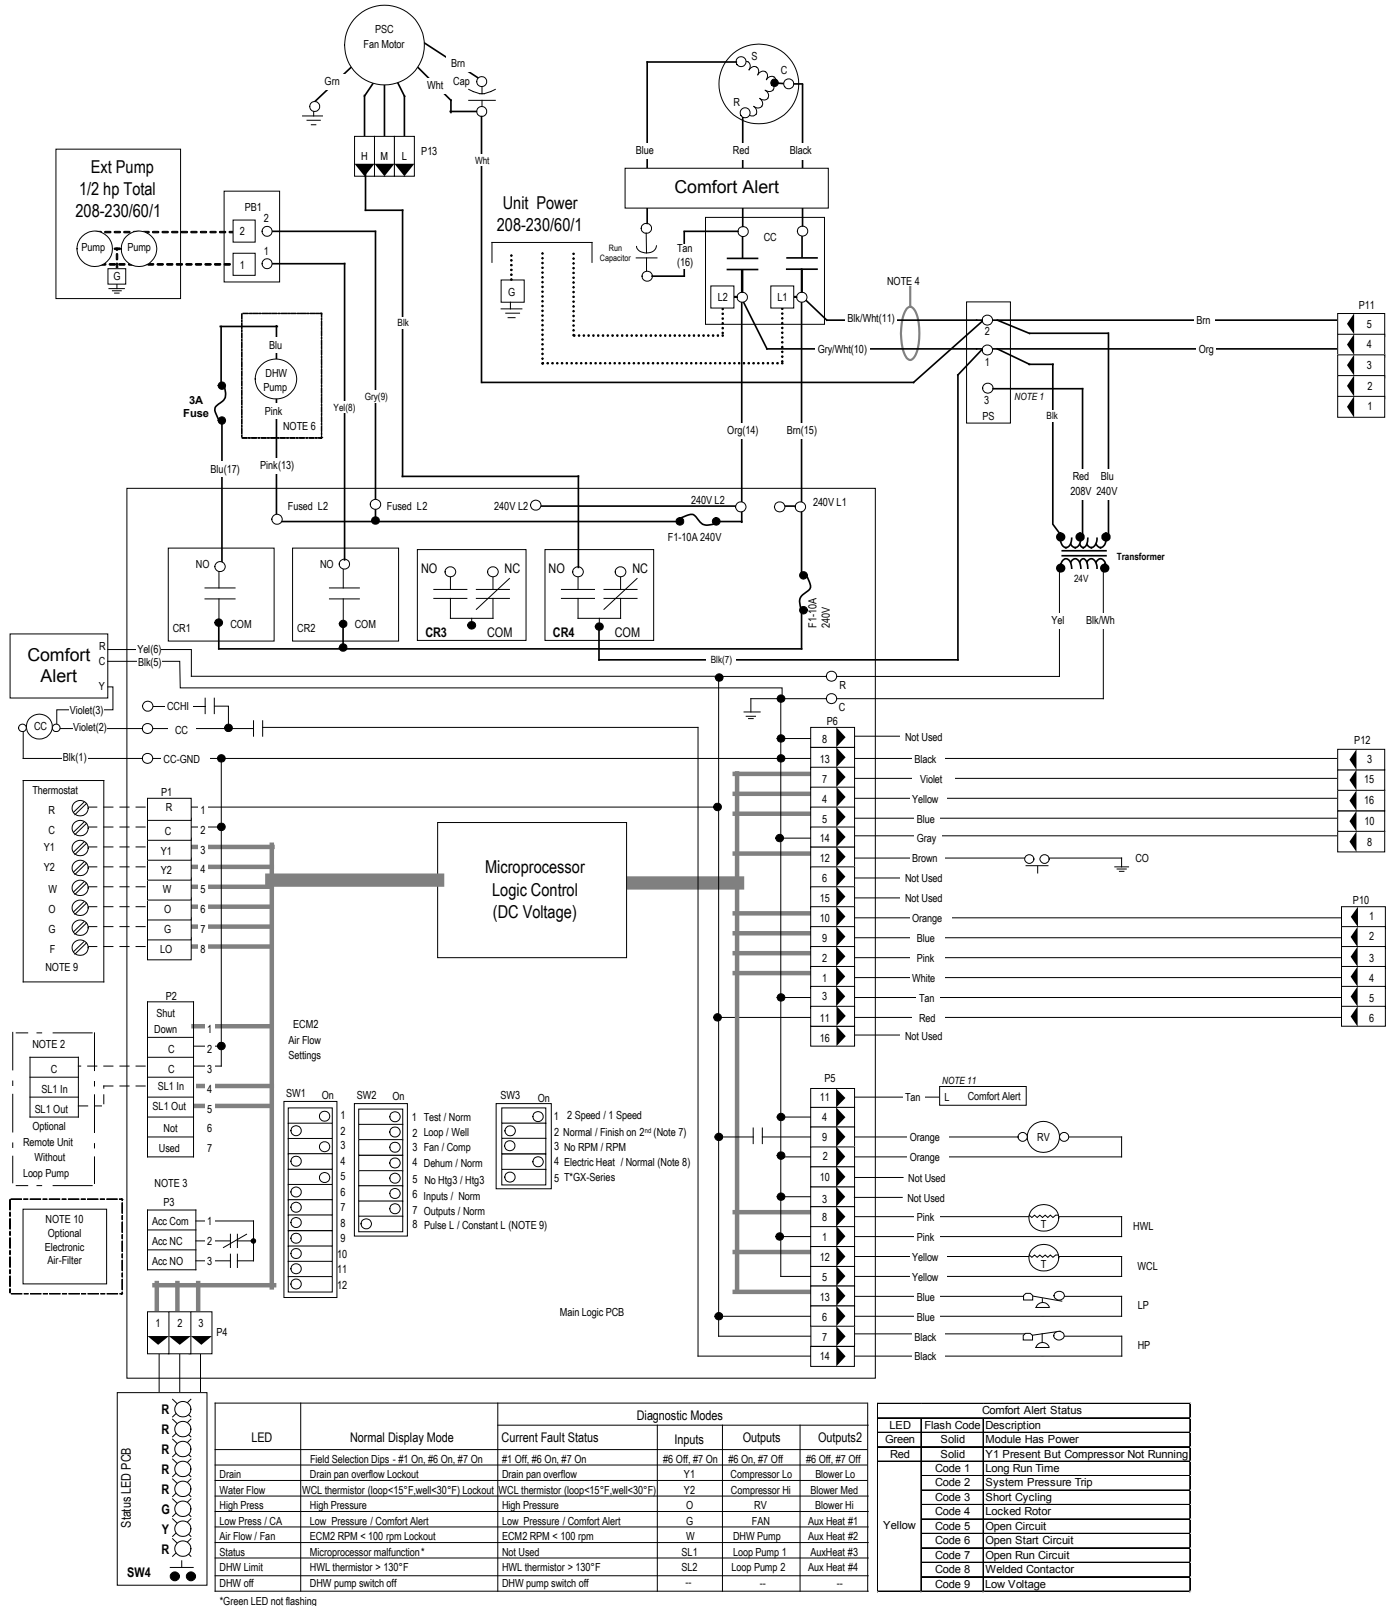


LED	Normal Display Mode	Diagnostic Modes			
		Current Fault Status	Inputs	Outputs	Outputs2
	Field Selection Dip - #1 On, #6 On, #7 On	#1 Off, #6 On, #7 On	#6 Off, #7 On	#6 On, #7 Off	#6 Off, #7 Off
	Drain	Drain pan overflow Lockout	Drain pan overflow	Compressor Lo	Blower Lo
	Water Flow	WCL thermistor (loop<15°F, well<30°F) Lockout	Y1	Compressor Hi	Blower Med
	High Press	High Pressure	High Pressure	RV	Blower Hi
	Low Press / CA	Low Pressure / Comfort Alert	Low Pressure / Comfort Alert	FAN	Aux Heat #1
	Air Flow / Fan	ECM2 RPM < 100 rpm Lockout	ECM2 RPM < 100 rpm	W	DHW Pump
	Status	Microprocessor malfunction*	Not Used	SL1	AuxHeat #3
	DHW Limit	HWL thermistor > 130°F	HWL thermistor > 130°F	SL2	Loop Pump 2
	DHW off	DHW pump switch off	DHW pump switch off	--	--

Comfort Alert Status		
LED	Flash Code	Description
Green	Solid	Module Has Power
Red	Solid	Y1 Present But Compressor Not Running
Yellow	Code 1	Long Run Time
	Code 2	System Pressure Trip
	Code 3	Short Cycling
	Code 4	Locked Rotor
	Code 5	Open Circuit
	Code 6	Open Start Circuit
	Code 7	Open Run Circuit
	Code 8	Welded Contactor
	Code 9	Low Voltage


Wiring Schematics - Residential cont.

T1GX Series - Single Stage Wiring Schematic - 208-230/60/1 - PSC cont.

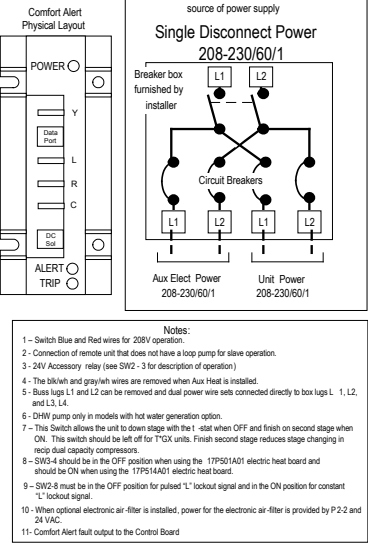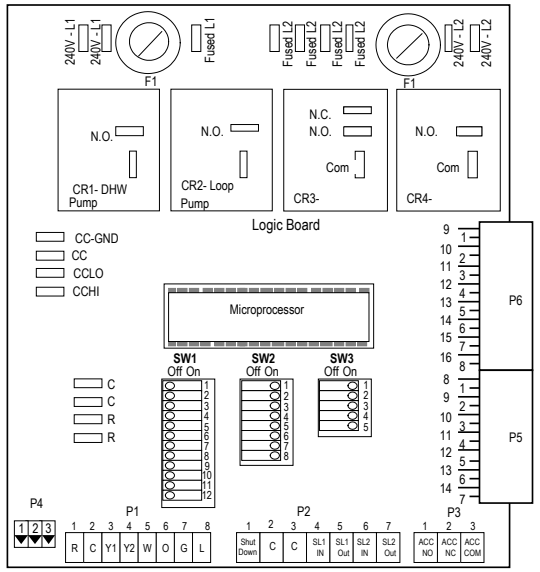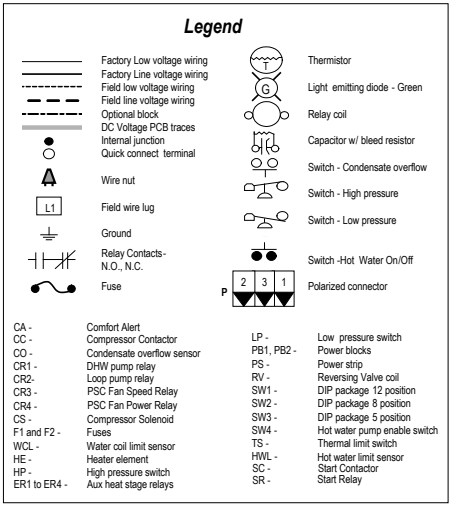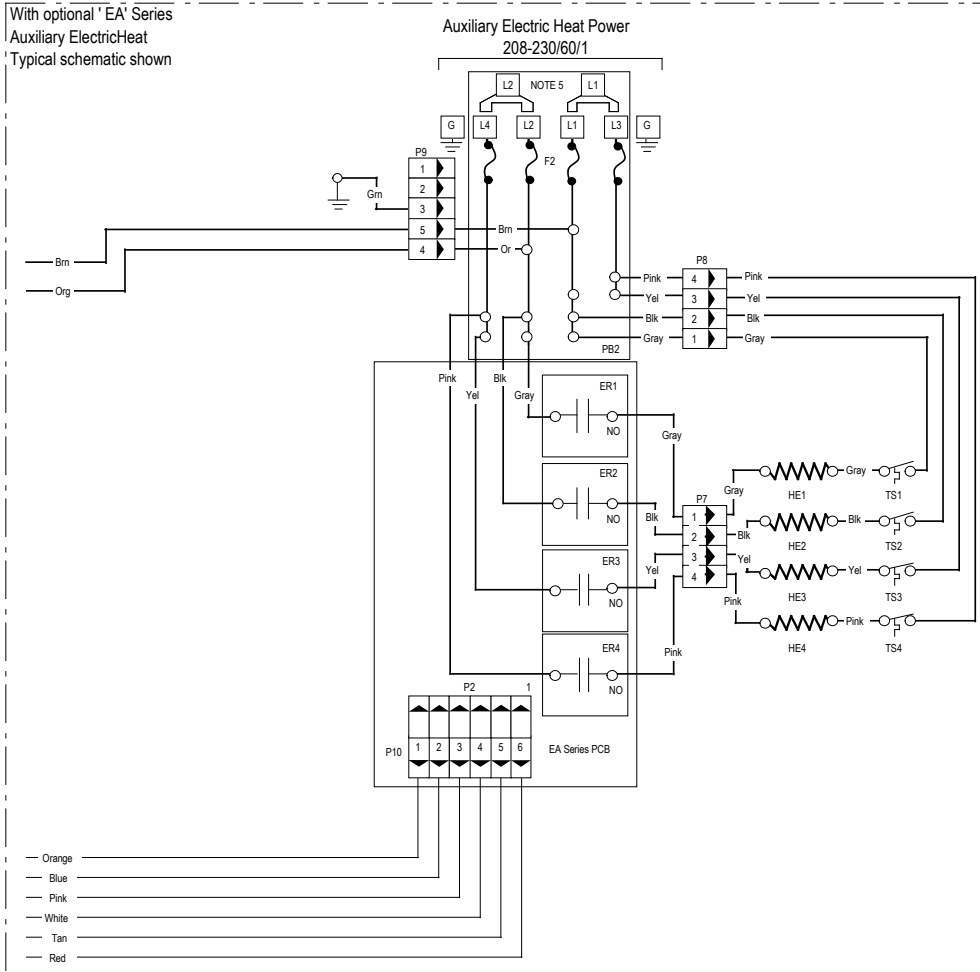

Wiring Schematics - Residential cont.

Single Stage - 208-230/60/1

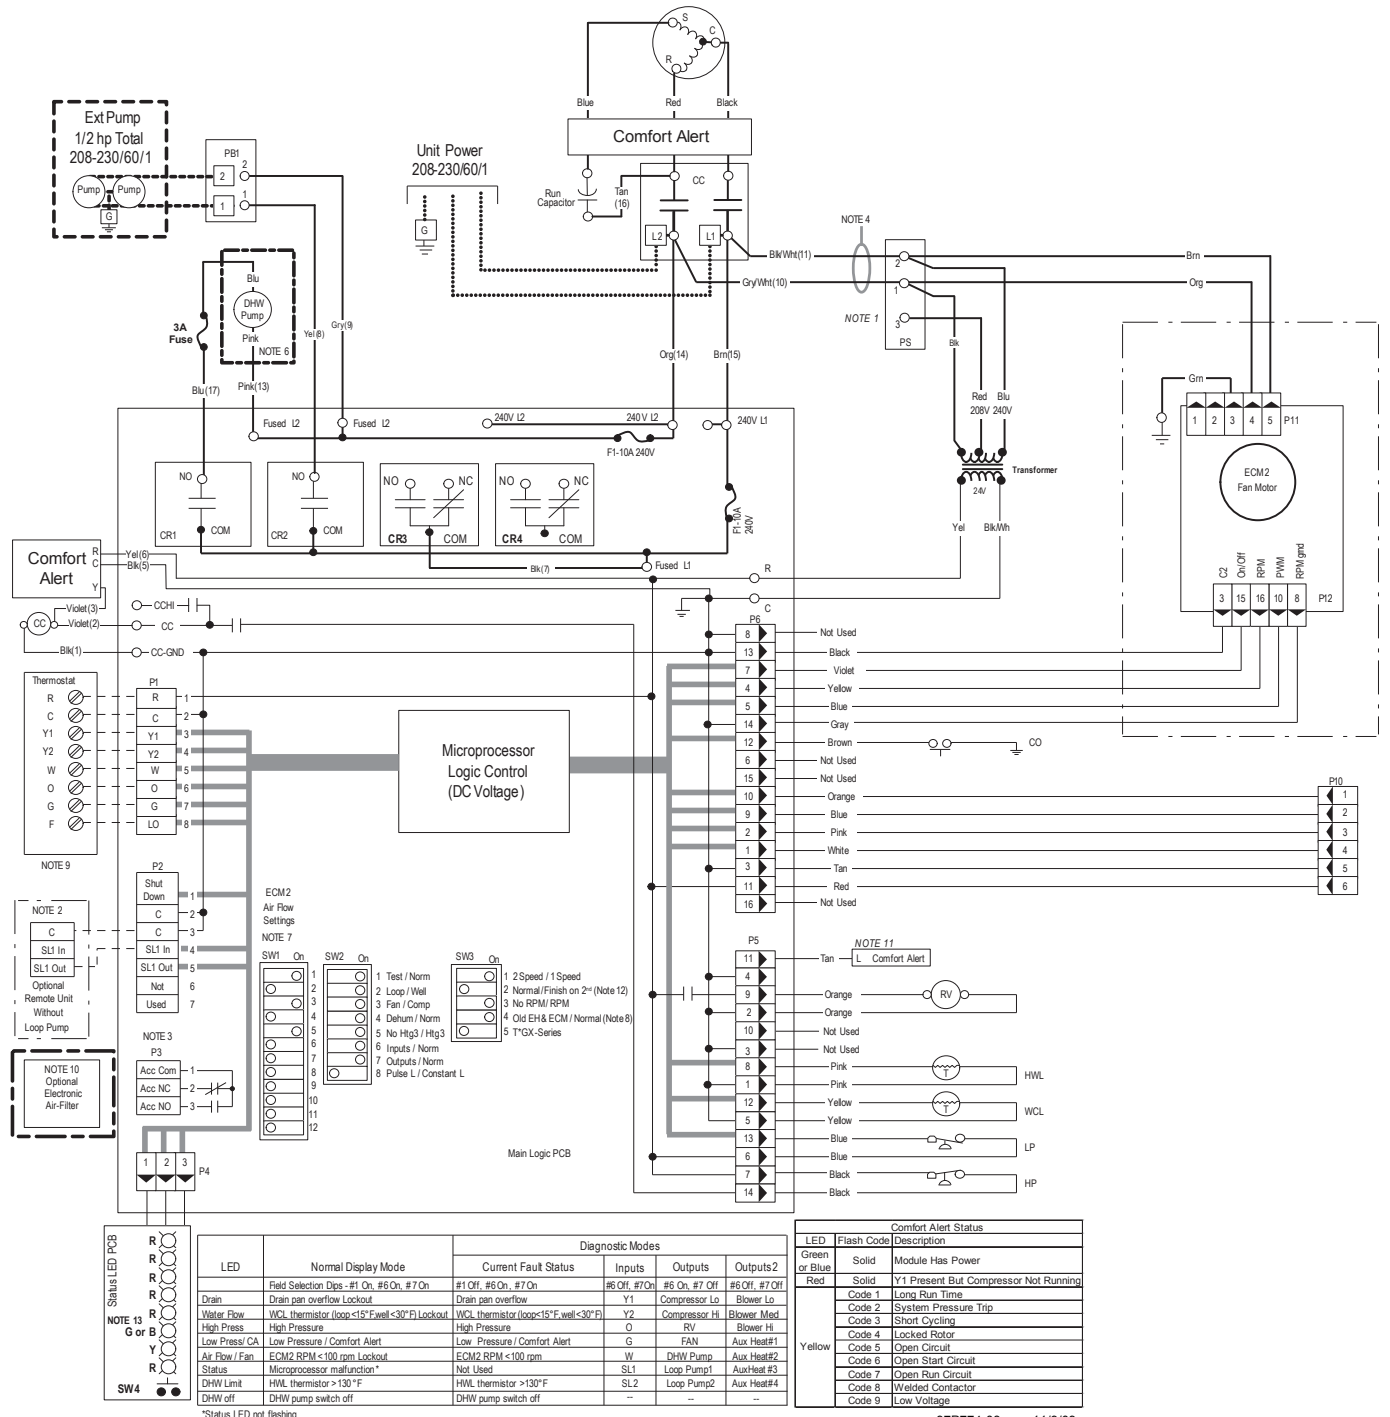






LED	Normal Display Mode		Diagnostic Modes		
	Field Selection Digs - #1 On, #6 On, #7 On	#1 Off, #6 On, #7 On	Current Fault Status	Inputs	Outputs
Drain	Drain pan overflow Lockout	Drain pan overflow	#6 Off, #7 On	#6 On, #7 Off	#6 Off, #7 Off
Water Flow	WCL thermostat (loop < 15°F, well < 30°F) Lockout	WCL thermostat (loop < 15°F, well < 30°F)	Y1	Compressor Lo	Blower Lo
High Press	High Pressure	High Pressure	Y2	Compressor Hi	Blower Med
Low Press/CA	Low Pressure / Comfort Alert	Low Pressure / Comfort Alert	O	RV	Blower Hi
Air Flow / Fan	ECM2 RPM < 100 rpm Lockout	ECM2 RPM < 100 rpm	G	FAN	Aux Heat#1
Status	Microprocessor malfunction*	Not Used	SL1	Loop Pump1	Aux Heat#3
DHW Limit	HWL thermostat > 130°F	HWL thermostat > 130°F	SL2	Loop Pump2	Aux Heat#4
DHW off	DHW pump switch off	DHW pump switch off	--	--	--

Comfort Alert Status	
LED	Description
Green or Blue	Module Has Power
Red	Y1 Present But Compressor Not Running
Code 1	Long Run Time
Code 2	System Pressure Trip
Code 3	Short Cycling
Code 4	Locked Rotor
Code 5	Open Circuit
Code 6	Open Start Circuit
Code 7	Open Run Circuit
Code 8	Welded Contactor
Code 9	Low Voltage

*Status LED not flashing

Wiring Schematics - Residential cont.



Single Stage - 208-230/60/1 cont.

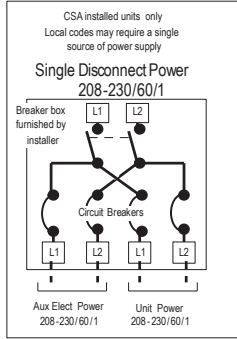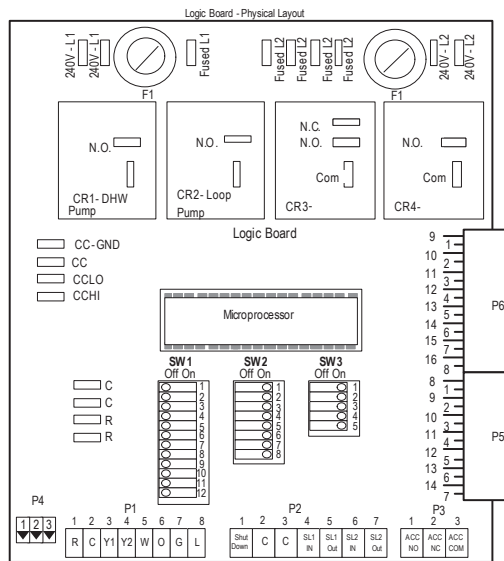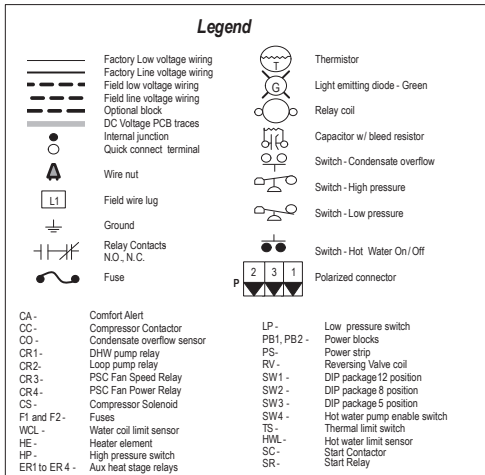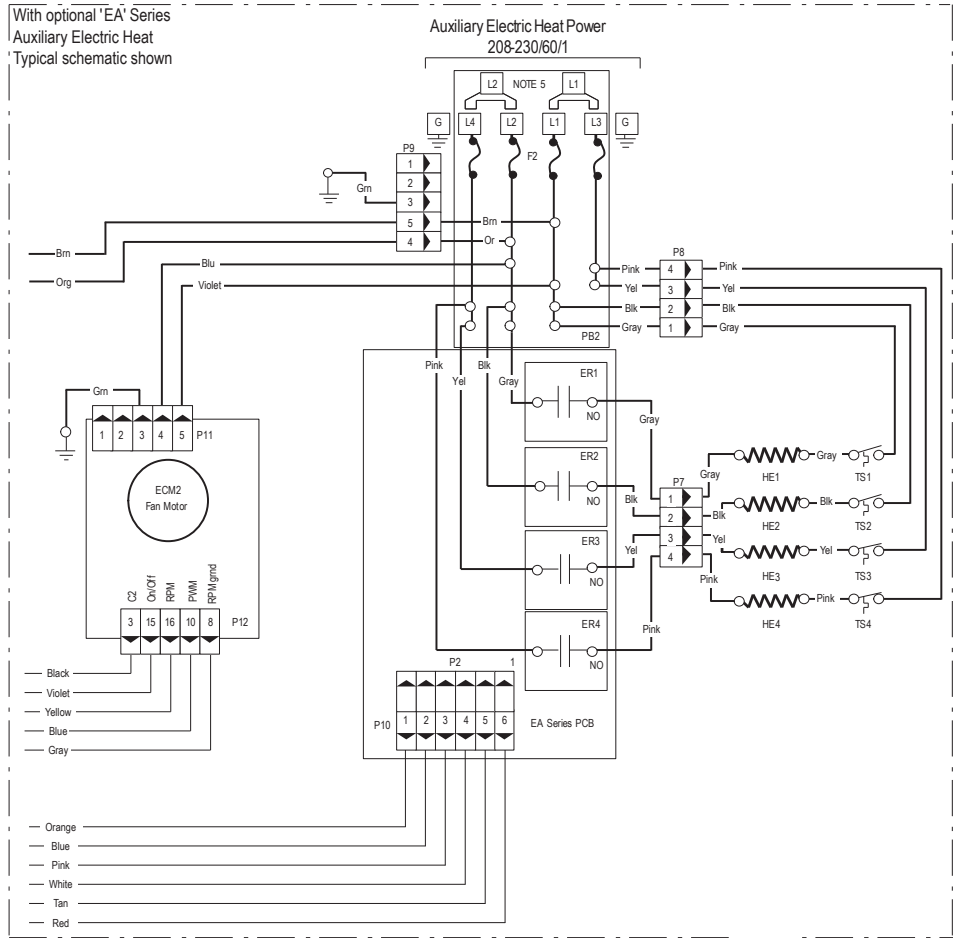

- #### Notes:
- 1 - Switch Blue and Red wires for 208 V operation.
 - 2 - Connection of remote unit that does not have a loop pump for slave operation.
 - 3 - 24V Accessory relay (see SW2 - 3 for description of operation)
 - 4 - The Blk and gray wires are removed when Aux Heat is installed.
 - 5 - Blue legs L1 and L2 can be removed and dual power wire sets connected directly to box lugs L1, L2, and L3, L4.
 - 6 - DHW pump only in models with hot water generation option.
 - 7 - All Fan Configuration Example: SW1 configured for dip 1 as low, dip 3 as medium, and dip 5 as High Speed ECM2 fan.
 - 8 - SW 3 4 should be in the OFF position when using ECM2 motor and 17P501A01 electric heat board and should be ON when using ECM2 with 17P514 A01 electric heat board.
 - 9 - SW2 8 must be in the OFF position for pulsed "L" lockout signal and in the ON position for constant "L" lockout signal.
 - 10 - When optional electronic air - filter is installed, power for the electronic air - filter is provided by P2 - 2 and HIG24.
 - 11 - Comfort Alert fault output to the Control Board.
 - 12 - This Switch allows the unit to down stage with the 1 - stst when OFF and finish on second stage when ON. This switch should be left off for TCG units. Finish second stage reduces stage charging in reup dual capacity compressors.
 - 13 - Status LED may be Green or Blue depending on model.

Wiring Schematics - Residential cont.

T2GX Dual Stage - 208-230/60/1

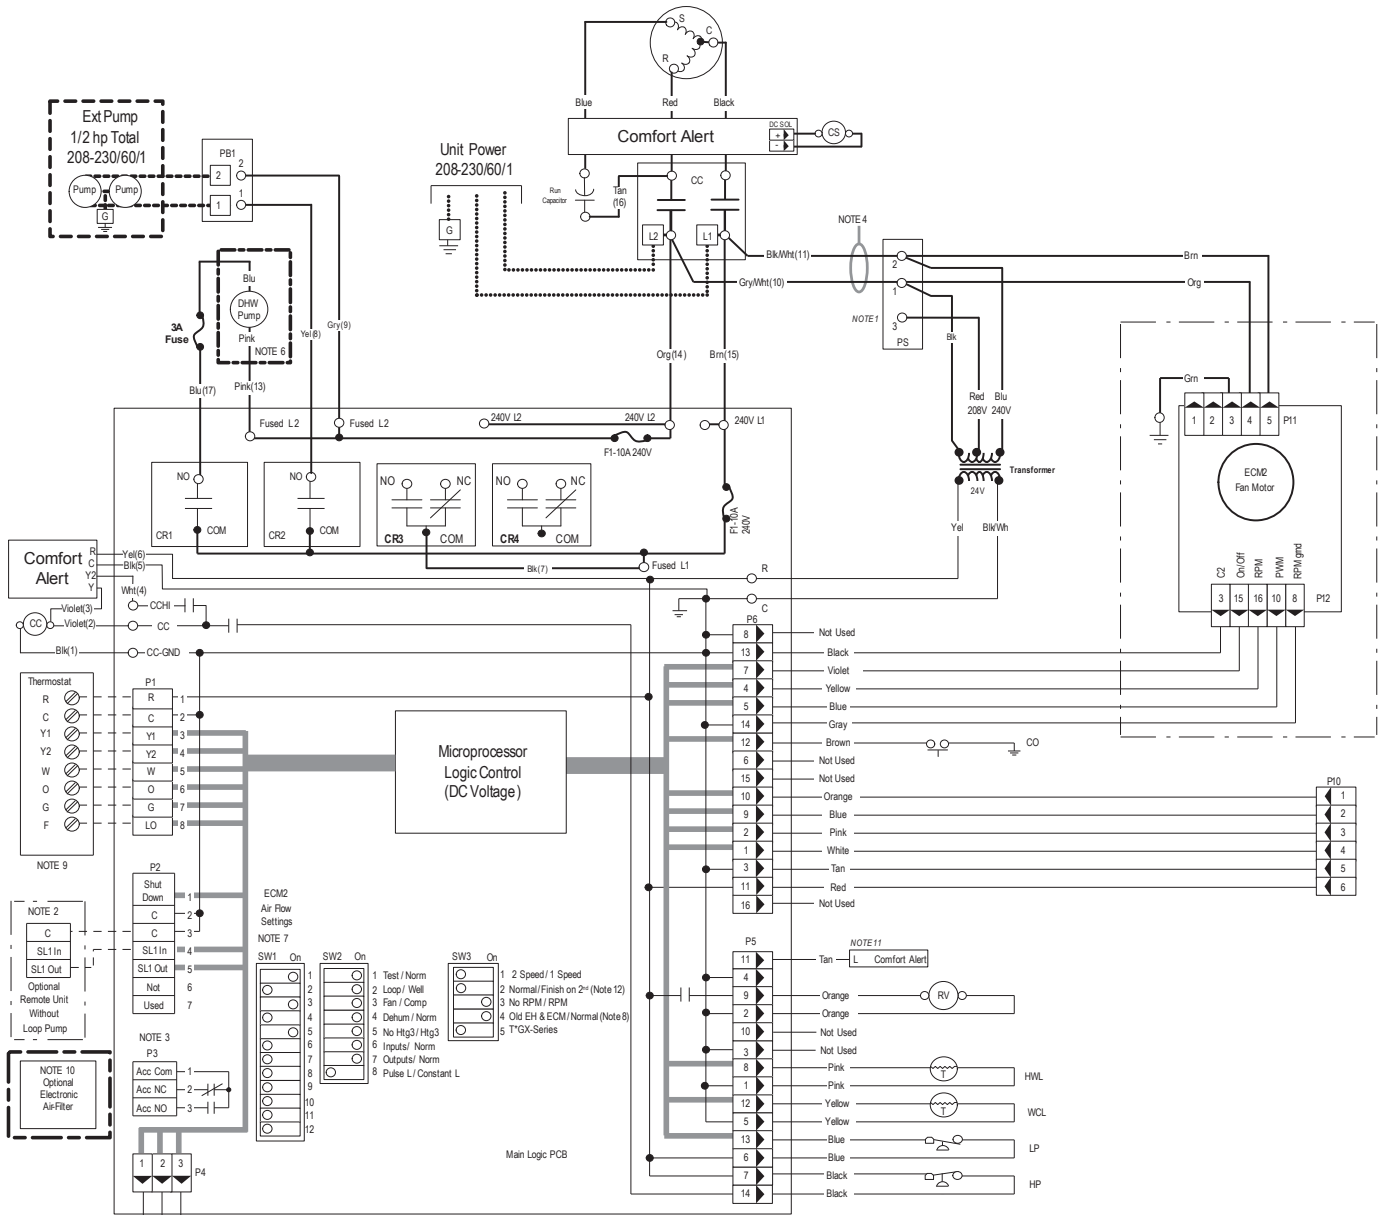





LED	Normal Display Mode	Diagnostic Modes			
		Current Fault Status	Inputs	Outputs	Outputs2
Drain	Field Selection Dips-#1 On, #6 On, #7 On	#1 Off, #6 On, #7 On	#6 Off, #7 On	#6 On, #7 Off	#6 Off, #7 Off
Water Flow	WCL thermostat (loop <15°F, well <30°F) Lockout	Drain pan overflow	Y1	Compressor Lo	Blower Lo
High Press	High Pressure	High Pressure	O	RV	Blower Hi
Low Press/CA	Low Pressure / Comfort Alert	Low Pressure / Comfort Alert	G	FAN	Aux Heat#1
Air Flow / Fan	ECM2 RPM < 100 rpm Lockout	ECM2 RPM < 100 rpm	W	DHW Pump	Aux Heat#3
Status	Microprocessor malfunction*	Not Used	SL1	Loop Pump1	Aux Heat#4
DHW Limit	HWL thermostat < 130°F	HWL thermostat < 130°F	SL2	Loop Pump2	
DHW off	DHW pump switch off	DHW pump switch off	--	--	--

Comfort Alert Status	
LED	Description
Green or Blue	Solid Module Has Power
Red	Solid Y1 Present But Compressor Not Running
Yellow	Code 1 Long Run Time
	Code 2 System Pressure Trip
	Code 3 Short Cycling
	Code 4 Locked Rotor
	Code 5 Open Circuit
	Code 6 Open Start Circuit
	Code 7 Open Run Circuit
	Code 8 Welded Contactor
	Code 9 Low Voltage

97P774-04 11/9/09

Wiring Schematics - Residential cont.

T2GX Dual Stage - 208-230/60/1 cont.

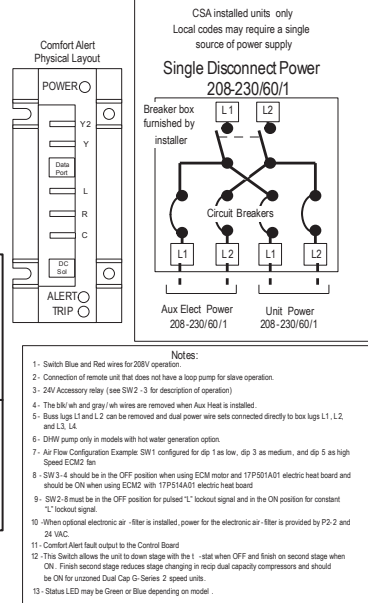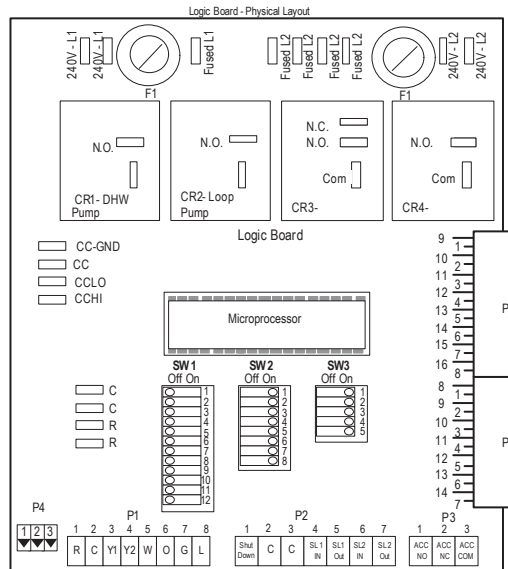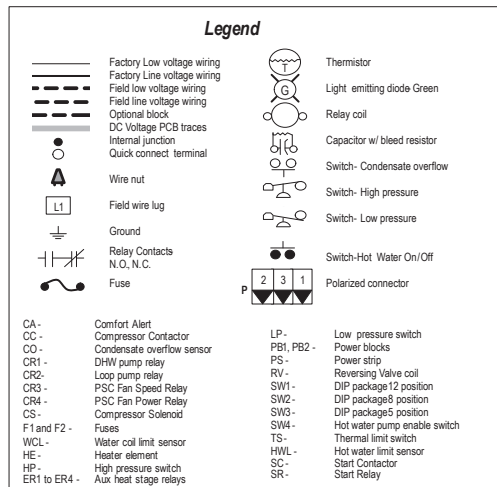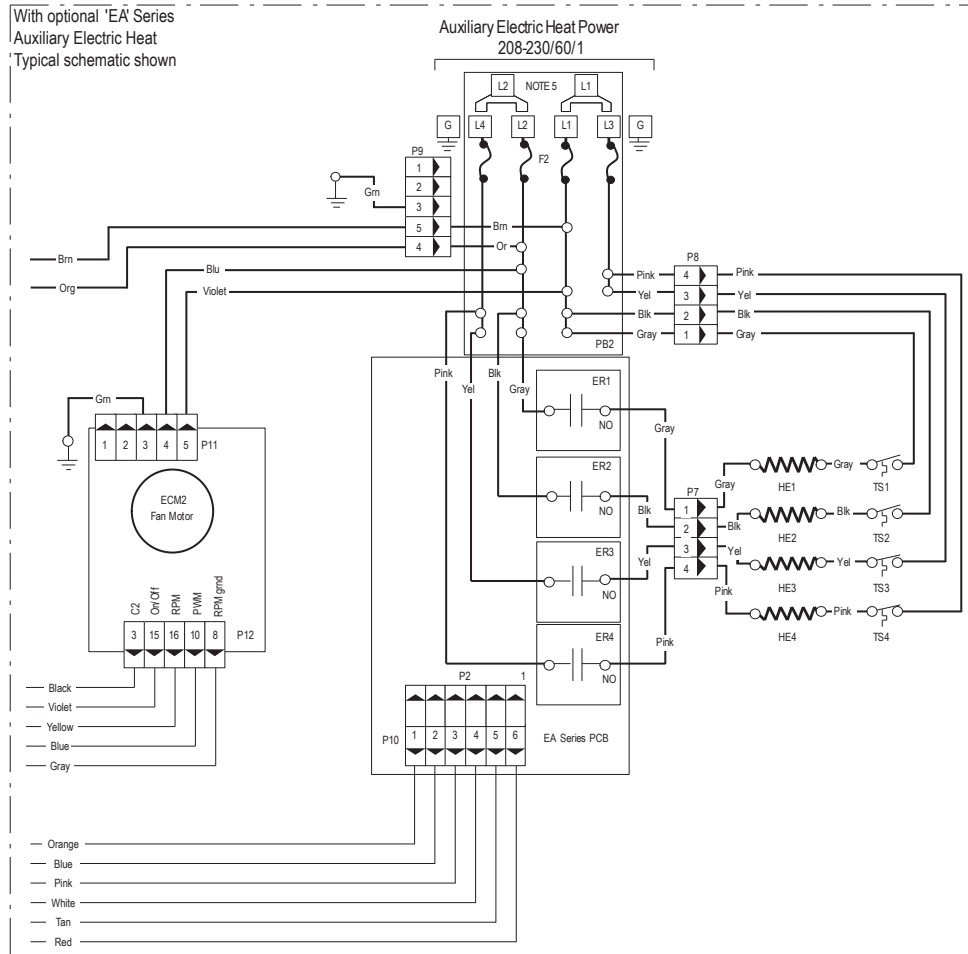

Microprocessor Control

Startup

The unit will not operate until all the inputs and safety controls are checked for normal conditions. Upon power-up, a four minute delay is employed before the compressor is energized.

Component Sequencing Delays

Components are sequenced and delayed for optimum space conditioning performance.

Accessory Relay

An accessory relay on the control board allows for field connection of solenoid valves, electronic air cleaners, etc. The accessory relay has a normally open output and a normally closed output.

Short Cycle Protection

The control employs a minimum "off" time of four minutes to provide for short cycle protection of the compressor.

Condensate Overflow Protection

The T1GX, T2GX Series control board incorporates an impedance sensing liquid sensor at the top of the drain pan. Upon a continuous 30-second sensing of the condensate, compressor operation is suspended (see Fault Retry), and the condensate overflow lockout LED begins flashing.

Shutdown Mode

A 24VAC common signal to the "shutdown" input on the control board puts the unit into shutdown mode. Compressor, hot water pump and blower operation are suspended.

Safety Controls

The T1GX, T2GX Series control receives separate signals for a high pressure switch for safety, a low pressure switch to prevent loss of charge damage, and a low suction temperature thermistor for freeze sensing. Upon a continuous 30-second measurement of the fault (immediate for high pressure), compressor operation is suspended, the appropriate lockout LED begins flashing. (Refer to the "Fault Retry" section below.)

Testing

The T1GX, T2GX Series control allows service personnel to shorten most timing delays for faster diagnostics. (Refer to the Field Selection DIP switch SW2-1 on the Wiring Schematic pages.)

Fault Retry

All faults (except for low RPM faults with the ECM2.3 blower motor) are retried twice before finally locking the unit out. An output signal is made available for a fault LED at the thermostat. The "fault retry" feature is designed to prevent nuisance service calls.

Diagnostics

The T1GX, T2GX Series control board allows all inputs and outputs to be displayed on the LEDs for fast and simple control board diagnosis. (Refer to the Field Selection DIP Switch SW2-1 on the Wiring Schematic pages.)

Resistance Heat Control (208-230 Units)

The electric heat control module contains the appropriate high-voltage control relays. Control signals energize the relays in the proper sequence, and the LED display board indicates which stages are energized.

Hot Water High Limit (Domestic Hot Water Option)

This mode occurs when the hot water input temperature is at or above 130°F for 30 continuous seconds. The DHW limit status LED on the unit illuminates and the hot water pump de-energizes. Hot water pump operations resume on the next compressor cycle or after 15 minutes of continuous compressor operation during the current thermostat demand cycle.

Hot Water Justification

Since compressor hot gas temperature is dependant on loop temperature in cooling mode, loop temperatures may be too low to allow proper heating of water. The control will monitor water and refrigerant temperatures to determine if conditions are satisfactory for heating water. The DHW limit status LED on the unit illuminates when conditions are not favorable for heating water.

Heating Operation

Heat, 1st Stage (Y1)

The blower motor is started on low speed immediately (PSC ON), the loop pump is energized 5 seconds after the "Y1" input is received, and the compressor is energized on low capacity 10 seconds after the "Y1" input. The blower is switched to medium speed 15 seconds after "Y1" input (ECM2.3 only). The hot water pump is cycled 30 seconds after the "Y1" input.

Heat, 2nd Stage (Y1,Y2) Single-Speed Units

The hot water pump is de-energized, which directs all heat to satisfying the thermostat, and the blower changes to high speed 15 seconds after the "Y2" input (ECM2.3 only).

Heat, 2nd Stage (Y1,Y2) Dual Stage Units

The second stage compressor will be activated 5 seconds after receiving a "Y2" input as long as the minimum first stage compressor run time of 1 minute has expired. The ECM2.3 blower changes from medium to high speed 15 seconds after the "Y2" input.

The Comfort Alert will delay the second stage compressor until 5 seconds after it receives a "Y2" from the board.

Heat, 3rd Stage (Y1,Y2,W) Single-Speed Units

The first stage of resistance heat is energized 10 seconds after "W" input, and with continuous 3rd stage demand, the additional stages of resistance heat engage sequentially every 5 minutes.

Microprocessor Control cont.

Heat, 3rd Stage (Y1,Y2,W) Dual Stage Units

The hot water pump is de-energized which directs all heat to satisfy the thermostat. The 1st stage of resistance heat is energized 10 seconds after “W” input, and with continuous 3rd stage demand, the additional stages of resistance heat engage sequentially every 5 minutes.

Emergency Heat (W only)

The blower is started on high speed, and the first stage of resistance heat is energized 10 seconds after the “W” input. Continuing demand will engage the additional stages of resistance heat sequentially every 2 minutes.

Cooling Operation

In all cooling operations, the reversing valve directly tracks the “O” input. Thus, anytime the “O” input is present, the reversing valve will be energized.

Cool, 1st Stage (Y1,O)

The blower motor and hot water pump are started immediately, the loop pump(s) is energized 5 seconds after the “Y1” input is received. The compressor will be energized (on low capacity for Dual Stage units) 10 seconds after the “Y1” input. The ECM2.3 blower will shift from low to medium speed 15 seconds after the “Y1” input (85% of medium speed if in dehumidification mode).

Cool, 2nd Stage (Y1, Y2, O) Single Stage Units

The blower changes to high speed (85% of high speed if in dehumidification mode) 15 seconds after the “Y2” input (ECM2.3 only).

Cool, 2nd Stage (Y1, Y2, O) Dual Stage Units

The second stage compressor will be activated 5 seconds after receiving a “Y2” input as long as the minimum first stage compressor run time of 1 minute has expired. The ECM2.3 blower changes to high speed 15 seconds after the “Y2” input. (85% of high speed if in dehumidification mode). The Comfort Alert will delay the second stage compressor until 5 seconds after it receives a “Y2” from the board.

Blower (G only)

The blower starts on low speed. Regardless of blower input “G” from thermostat, the blower will remain on low speed for 30 seconds at the end of each heating, cooling or emergency heat cycle.

A DIP switch on the T1GX, T2GX Series control allows field selection of 15% reduced blower speeds for cooling in the dehumidification mode or medium and high blower speeds for cooling in the normal mode.

NOTE: Blower speed can change automatically only with an ECM2.3 Motor.

ECM2.3 Airflow Selection DIP Switches (SW1)

A 12-position DIP switch package on the T1GX, T2GX Series control allows the airflow levels to be set for low, medium and high speed. (Refer to the ECM2.3 Blower Table in the Blower Performance Data section.)

Only three of the DIP switches can be in the “on” position. The first “on” switch (the lowest position number) determines the “low speed blower” setting. The second “on” switch determines the “medium speed blower” setting, and the third “on” switch determines the “high speed blower” setting, (see the ECM2.3 Blower Table in the Blower Performance Data section).

Lockout Conditions

During lockout mode, the appropriate unit and thermostat lockout LEDs will illuminate. The compressor, loop pump, hot water pump, and accessory outputs are de-energized. Unless the lockout is caused by an ECM2.3 low RPM fault, the blower will continue to run on low speed. If the thermostat calls for heating, emergency heat operation will occur.

Comfort Alert lockouts cannot be reset at the thermostat. All other lockout modes can be reset at the thermostat after turning the unit off, then on, which restores normal operation but keeps the unit lockout LED illuminated. Interruption of power to the unit will reset a lockout without a waiting period and clear all lockout LEDs.

High Pressure

This lockout mode occurs when the normally closed safety switch is opened momentarily (set at 600 PSI).

Low Pressure

This lockout mode occurs when the normally closed low pressure switch is opened for 30 continuous seconds (set at 40 PSI). A low pressure fault may also be indicated when a Comfort Alert lockout has occurred.

Freeze Sensing (Water Flow)

This lockout mode occurs when the freeze thermistor temperature is at or below the selected freeze sensing point (well 30°F or loop 15°F) for 30 continuous seconds.

Condensate Overflow

This lockout mode occurs when the condensate overflow level has been reached for 30 continuous seconds.

Blower RPM

The control board monitors blower RPM to sense operation. This lockout mode occurs if the blower RPM falls below the low RPM limit (100 RPM) for 30 continuous seconds.

Microprocessor Control cont.

Compressor Monitoring/Comfort Alert

The Comfort Alert displays abnormal compressor conditions through a unique flash code and communicates the conditions to the heat pump microprocessor control. The heat pump microprocessor will determine which fault to act on and ignore. Fault codes 4 (locked rotor), 6 (open start circuit), and 7 (open run circuit) will result in a lockout. All other fault codes are passive. All compressor alerts are displayed on the module by flashing the yellow Alert LED a specific number of times consecutively followed by a pause, and then repeated. The number of consecutive flashes or "Flash Code" correlates to a specific abnormal condition. The red "TRIP" LED means there is a thermostat demand signal "Y" present but the compressor is not running. The green "POWER" LED means the module has power.

Green "POWER" LED - module has power

Red "TRIP" LED - Thermostat "Y" demand signal is present, but the compressor is not running.

Comfort Alert Flash Codes		
Yellow "ALERT" LED	LED Description	Cause
Flash Code 1	Long Run Time	Not applicable
Flash Code 2	System Pressure Trip	Not applicable
Flash Code 3	Short Cycling	Compressor run time of less than 3 minutes on 4 consecutive cycles
Flash Code 4	Locked Rotor	Four consecutive compressor protector trips indicating compressor won't start
Flash Code 5	Open Circuit	"Y" thermostat demand signal with no compressor current
Flash Code 6	Open Start Circuit	"Y" thermostat demand signal with no current in the start circuit
Flash Code 7	Open Run Circuit	"Y" thermostat demand signal with no current in the run circuit
Flash Code 8	Welded Contactor	Current detected with no "Y" thermostat demand signal present
Flash Code 9	Low Voltage	Less than 17 VAC detected in control circuit

* Flash code number corresponds to a number of LED flashes, followed by a pause and then repeated.

* TRIP and ALERT LEDs flashing at the same time indicates control circuit voltage is too low for operation.

* Reset ALERT flash code by removing 24 VAC power from module.

* Last ALERT flash code is displayed for 1 minute after module is powered on.

Resetting Comfort Alert Codes

Alert codes can be reset manually by cycling power off and on to the Comfort Alert module. Alert codes will reset automatically if conditions return to normal.

Flash Code Number	LED Description	Automatic Reset of Alert Codes
Flash Code 1	Long Run Time	Not applicable
Flash Code 2	System Pressure Trip	Not applicable
Flash Code 3	Short Cycling	Four "alert free" on and off cycles to reset automatically
Flash Code 4	Locked Rotor	Four "alert free" on and off cycles to reset automatically
Flash Code 5	Open Circuit	One "alert free" on and off cycles to reset automatically
Flash Code 6	Open Start Circuit	One "alert free" on and off cycles to reset automatically
Flash Code 7	Open Run Circuit	One "alert free" on and off cycles to reset automatically
Flash Code 8	Welded Contactor	One "alert free" on and off cycles to reset automatically
Flash Code 9	Low Voltage	Resets when voltage rises above 19 VAC

* Reset ALERT flash code by removing 24 VAC power from module.

Microprocessor Control cont.

Thermostat Displays

When using a fault monitor thermostat and SW2-8 is in the pulsing "L" position (off), the system monitor will enable a user to view the thermostat and count the fault indicator flashes to determine the lockout condition the unit is experiencing.

When using an A/TCONT802 or 803 thermostat and SW2-8 is in the pulsing "L" position (off), the system monitor will enable the user to view the thermostat and determine the fault. SW2-8 in the "on" position will send a constant signal to the fault indicator in the event of a system lockout condition. The LED board on the front of the unit will display all lockouts. The Low Pressure LED will flash for a low pressure condition or a Comfort Alert fault. If the low pressure lockout was caused by Comfort Alert codes 4, 6 or 7, then the Comfort Alert will be flashing. If no Comfort Alert code is visible, then it is a low pressure lockout.

The following table shows the codes that will be displayed when the System Monitor (L) is connected to the F terminal of an A/TCONT802 or 803 Comfort Control.

A/TCONT802 or 803 Thermostats	
Thermostat Display Lockout Code	Lockout Description
2 Flashes	High Pressure Fault
3 Flashes	Low Pressure Fault
4 Flashes	Not Applicable
5 Flashes	Water Flow Fault
6 Flashes	Not Applicable
7 Flashes	Condensate Fault
8 Flashes	Voltage out of Range
9 Flashes	RPM Fault
10 Flashes	Comfort Alert Compressor Module Fault

Lockout code 10 - see Comfort Alert module to determine the specific flash code for compressor abnormalities.

Operation Logic Data Table

OPERATION LOGIC	HEATING				COOLING		BLOWER ON	SL1 - IN ON
	STG1	STG2	STG3	EMERG	STG1	STG2		
Single Stage UNITS								
Compressor	On	On	On	Off	On	On	-	-
ECM2.3 Normal	Med	High	High	High	Med	High	Low	-
ECM2.3 Dehumidify	Med	High	High	High	85% Med	85% High	Low	-
PSC	On	On	On	On	On	On	On	-
Rev Valve	Off	Off	Off	Off	On	On	-	-
Loop Pump	On	On	On	Off	On	On	-	On
DHW Pump	On	Off	Off	Off	On	On	-	-
Aux Heater	Off	Off	Staged	Staged	Off	Off	-	-
Secondary 1- Out	On	On	On	Off	On	On	-	-
Emerg LED	Off	Off	Off	On	Off	Off	Off	-
T-Stat Signal	Y1	Y1, Y2	Y1, Y2, W	W	Y1, O	Y1, Y2, O	G	-
Dual Stage UNITS								
Compressor-Lo	On	Off	Off	Off	On	Off	-	-
Compressor-Hi	Off	On	On	Off	Off	On	-	-
ECM2.3 Normal	Med	High	High	High	Med	High	Low	-
ECM2.3 Dehumidify	Med	High	High	High	85% Med	85% High	Low	-
Rev Valve	Off	Off	Off	Off	On	On	-	-
Loop Pumps	On	On	On	Off	On	On	-	On
DHW Pump	On	On	Off	Off	On	On	-	-
Aux Heater	Off	Off	Staged	Staged	Off	Off	-	-
Secondary 1- Out	On	On	On	Off	On	On	-	-
Secondary 2- Out	Off	On	On	Off	Off	On	-	-
Emerg LED	Off	Off	Off	On	Off	Off	-	-
T-Stat Signal	Y1	Y1, Y2	Y1, Y2, W	W	Y1, O	Y1, Y2, O	G	-

Pressure Drop Single Stage Models

Model	GPM	Pressure Drop (psi)				
		30°F	50°F	70°F	90°F	110°F
022	3	0.9	0.9	0.8	0.7	0.7
	4.5	1.7	1.6	1.5	1.4	1.3
	6	2.8	2.7	2.5	2.3	2.2
	8	4.7	4.4	4.1	3.9	3.6
030	4	1.5	1.4	1.3	1.2	1.1
	6	3.0	2.8	2.7	2.5	2.3
	8	5.1	4.8	4.5	4.2	3.9
036	10	7.7	7.2	6.8	6.3	5.8
	5	1.0	1.0	0.9	0.8	0.8
	7	2.1	1.9	1.8	1.7	1.6
	9	3.6	3.3	3.0	2.8	2.6
042	12	6.3	5.9	5.5	5.1	4.8
	5	0.8	0.7	0.7	0.7	0.6
	8	2.1	2.1	1.9	1.8	1.7
048	11	4.2	4.1	3.8	3.5	3.3
	14	7.6	6.7	6.3	5.8	5.4
	6	1.1	1.0	1.0	0.9	0.8
060	9	2.4	2.2	2.1	2.0	1.8
	12	3.9	3.6	3.4	3.2	2.9
	15	5.7	5.3	5.0	4.7	4.3
070	20	9.5	8.9	8.3	7.8	7.2
	12	3.0	2.8	2.6	2.4	2.2
	15	4.4	4.0	3.8	3.5	3.3
	18	6.0	5.5	5.1	4.8	4.4
	24	9.7	9.1	8.5	7.9	7.3

5/25/07

Dual Stage Models

Model	GPM	Pressure Drop (psi)				
		30°F	50°F	70°F	90°F	110°F
026 full load	4	1.4	1.3	1.2	1.1	1.0
	6	2.8	2.6	2.4	2.3	2.1
	8	4.7	4.4	4.1	3.8	3.5
	10	7.0	6.6	6.2	5.8	5.3
026 part load	3	0.8	0.7	0.7	0.7	0.6
	5	2.0	1.8	1.7	1.6	1.5
	7	3.6	3.4	3.2	3.0	2.8
038 full load	9	5.8	5.5	5.1	4.8	4.4
	5	1.2	1.2	1.1	1.0	1.0
	7	2.2	2.1	1.9	1.8	1.7
	9	3.4	3.2	3.0	2.8	2.6
038 part load	11	4.9	4.6	4.3	4	3.7
	4	0.9	0.8	0.8	0.7	0.7
	6	1.7	1.6	1.5	1.4	1.3
049 full load	8	2.8	2.6	2.5	2.3	2.1
	10	4.2	3.9	3.7	3.4	3.2
	6	1.2	1.2	1.1	1.0	1.0
049 part load	9	2.4	2.2	2.1	2.0	1.8
	12	3.9	3.6	3.4	3.2	2.9
	15	5.7	5.3	5	4.7	4.3
	5	0.9	0.9	0.8	0.8	0.7
064 full load	8	2.0	1.8	1.7	1.6	1.5
	11	3.4	3.1	2.9	2.8	2.5
	14	5.0	4.7	4.4	4.1	3.8
064 part load	8	1.8	1.7	1.6	1.4	1.3
	12	3.8	3.5	3.3	3.0	2.8
	16	6.5	6.0	5.6	5.2	4.8
	20	9.7	9.1	8.5	8.0	7.4
072 full load	6	1.0	0.9	0.9	0.8	0.8
	10	2.6	2.5	2.3	2.1	2.0
	14	5.0	4.7	4.4	4.1	3.8
072 part load	18	8.1	7.6	7.1	6.6	6.1
	12	3.2	3.0	2.8	2.6	2.4
	15	4.5	4.2	4.0	3.7	3.4
	18	6.0	5.7	5.3	4.9	4.6
	21	7.8	7.3	6.8	6.4	5.9
	10	2.3	2.1	2.0	1.9	1.7
	13	3.6	3.3	3.0	2.8	2.6
	16	5.0	4.6	4.3	4.0	3.7
	19	6.5	6.2	5.8	5.4	5.0

5/30/06

Engineering Guide Specifications

General

Furnish and install Water Source Heat Pumps, as indicated on the plans. Equipment shall be completely assembled, piped and internally wired. Capacities and characteristics as listed in the schedule and the specifications that follow. The reverse cycle heating/cooling units shall be either suspended type with horizontal air inlet and discharge or floor mounted type with horizontal air inlet and vertical upflow, downflow, or rear air discharge. Units shall be AHRI/ISO 13256-1 certified and listed by a nationally recognized safety-testing laboratory or agency, such as ETL Testing Laboratory. Each unit shall be computer run-tested at the factory with conditioned water and operation verified to catalog data. Each unit shall be mounted on a pallet and shipped in a corrugated box or stretch-wrapped. The units shall be designed to operate with entering liquid temperature between 20°F and 120°F [-6.7°C and 48.9°C].

Casing and Cabinet

The cabinet shall be fabricated from heavy-gauge galvanized steel and finished with corrosion-resistant powder coating. This corrosion protection system shall meet the stringent 1000 hour salt spray test per ASTM B117. The interior shall be insulated with 1/2-inch thick, multi-density, cleanable aluminum foil coated glass fiber with edges sealed or tucked under flanges to prevent the introduction of glass fibers into the discharge air. Standard cabinet panel insulation must meet NFPA 90A requirements, air erosion and mold growth limits of UL-181, stringent fungal resistance test per ASTM-C1071 and ASTM G21, and shall meet zero level bacteria growth per ASTM G22. Unit insulation must meet these stringent requirements or unit(s) will not be accepted.

One (horizontal) or two (vertical) blower and three compressor compartment access panels shall be 'lift-out' removable with supply and return ductwork in place. The internal component layout shall provide for service access from the front side for restricted installations.

A duct collar shall be provided on the supply air opening. Standard size 2 in. [5.1 cm] MERV 11 pleated filters shall be provided with each unit. Vertical units shall have a return air filter rack/duct collar; the horizontal units shall have a filter bracket, each field convertible from 1 in. [2.5 cm] to 2 in. [5.1 cm]. The upflow vertical units shall have a removable insulated divider panel between the air handling section and the compressor section to minimize the transmission of compressor noise and to permit operational service testing without air bypass. Vertical units shall be supplied with left or right horizontal air inlet and top, bottom, or rear vertical air discharge. Horizontal units shall be supplied with left or right air inlet and side or end air discharge.

The compressor shall be double isolation mounted using selected durometer grommets to provide vibration free compressor mounting.

The drain pan shall be of plastic construction to inhibit corrosion and bacterial growth. Drain outlet shall be located on pan as to allow complete and unobstructed drainage of condensate. The unit as standard will be supplied with solid-state electronic condensate overflow protection. Mechanical float switches WILL NOT be accepted. Vertical units shall be furnished with a PVC slip condensate drain connection and an internal factory installed condensate trap.

Refrigerant Circuit

All units shall contain a sealed refrigerant circuit including a hermetic motor-compressor, bidirectional thermostatic expansion valve, finned tube air-to-refrigerant heat exchanger, reversing valve, coaxial tube water-to-refrigerant heat exchanger, optional hot water generator coil, and service ports.

Compressors shall be high-efficiency Single Stage scroll, or Dual Stage scroll type designed for heat pump duty and mounted on vibration isolators. Compressor motors shall be single-phase PSC with overload protection. The electro-coated coil shall be sized for low-face velocity and constructed of lanced aluminum fins bonded to rifled copper tubes in a staggered pattern not less than three rows deep for enhanced performance.

The coaxial water-to-refrigerant heat exchanger shall be designed for low water pressure drop and constructed of a convoluted copper (cupronickel option) inner tube and a steel outer tube. Refrigerant to air heat exchangers shall utilize enhanced corrugated lanced aluminum fins and rifled copper tube construction rated to withstand 600 PSIG (4135 kPa) refrigerant working pressure. Refrigerant to water heat exchangers shall be of copper inner water tube and steel refrigerant outer tube design, rated to withstand 600 PSIG (4135 kPa) working refrigerant pressure and 450 PSIG (3101 kPa) working water pressure. The thermostatic expansion valve shall provide proper superheat over the entire liquid temperature range with minimal "hunting." The valve shall operate bidirectionally without the use of check valves.

The water-to-refrigerant heat exchanger, optional hot water generator coil and refrigerant suction lines shall be insulated to prevent condensation at low liquid temperatures.

Blower Motor and Assembly

The blower shall be a direct drive centrifugal type with a dynamically balanced wheel. The housing and wheel shall be designed for quiet low outlet velocity operation. The blower housing shall be removable from the unit without disconnecting the supply air ductwork for servicing of the blower motor. The blower motor shall be a three-speed PSC or variable-speed ECM2.3 type. The ECM2.3 blower motor shall be soft starting, shall maintain constant CFM over its operating static range, and shall provide 12 CFM settings. The blower motor shall be isolated from the housing by rubber grommets. The motor shall be permanently lubricated and have thermostatic overload protection. ECM2.3 motors shall be long-life ball bearing type.

Engineering Guide Specifications cont.

Electrical

A control box shall be located within the unit compressor compartment and shall contain a 75VA transformer, 24 Volt activated, 2 pole compressor contactor, terminal block for thermostat wiring and solid-state controller for complete unit operation. Electromechanical operation WILL NOT be accepted. Units shall be name-plated for use with time delay fuses or HACR circuit breakers. Unit controls shall be 24 Volt and provide heating or cooling as required by the remote thermostat/sensor. A microprocessor-based controller that interfaces with a multi-stage electronic thermostat to monitor and control unit operation shall be provided. The control shall provide operational sequencing, blower speed control, blower failure, high and low pressure switch monitoring, freeze sensing, hot water limit thermistor sensing, condensate overflow sensing, auxiliary heat staging, lockout mode control, hot water and loop pump control, LED status and fault indicators, fault memory, field selectable options, and accessory output. An integrally mounted ComfortAlert compressor sensing module shall provide monitoring for open start, open run, locked rotor, welded contactor and short cycle conditions.

A detachable terminal block with screw terminals will be provided for field control wiring. All units shall have knockouts for entrance of low and line voltage wiring. The blower motor and control box shall be harness plug wired for easy removal.

Optional GeoStart (Compressor Soft Starter) - shall be factory installed for use in applications that require low starting amps, reduced compressor start-up noise, off-grid, and improved start-up behavior. GeoStart shall reduce normal starting current by 60% on 208/60/1 units.

Piping

Supply and return water connections shall be 1 in. [25.4 mm] FPT brass swivel fittings, which provide a union and eliminate the need for pipe wrenches and sealants when making field connections. The optional hot water generator connections shall be 1/2 in. [12.7 mm] female sweat type. All water piping shall be insulated to prevent condensation at low liquid temperatures, on the vertical upflow units, the condensate connection shall be a 3/4 in. [19.1 mm] PVC socket with internally-trapped hose that can be routed to front or side locations.

Hanger Kit (field-installed horizontal units only)

The hanger kit shall consist of galvanized steel brackets, bolts, lock washers, and isolators and shall be designed to fasten to the unit bottom panel for suspension from 3/8 in. threaded rods. Unit sizes 022-030 shall include four brackets. Unit sizes 036-072 shall include six brackets.

Options and Accessories Cupronickel Heat Exchanger

An optional cupronickel water-to-refrigerant heat exchanger shall be provided.

Hot Water Generator

An optional heat reclaiming hot water generator coil of vented double-wall copper construction suitable for potable water shall be provided. The coil and hot water circulating pump shall be factory mounted inside the unit with integral electronic high limit temperature monitoring and external on/off switch.

Thermostat (field-installed)

A multi-stage auto-changeover electronic digital thermostat shall be provided. The thermostat shall offer three heating and two cooling stages with precise temperature control. An OFF-HEAT-AUTO-COOL-EMERG system switch, OFF-AUTO blower switch, and indicating LEDs shall be provided. The thermostat shall display in °F or °C.

Earth Loop Flow Center (field-installed)

A self-contained module shall provide all liquid flow, fill and connection requirements for ground source closed loop systems up to 20 GPM. The pumps shall be wired to a power block located in the nearest unit. The heat pump units shall contain low voltage pump slaving control so that two units may share one flow center.

Auxiliary Heater (field-installed)

An electric resistance heater shall provide supplemental and/or emergency heating capability. Vertical units shall have the control and resistance heater coil assembly mounted internally. For horizontal units, the control panel shall be mounted internally while the resistance heater coil assembly shall be mounted externally. A low voltage plug shall be provided in each unit for quick auxiliary heat connection. The heater shall operate in sequenced stages as controlled by the unit's microprocessor. The heater shall feed line voltage power to the unit blower and transformer to provide emergency heat capability in the event of an open compressor circuit breaker.



TRANE®

Trane
www.trane.com



04/11

Trane has a policy of continuous product and product data improvement and it reserves the right to change design and specifications without notice.