

### PACKAGED HEAT PUMP ROOFTOP UNITS WITH X-VANE™ FAN TECHNOLOGY WITH OPTIONAL ELECTRIC HEAT (RHV) 15-25 TONS

The 15 to 25 ton RHV181-300 packaged heat pump rooftop units (RTU) with X-Vane Fan Technology were designed by customers to provide value added benefits never seen in this type of equipment before.

New feature include:

- A patented - industry first - Vane Axial Indoor Fan System, powered by an electronically commutated motor for quiet, efficient, and reliable operation. Compared to traditional belt driven forwards curved fans, this system has:
  - 75% fewer moving parts
  - No fan belts, pulleys, shaft, and shaft bearings
  - Up to 40% better efficiency than traditional belt drive forward curve fans
  - Slow ramp up capability for better sound and comfort control
  - Internal protection from phase reversal and phase loss situations
  - High external static capability
  - Slide out blower assembly design
- Reliable 2 stage cooling with tandem scroll compressors technology, fully active evaporator coil, and mixed air temperature protection on all models
- New unit control board with intuitive indoor fan adjustment that uses simple dial and switch adjustments
- An industry first 25 ton packaged heat pump
- Reliable copper tube/aluminum fin condenser coil with 5/16 in. tubing to help reduce refrigerant charge and reduce weight versus prior designs

RHV units up to 25 tons are specifically designed for dedicated factory-supplied vertical air flow or horizontal air flow. No special field kits are required. All footprints were maintained to easily fit on our R-410A and select competitor curbs, making replacements easier than ever.

With “no-strip” screw collars, handled access panels, and more, the unit is easy to install, easy to maintain, and easy to use.

Our 2-Speed Indoor Fan Motor System through our Vane Axial fan allows our 15 to 25 ton RHV units to deliver IEER values up to 14.0 and provide optimum comfort and control from a packaged rooftop.

#### Installation ease

Lighter units make for easy replacement and aid in the structural approval process. Units have simple, fast plug-in connections to the standard integrated unit control board (UCB). Clearly labeled connections points to reduce installation time. Also, a large control box provides room to work.

#### Easy to maintain

With the new X-Vane Fan Vane Axial fan system and direct drive ECM motor, there is no longer a need to adjust or replace belts or pulleys as in past designs. This frees up maintenance, installation and commissioning time.

Easy access handles provide quick and easy access to all normally serviced components. Our “no-strip” screw system has superior holding power and guides screws into position while preventing the screw from stripping the unit’s metal.

Sloped, corrosion resistant composite drain pan sheds water and won’t rust.



RHV181

## X-Vane™ Fan

# Table of contents

	Page
Features/Benefits . . . . .	1
Model number nomenclature . . . . .	3
Capacity ratings . . . . .	4
Physical data . . . . .	6
Options and accessories . . . . .	7
Base unit dimensions . . . . .	11
Accessory dimensions . . . . .	22
Performance data . . . . .	23
Fan data . . . . .	32
Electrical data . . . . .	42
Typical wiring diagrams . . . . .	53
Sequence of operation . . . . .	56
Application data . . . . .	58
Guide specifications . . . . .	59

## Easy to use

The newly re-designed Unit Control Board puts all connections and troubleshooting points in one convenient place. Most low voltage connections are made to the same board and make it easy to access it. Setting up the fan is simple by an intuitive switch and rotary dial arrangement. RHV rooftops have high and low pressure switches, a new mixed air temperature switch, a filter drier, and 2-in. filters standard.

RHV rooftops have high and low pressure switches, a new mixed air temperature switch, a filter drier, and 2-in. filters standard.

## X-Vane Fan Technology

Direct drive X-Vane Fan Technology indoor fan system uses Vane Axial fan design and electrically commutated motors.

This new Vane Axial design over past belt drive systems has 75% fewer moving parts, uses up to 40% less energy and has no fan belts, blower bearings and shaft. Full fan and motor assembly also slides out for easier maintenance and service.

# Features/Benefits

## Value-added features include:

- Single point electrical connections
- 15 to 25 ton models use TXV refrigerant metering devices
- Scroll compressors with internal line-break overload protection
- Units come with an easy access tool-less filter door. Filter track tilts out for filter removal and replacement. All filters are the same size in each unit

## Operating efficiency and flexibility

These RHV packaged rooftops meet the Department of Energy (DOE) 2023 efficiency standard, as well as the latest ASHRAE (American Society of Heating, Refrigerating, and Air-Conditioning Engineers) 90.1 and IECC (International Energy Conservation Code) minimum IEER<sup>1</sup> efficiency requirements.

---

1. Third-party trademarks and logos are the property of their respective owners.

# Model number nomenclature

<b>MODEL SERIES</b>	<b>R</b>	<b>H</b>	<b>V</b>	<b>1</b>	<b>8</b>	<b>1</b>	<b>L</b>	<b>0</b>	<b>2</b>	<b>A</b>	<b>0</b>	<b>A</b>	<b>A</b>	<b>A</b>
<b>Position Number</b>	<b>1</b>	<b>2</b>	<b>3</b>	<b>4</b>	<b>5</b>	<b>6</b>	<b>7</b>	<b>8</b>	<b>9</b>	<b>10</b>	<b>11</b>	<b>12</b>	<b>13</b>	<b>14</b>
R = Rooftop														
H = Heat Pump with Electric Heat		<b>Type</b>												
V = R-410A with X-Vane™ Fan		<b>Standard Efficiency</b>												
181 = 181,000 BTUH = 15 Tons 240 = 240,000 BTUH = 20 Tons 300 = 300,000 BTUH = 25 Tons				<b>Nominal Cooling Capacity</b>										
H = 208/230-3-60 L = 460-3-60 S = 575-3-60							<b>Voltage</b>							
0 = No Heat (Field-Installed Only)											<b>Electric Heating Capacity</b>			
2 = Standard/Medium Static X-Vane Fan — Vertical Supply 3 = High Static X-Vane Fan — Vertical Supply 5 = Standard/Medium Static X-Vane Fan and Filter Status Switch — Vertical Supply 6 = High Static X-Vane Fan and Filter Status Switch — Vertical Supply J = High Static X-Vane Fan — Horizontal Supply L = High Static X-Vane Fan and Filter Status Switch — Horizontal Supply							<b>Motor Option (Indoor Fan)</b>							
A = None B = Low Leak Economizer with Barometric relief, OA Temp sensor E = Low Leak Economizer with Barometric relief + CO <sub>2</sub> sensor, OA Temp sensor H = Low Leak Economizer with Barometric relief L = Economizer with Barometric relief + CO <sub>2</sub> sensor, Enthalpy sensor U = Ultra Low Leak Economizer with Barometric relief, OA Temp sensor W = Ultra Low Leak Economizer with Barometric relief, Enthalpy sensor										<b>Outdoor Air Options / Control</b>				
0A = Standard 4B = Non Fused Disconnect Switch AA = Hinged Access Panels AT = Un-Powered Convenience Outlet BB = Powered Convenience Outlet BP = Return Air Smoke Detector BR = Supply Air Smoke Detector CJ = Condensate Overflow Switch													<b>Factory-Installed Options<sup>1</sup></b>	
A = Aluminum / Copper Cond and Evap Coil B = Precoat Alum/Copper Cond with Alum / Copper Evap C = E-Coated Alum/Copper Cond with Alum / Copper Evap D = E-Coated Alum / Copper Cond and Evap E = Copper/Copper Cond and Alum/Copper Evap F = Copper/Copper Cond and Evap													<b>Condenser / Evaporator Coil Configuration</b>	
A = Economizer controls for EconoMiSer® IV and others (except for Factory-Installed EconoMiSer X) B = Economizer controls for Factory-Installed EconoMiSer X													<b>Economizer Control</b>	

<sup>1</sup> Combinations of factory-installed options are available, contact your representative for details.

# Capacity ratings

## RHV AHRI Ratings, Cooling Mode<sup>a,b,c</sup>

UNIT	Cooling Stages	Nominal Capacity (tons)	Net Cooling Capacity (Btuh)	Total Power (kW)	EER	IEER with 2-Speed Indoor Fan Motor	AHRI Rating cfm
RHV181	2	15	172,000	16.2	10.6	14.0	6300
RHV240	2	20	240,000	24.5	9.8	14.0	8000
RHV300	2	25	278,000	29.3	9.5	14.0	10,000

**NOTE(S):**

- a. Rated in accordance with AHRI Standards 340/360.
- b. Rating are based on:  
**Cooling Standard:** 80°F (27°C) db, 67°F (19°C) wb indoor air temperature and 95°F (35°C) db outdoor air temperature.  
**IEER Standard:** A measure that expresses cooling part-load EER efficiency for commercial unitary air-conditioning and heat pump equipment on the basis of weighted operation at various load capacities.
- c. All RHV units comply with ASHRAE 90.1-2019 (American Society of Heating, Refrigerating, and Air-Conditioning Engineers) and DOE-2023 (Department of Energy) Energy Standard for minimum IEER requirements.

**LEGEND**

- AHRI** — Air-Conditioning, Heating and Refrigeration Institute
- EER** — Energy Efficiency Ratio
- IEER** — Integrated Energy Efficiency Ratio



## RHV AHRI Ratings, Heating Mode<sup>a,b,c</sup>

UNIT	Heating, Low 17°F(-8°C) Ambient		Heating, High 47°F (8°C) Ambient		AHRI Rating cfm
	Net Capacity (Btuh)	COP	Net Capacity (Btuh)	COP	
RHV181	106,000	2.30	168,000	3.30	6300
RHV240	136,000	2.30	234,000	3.30	8000
RHV300	158,000	2.30	274,000	3.30	9500

**NOTE(S):**

- a. Rated in accordance with AHRI Standards 340/360.
- b. Rating are based on:  
**Cooling Standard:** 80°F (27°C) db, 67°F (19°C) wb indoor air temperature and 95°F (35°C) db outdoor air temperature.  
**IEER Standard:** A measure that expresses cooling part-load EER efficiency for commercial unitary air-conditioning and heat pump equipment on the basis of weighted operation at various load capacities.
- c. All RHV units comply with ASHRAE 90.1-2019 (American Society of Heating, Refrigerating, and Air-Conditioning Engineers) and DOE-2023 (Department of Energy) Energy Standard for minimum IEER requirements.

**LEGEND**

- AHRI** — Air-Conditioning, Heating and Refrigeration Institute
- COP** — Coefficient of Performance



# Capacity ratings (cont)

Sound Rating Table<sup>a</sup>

UNIT	COOLING STAGES	OUTDOOR SOUND (dB) AT 60Hz <sup>b</sup>								
		A-WEIGHTED <sup>c</sup>	63	125	250	500	1000	2000	4000	8000
RHV181	2	84.1	92.2	83.9	80.4	81.8	78.7	76.5	72.2	65.4
RHV240	2	85.9	97.1	88.3	84.4	83.3	80.7	77.4	73.4	67.3
RHV300	2	85.9	97.1	88.3	84.4	83.3	80.7	77.4	73.4	67.3

NOTE(S):

- Outdoor sound data is measured in accordance with AHRI.
- Measurements are expressed in terms of sound power. Do not compare these values to sound pressure values because sound pressure depends on specific environmental factors which normally do not match individual applications. Sound power values are independent of the environment and therefore more accurate.
- A-weighted sound ratings filter out very high and very low frequencies, to better approximate the response of "average" human ear. A-weighted measurements for RHV units are taken in accordance with AHRI.

LEGEND

**dB** — Decibel

Minimum - Maximum Airflow Ratings (cfm) — Cooling Units and Accessory Electric Heat

UNIT	COOLING			ELECTRIC HEAT <sup>a</sup>	
	MINIMUM 2-SPEED AIRFLOW (LOW SPEED)	MINIMUM 2-SPEED AIRFLOW (HIGH SPEED)	MAXIMUM AIRFLOW CFM	MINIMUM AIRFLOW CFM	MAXIMUM AIRFLOW CFM
RHV181	2700	4500	7500	4500	7500
RHV240	3000	6000	10,000	6000	10,000
RHV300	3750	7500	12,500	7500	12,500

NOTE(S):

- Electric heat modules and single point kits are available as field-installed accessories for RHV units.

# Physical data

## RHV181-300 Physical Data

RHV UNIT	RHV181	RHV240	RHV300
<b>NOMINAL TONS</b>	15	20	25
<b>BASE UNIT OPERATING WT (lb)<sup>a</sup></b>	1627	2057	2125
<b>REFRIGERATION SYSTEM</b>			
<b>No. Circuits/No. Compressors/Type</b>	1/2/Scroll	1/2/Scroll	1/2/Scroll
<b>R-410A Charge (lb-oz)</b>	27-0	48-0	48-0
<b>Cooling Metering Device</b>	TXV	TXV	TXV
<b>Heating Metering Device</b>	TXV	TXV	TXV
<b>High-Pressure Trip/Reset (psig)</b>	630/505	630/505	630/505
<b>Loss of Charge Trip/Reset (psig)</b>	27/44	27/44	27/44
<b>EVAPORATOR COIL</b>			
<b>Material (Tube/Fin)</b>	Cu/Al	Cu/Al	Cu/Al
<b>Coil Type</b>	3/8-in. RTPF	3/8-in. RTPF	3/8-in. RTPF
<b>Rows/FPI</b>	4/15	4/15	4/15
<b>Total Face Area (ft<sup>2</sup>)</b>	22	26	26
<b>Condensate Drain Connection Size</b>	3/4-in.	3/4-in.	3/4-in.
<b>CONDENSER COIL</b>			
<b>Material (Tube/Fin)</b>	Cu/Al	Cu/Al	Cu/Al
<b>Coil Type</b>	5/16-in. RTPF	5/16-in. RTPF	5/16-in. RTPF
<b>Rows/FPI</b>	2/18	2/18	2/18
<b>Total Face Area (ft<sup>2</sup>)</b>	41.6	59.2	59.2
<b>EVAPORATOR FAN AND MOTOR</b>			
<b>Standard/Medium Static 3 Phase</b>			
<b>Motor Qty / Drive Type</b>	2 / Direct	2 / Direct	2 / Direct
<b>Max Cont bhp</b>	2.4	2.4	3
<b>Range (rpm)</b>	250-2000	250-2000	250-2200
<b>Fan Qty / Type</b>	2 / Vane Axial	2 / Vane Axial	2 / Vane Axial
<b>Fan Diameter (in.)</b>	22	22	22
<b>Vertical High Static 3 Phase</b>			
<b>Motor Qty / Drive Type</b>	2 / Direct	2 / Direct	2 / Direct
<b>Max Cont bhp</b>	3	5	5
<b>Range (rpm)</b>	250-2200	250-2200	250-2200
<b>Fan Qty / Type</b>	2 / Vane Axial	2 / Vane Axial	2 / Vane Axial
<b>Fan Diameter (in.)</b>	22	22	22
<b>Horizontal High Static 3 Phase</b>			
<b>Motor Qty / Drive Type</b>	2 / Direct	2 / Direct	2 / Direct
<b>Max Cont bhp</b>	5	5	5
<b>Range (rpm)</b>	250-2200	250-2200	250-2200
<b>Fan Qty / Type</b>	2 / Vane Axial	2 / Vane Axial	2 / Vane Axial
<b>Fan Diameter (in.)</b>	22	22	22
<b>CONDENSER FAN AND MOTOR</b>			
<b>Qty / Motor Drive Type</b>	3 / Direct	4 / Direct	4 / Direct
<b>Motor hp / rpm</b>	1/4 / 1100	1/4 / 1100	1/4 / 1100
<b>Fan Diameter (in.)</b>	22	22	22
<b>FILTERS</b>			
<b>RA Filter Qty / Size (in.)</b>	6 / 25x25x2	9 / 20x25x2	9 / 20x25x2
<b>OA Inlet Screen Qty / Size (in.)</b>	4 / 16x25x1	4 / 16x25/1	4 / 16x25/1

**NOTE(S):**

a. Base unit operating weight does not include weight of options.

**LEGEND**

**bhp** — Brake Horsepower  
**FPI** — Fins Per Inch  
**OA** — Outdoor Air  
**RA** — Return Air

# Options and accessories

ITEM	OPTION <sup>a</sup>	ACCESSORY <sup>b</sup>
<b>ELECTRIC HEAT</b>		
Electric Resistance Heaters		X
Single Point Kits		X
<b>CABINET</b>		
Hinged Access Panels	X	
4 in. Filter Rack (filters not included)		X
<b>COIL OPTIONS</b>		
Cu/Cu indoor and/or outdoor coils	X	
Pre-coated outdoor coils	X	
Premium, E-coated outdoor coils	X	
<b>CONTROLS</b>		
Thermostats, temperature sensors, and subbases		X
Smoke detector (supply and/or return air)	X	X
Horn Strobe Annunciator <sup>c</sup>		X
Time Guard II compressor delay control circuit		X
Phase Monitor	X	X
Condensate Overflow switch	X	X
<b>ECONOMIZERS AND OUTDOOR AIR DAMPERS</b>		
EconoMiSer <sup>®</sup> IV for electro-mechanical controls - Non FDD (Standard air leak damper models) <sup>d</sup>		X
EconoMiSer X for electro-mechanical controls, complies with FDD (Low and Ultra Low Leak damper models) <sup>d</sup>	X	X
Motorized 2-position outdoor-air damper		X
Manual outdoor-air damper (25% and 50%)		X
Barometric relief <sup>e</sup>	X	X
Power exhaust - centrifugal design	X	X

ITEM	OPTION <sup>a</sup>	ACCESSORY <sup>b</sup>
<b>ECONOMIZER SENSORS AND IAQ DEVICES</b>		
Single dry bulb temperature sensors <sup>f</sup>	X	X
Differential dry bulb temperature sensors <sup>f</sup>		X
Single enthalpy sensors <sup>f</sup>	X	X
Differential enthalpy sensors <sup>f</sup>		X
CO <sub>2</sub> sensor (wall, duct, or unit mounted) <sup>f</sup>	X	X
<b>INDOOR MOTOR AND DRIVE</b>		
Multiple motor and drive packages	X	
<b>LOW AMBIENT CONTROLS</b>		
Winter start kit <sup>g</sup>		X
Low Ambient controller to 0°F (-18°C) <sup>g</sup>		X
<b>POWER OPTIONS</b>		
Convenience outlet (powered)	X	
Convenience outlet (unpowered)	X	
Convenience outlet, 20 amp (unpowered)		X
Non-fused disconnect <sup>h</sup>	X	
<b>ROOF CURBS</b>		
Roof curb 14 in. (356 mm)		X
Roof curb 24 in. (610 mm)		X

**NOTE(S):**

- a. Factory-installed option.
- b. Field-installed accessory.
- c. Requires a field-supplied 24V transformer for each application.
- d. FDD (Fault Detection and Diagnostic) capability per California Title 24 section 120.2.
- e. Included with economizer.
- f. Sensors used to optimize economizer performance.
- g. See application data for assistance.
- h. Non-fused disconnect switch cannot be used when unit FLA electrical rating exceeds 200 amps (all voltages).

# Options and accessories (cont)

## Factory-installed options

### Economizer (dry-bulb or enthalpy)

Economizers save money. They bring in fresh, outside air for ventilation; and provide cool, outside air to cool your building. This is the preferred method of low-ambient cooling. When coupled to CO<sub>2</sub> sensors, economizers can provide even more savings by coupling the ventilation air to only that amount required.

Economizers are available, installed and tested by the factory, with either enthalpy or dry-bulb temperature inputs. Additional sensors are available as accessories to optimize the economizers. Economizers include a powered exhaust system to help equalize building pressures.

Economizers can be factory-installed or easily field-installed.

### Unit mounted CO<sub>2</sub> sensor

The CO<sub>2</sub> sensor works with the economizer to intake only the correct amount of outside air for ventilation. As occupants fill your building, the CO<sub>2</sub> sensor detects their presence through increasing CO<sub>2</sub> levels, and opens the economizer appropriately. When the occupants leave, the CO<sub>2</sub> levels decrease, and the sensor appropriately closes the economizer. This intelligent control of the ventilation air, called demand controlled ventilation (DCV), reduces the overall load on the rooftop, saving money. It is also available as a field-installed accessory.

### Smoke detector (supply and/or return air)

Smoke detectors make your application safer and your job easier. Our smoke detectors immediately shut down the rooftop unit when smoke is detected. They are available, installed by the factory, for supply air, return air, or both.

### Thru-the-base connections

Thru-the-base connections, included as standard, are necessary to ensure proper connection and seal when routing wire and piping through the rooftop's basepan and curb. These couplings eliminate roof penetration and should be considered for gas lines, main power lines, as well as control power.

### Hinged access panels

Allows access to unit's major components with specifically designed hinged access panels. Panels are filter, control box access, and indoor fan motor access.

### Cu/Cu (indoor) coils

Copper fins and copper tubes are mechanically bonded to copper tubes and copper tube sheets. A polymer strip prevents coil assembly from contacting the sheet metal coil pan to minimize potential for galvanic corrosion between coil and pan.

### E-coated (outdoor and indoor) coils

A flexible epoxy polymer coating uniformly applied to all coil surface areas without material bridging between fins.

Coating process shall ensure complete coil encapsulation of tubes, fins and headers.

### Pre-coated outdoor coils

A durable epoxy-phenolic coating to provide protection in mildly corrosive coastal environments. The coating minimizes galvanic action between dissimilar metals. Coating is applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube.

### Condenser coil hail guard

Sleek, louvered panels protect the condenser coil from hail damage, foreign objects, and incidental contact.

### Convenience outlet (powered or un-powered)

Reduce service and/or installation costs by including a convenience outlet in your specification. We will install this service feature at our factory. Provides a convenient, 15 amp, 115v GFCI receptacle with "Wet in Use" cover. The "powered" option allows the installer to power the outlet from the line side of the disconnect or load side as required by code. The "unpowered" option is to be powered from a separate 115/120v power source.

The unpowered convenience outlet is available as a 15 amp factory-installed option or a 20 amp field-installed accessory.

### Non-fused disconnect

This OSHA-compliant, factory-installed, safety switch allows a service technician to locally secure power to the rooftop. When selecting a factory-installed non-fused disconnect, note they are sized for the unit as ordered from the factory. The sizing of these do not accommodate field-installed items such as power exhaust devices, etc. If field installing electric heat with factory-installed nonfused disconnect switch, a single point kit may or may not be required.

### Condensate overflow switch

This sensor and related controller monitors the condensate level in the drain pan and shuts down compression operation when overflow conditions occur. It includes:

- Indicator light – solid red (more than 10 seconds on water contact – compressors disabled), blinking red (sensor disconnected)
- 10-second delay to break – eliminates nuisance trips from splashing or waves in pan (sensor needs 10 seconds of constant water contact before tripping)
- Disables the compressors operation when condensate plug is detected, but still allows fans to run for economizer.

### Filter maintenance indicator

When the optional factory-installed filter maintenance indicator is used, a factory-installed differential pressure switch measures pressure drop across the outside air filter and activates a field-supplied dry contact indicator when the pressure differential exceeds the adjustable switch setpoint.

# Options and accessories (cont)

## Field-installed accessories

### Condenser coil hail guard

Sleek, louvered panels protect the condenser coil from hail damage, foreign objects, and incidental contact. This can be purchased as a factory-installed option or as a field-installed accessory.

### Differential enthalpy sensor

The differential enthalpy sensor is comprised of an outdoor and return air enthalpy sensors to provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.

### Wall or duct mounted CO<sub>2</sub> sensor

The IAQ sensor shall be available in duct or wall mount. The sensor provides demand ventilation indoor air quality (IAQ) control.

### 4 in. filter rack kit

The 4 in. filter rack accessory kit is designed to hold 4 in. MERV-8 or MERV-13 filters. Filters not included in kit.

### Phase monitor protection

The Phase Monitor Control will monitor the sequence of three phase electrical system to provide a phase reversal protection; and monitor the three phase voltage inputs to provide a phase loss protection for the three phase device. It will work on either a Delta or Wye power connection.

### Winter start kit

The winter start kit extends the low ambient limit of your rooftop to 25°F (−4°C). The kit bypasses the low pressure switch, preventing nuisance tripping of the low pressure switch. Other low ambient precautions may still be prudent.

### Low ambient controller

The low ambient controller is a head pressure controller kit that is designed to maintain the unit's condenser head pressure during periods of low ambient cooling operation. This device should be used as an alternative to

economizer free cooling when economizer usage is either not appropriate or desired. The low ambient controller will either cycle the outdoor fan motors or operate them at reduced speed to maintain the unit operation, depending on the model. This controller allows cooling operation down to 0°F (−18°C) ambient conditions.

### Roof curb (14 in./356 mm or 24 in./610 mm)

Full perimeter roof curb with exhaust capability provides separate air streams for energy recovery from the exhaust air without supply air contamination.

### Filter status indicator accessory

Monitors static pressure across supply and exhaust filters and provides indication when filters become clogged.

### Power exhaust

Superior internal building pressure control. This field-installed accessory may eliminate the need for costly, external pressure control fans.

### Manual OA damper

Manual outdoor air dampers are an economical way to bring in ventilation air. The dampers are available in 25% and 50% versions.

### Motorized 2-Position damper

The 2-position, motorized outdoor air damper admits up to 100% outside air. Using reliable, gear-driven technology, the 2-position damper opens to allow ventilation air and closes when the rooftop stops, stopping unwanted infiltration.

### Electric heaters

We offer a full-line of field-installed accessory heaters. The heaters are very easy to use, install and are all pre-engineered and certified.

### Time Guard II control circuit

This accessory protects your compressor by preventing short-cycling in the event of some other failure, prevents the compressor from restarting for 30 seconds after stopping.

# Options and accessories (cont)

Option and Accessory Weights<sup>a</sup>

OPTION / ACCESSORY NAME	RHV UNIT WEIGHT					
	181		240		300	
	lb	kg	lb	kg	lb	kg
Power Exhaust	198	90	198	90	198	90
EconoMiSer® (X or IV)	245	111	245	111	245	111
2-Position Damper	50	23	50	23	50	23
Manual Damper	35	16	35	16	35	16
Electric Heater	85	39	85	39	85	39
Hail Guard (louvered)	90	41	90	41	100	46
Cu/Cu Condenser and Evaporator Coils	305	139	448	204	448	204
Roof Curb (14 in. curb)	240	109	255	116	255	116
Roof Curb (24 in. curb)	340	154	355	161	355	161
CO <sub>2</sub> Sensor	5	3	5	3	5	3
Optional Indoor Motor <sup>b</sup>	30	14	30	14	0	0
Low Ambient Controller	9	4	9	4	9	4
Winter Start Kit	5	2	5	2	5	2
Return Air Smoke Detector	7	3	7	3	7	3
Supply Air Smoke Detector	7	3	7	3	7	3
Fan Filter Switch	2	1	2	1	2	1
Non-Fused Disconnect	15	7	15	7	15	7
Powered Convenience Outlet	36	16	36	16	36	16
Unpowered Convenience Outlet	4	2	4	2	4	2
Enthalpy Sensor	2	1	2	1	2	1
Differential Enthalpy Sensor	3	2	3	2	3	2

NOTE(S):

- a. Where multiple variations are available, the heaviest combination is listed.
- b. Add the Optional Indoor Motor weight to the weight of the base unit.

### RHV181 Base Unit Dimensions









THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

CONNECTION SIZES	
A	1 3/8" DIA [35] FIELD POWER SUPPLY KNOCKOUT
B	3" DIA [76] FIELD POWER SUPPLY KNOCKOUT
C	3 5/8" DIA [92] FIELD POWER SUPPLY KNOCKOUT
D	7/8" DIA [22] FIELD CONTROL WIRING HOLE
G	7/8" DIA [22] FIELD CONTROL WIRING KNOCKOUT

- NOTES:
1. DIMENSIONS ARE IN INCHES, DIMENSIONS IN [ ] ARE IN MILLIMETERS.
  2. CENTER OF GRAVITY
  3. DIRECTION OF AIR FLOW
  4. ALL VIEW DRAWN USING 3RD ANGLE

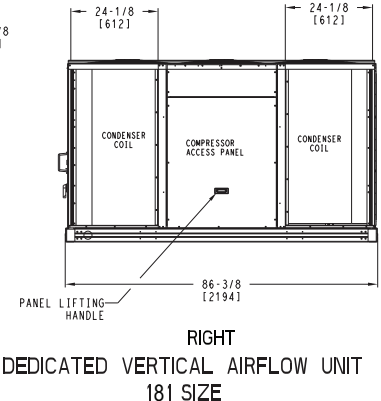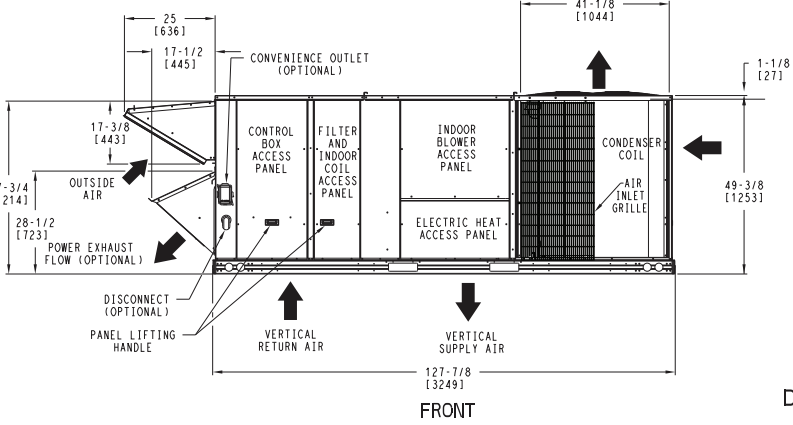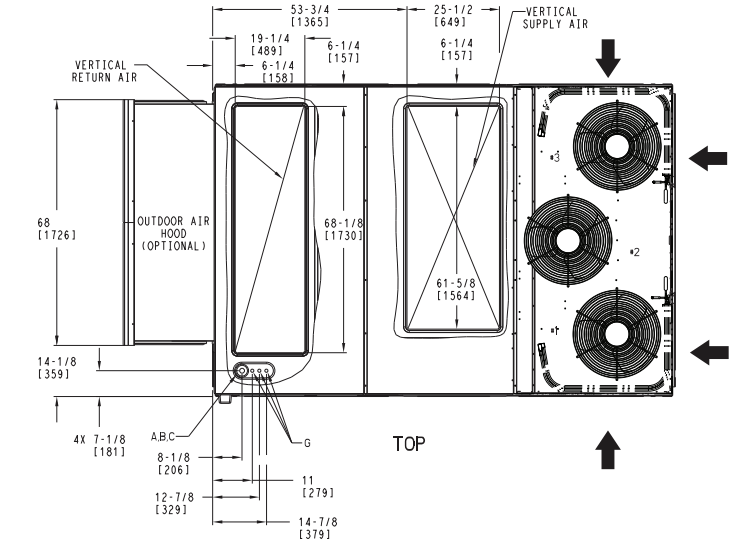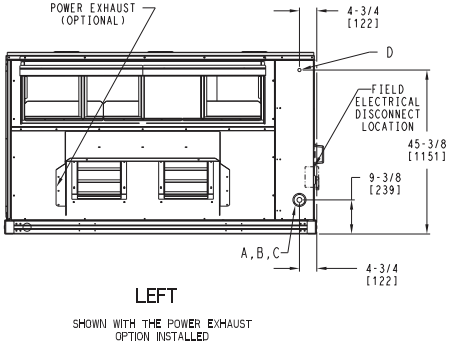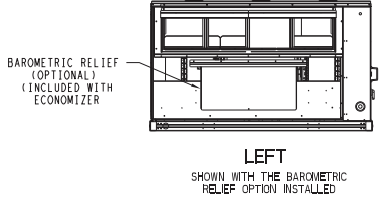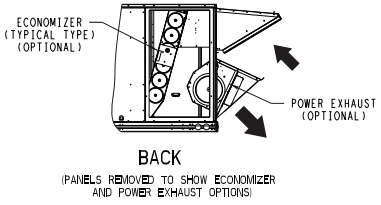

ITC CLASSIFICATION U.S. ECCN:NSR	SHEET 1 OF 5	DATE 8/29/22	SUPERCEDES -	RHV 181 SINGLE ZONE ELECTRICAL HEAT PUMP	50HE006193	REV -
-------------------------------------	-----------------	-----------------	-----------------	---	------------	----------

RHV181 Base Unit Dimensions (cont)








THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

CONNECTION SIZES	
A	1 3/8" DIA [35] FIELD POWER SUPPLY KNOCKOUT
B	3" DIA [76] FIELD POWER SUPPLY KNOCKOUT
C	3 5/8" DIA [92] FIELD POWER SUPPLY KNOCKOUT
D	7/8" DIA [22] FIELD CONTROL WIRING HOLE
G	7/8" DIA [22] FIELD CONTROL WIRING KNOCKOUT

NOTES:

1. DIMENSIONS ARE IN INCHES, DIMENSIONS IN [ ] ARE IN MILLIMETERS.
2. CENTER OF GRAVITY
3. DIRECTION OF AIR FLOW
4. ALL VIEW DRAWN USING 3RD ANGLE

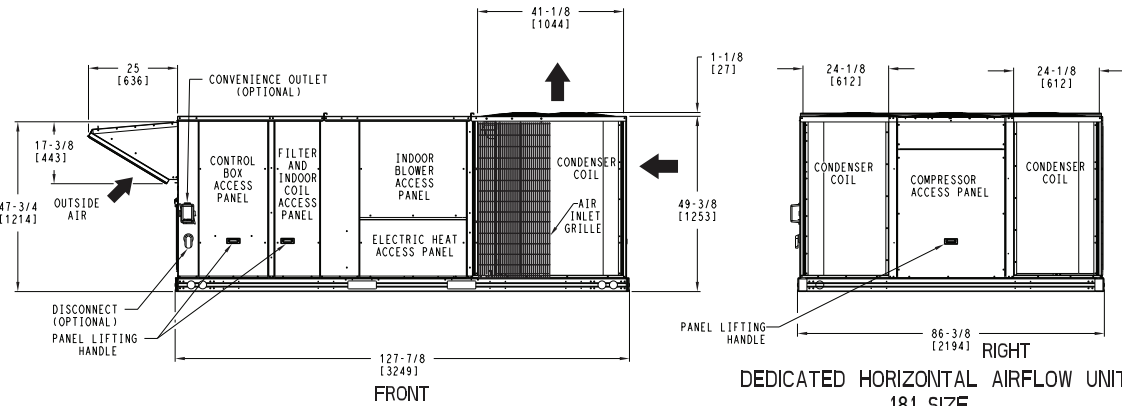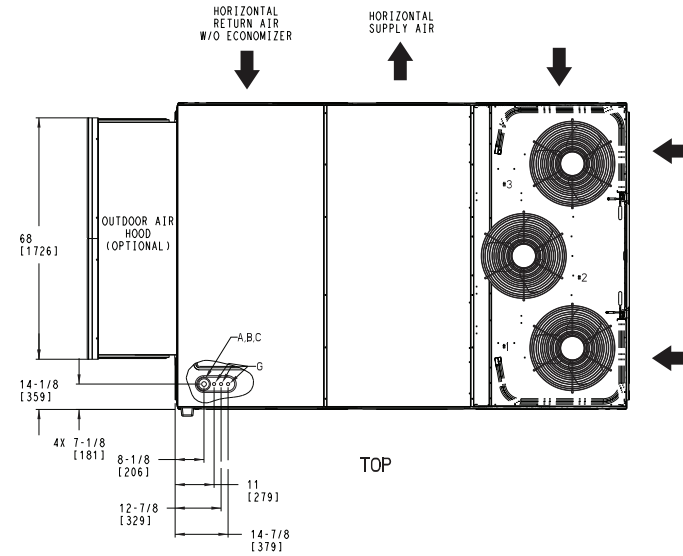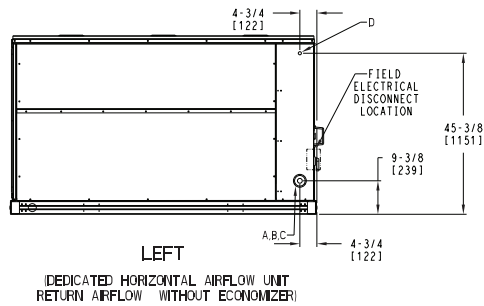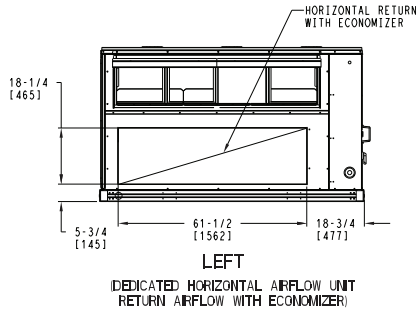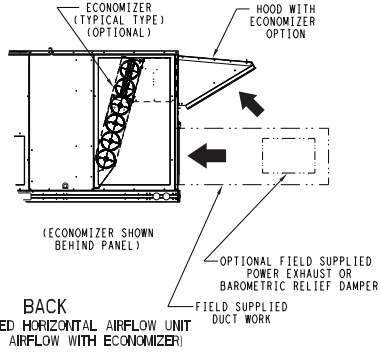

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	RHV 181 SINGLE ZONE ELECTRICAL HEAT PUMP	50HE006193	REV
U.S. ECCN:NSR	2 OF 5	8/29/22	-			-




RHV181 Base Unit Dimensions (cont)

CONNECTION SIZES	
E	3/4" - 1/4 NPT CONDENSATE DRAIN



THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PARTY PERFORMANCE OR ACCEPTANCE OF CONTRACT.

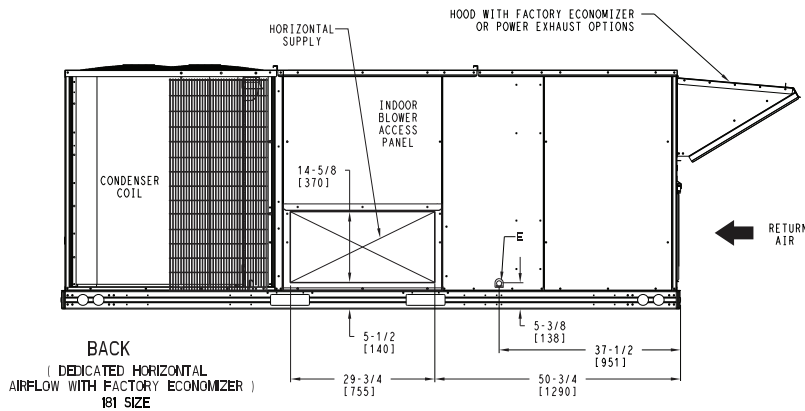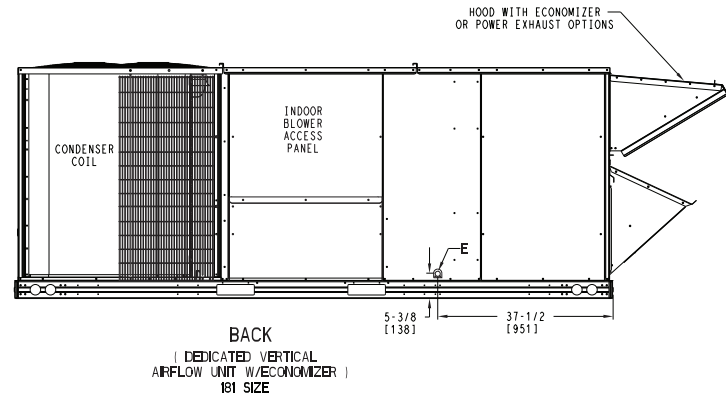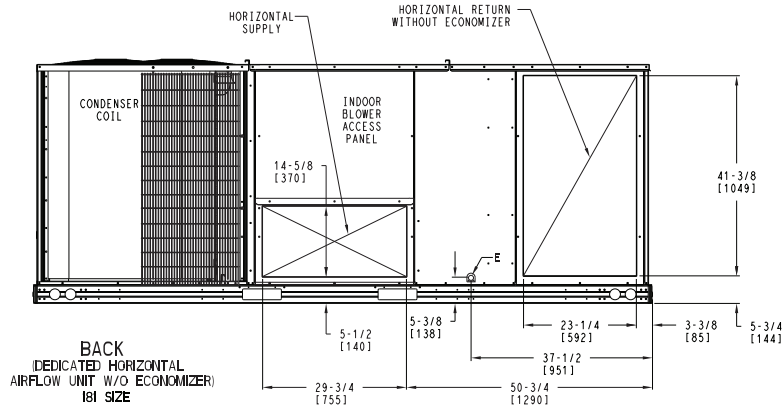

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	RHV 181 SINGLE ZONE ELECTRICAL HEAT PUMP	50HE006193	REV
U.S. ECCN:NSR	3 OF 5	8/29/22	-			-

RHV181 Base Unit Dimensions (cont)




UNIT	STD UNIT WEIGHT *		CORNER WEIGHT (A)		CORNER WEIGHT (B)		CORNER WEIGHT (C)		CORNER WEIGHT (D)		C.G.					
	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	X	Y	Z			
RHV-181	1627	738	357	162	460	209	456	207	354	161	72	1829	43	1092	16 1/2	419



THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

\* STANDARD UNIT WEIGHT IS WITHOUT ELECTRIC HEAT AND WITHOUT PACKAGING. FOR OTHER OPTIONS AND ACCESSORIES, REFER TO THE PRODUCT DATA CATALOG.

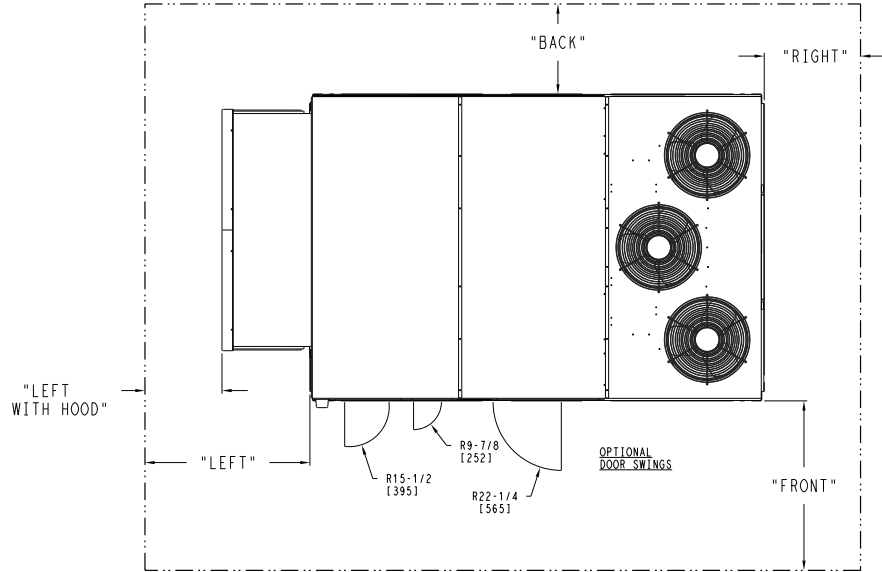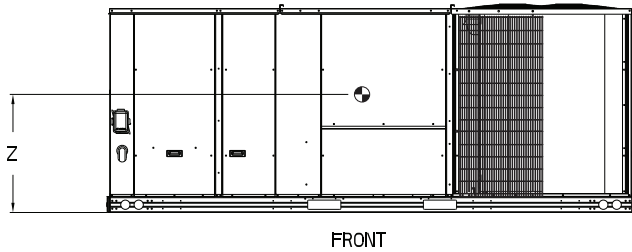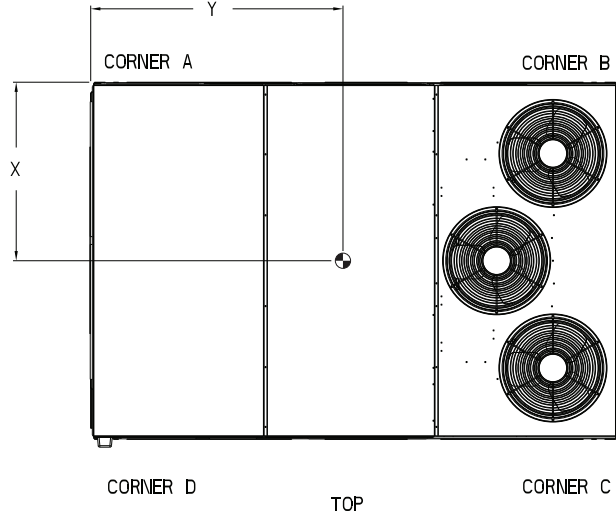

NOTES:

1. CLEARANCE ABOVE THE UNIT TO BE 72"
2. FOR ALL MINIMUM CLEARANCES LOCAL CODES OR JURISDICTIONS MAY PREVAIL.

SURFACE	CLEARANCE		OPERATING CLEARANCE
	SERVICE WITH: CONDUCTIVE BARRIER	SERVICE WITH: NONCONDUCTIVE BARRIER	
FRONT	48 [1219mm]	36 [914mm]	18 [457mm]
LEFT	48 [1219mm]	42 [1067mm]	18 [457mm]
BACK	42 [1067mm]	36 [914mm]	18 [457mm]
LEFT WITH HOOD	36 [914mm]	36 [914mm]	18 [457mm]
RIGHT	36 [914mm]	36 [914mm]	18 [457mm]
TOP	72 [1829mm]	72 [1829mm]	72 [1829mm]



ITC CLASSIFICATION U.S. ECCN:NSR	SHEET 4 OF 5	DATE 8/29/22	SUPERCEDES -	RHV 181 SINGLE ZONE ELECTRICAL HEAT PUMP	50HE006193	REV -
-------------------------------------	-----------------	-----------------	-----------------	--	------------	----------

RHV181 Base Unit Dimensions (cont)




THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.


SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

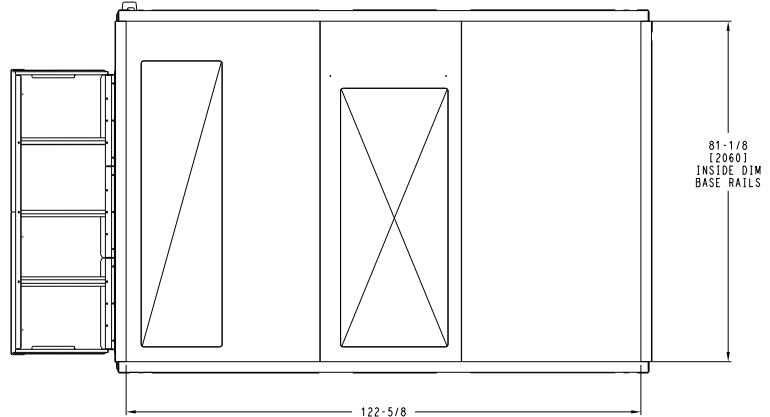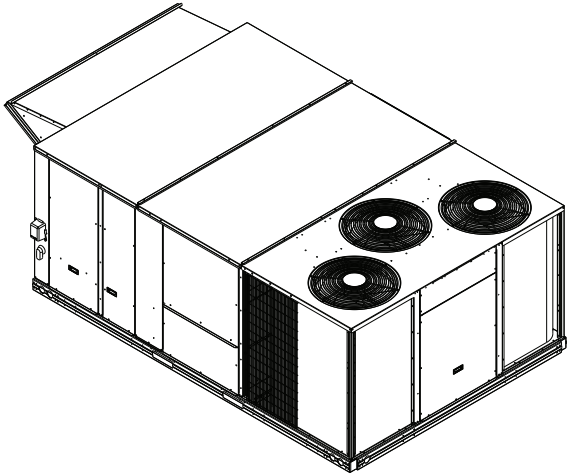

**BOTTOM**  
INSIDE BASERAIL DIMENSIONS

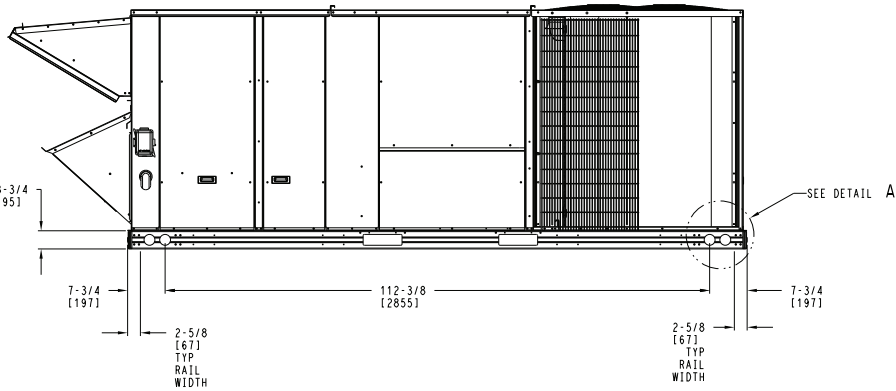

**FRONT**  
RIGGING HOLE LOCATIONS

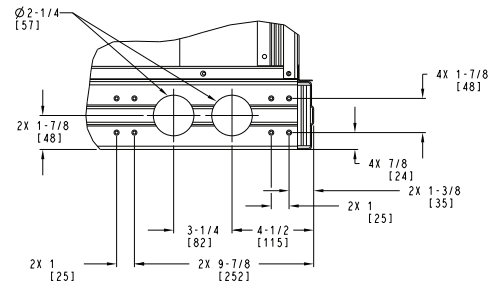

**DETAIL A**  
TYP 4 PLCS

ITC CLASSIFICATION U.S. ECCN:NSR	SHEET 5 OF 5	DATE 8/29/22	SUPERCEDES -	RHV 181 SINGLE ZONE ELECTRICAL HEAT PUMP	50HE006193	REV -
-------------------------------------	-----------------	-----------------	-----------------	---	------------	----------

RHV240-300 Base Unit Dimensions



THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.


SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

CONNECTION SIZES	
A	1 3/8" DIA [35] FIELD POWER SUPPLY KNOCKOUT
B	3" DIA [76] FIELD POWER SUPPLY KNOCKOUT
C	3 5/8" DIA [92] FIELD POWER SUPPLY KNOCKOUT
D	7/8" DIA [22] FIELD CONTROL WIRING HOLE
G	7/8" DIA [22] FIELD CONTROL WIRING KNOCKOUT


UNIT	H
240 SIZE	57-3/8 [1456]
300 SIZE	57-3/8 [1456]

NOTES:


1. DIMENSIONS ARE IN INCHES, DIMENSIONS IN [ ] ARE IN MILLIMETERS.
2. CENTER OF GRAVITY
3. DIRECTION OF AIR FLOW
4. ALL VIEW DRAWN USING 3RD ANGLE

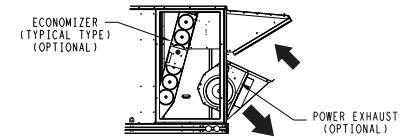


BACK  
PANELS REMOVED TO SHOW ECONOMIZER AND POWER EXHAUST OPTIONS

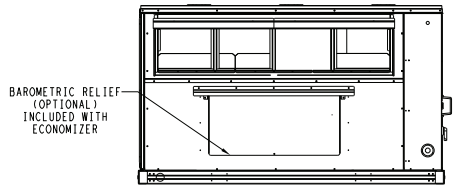


LEFT  
SHOWN WITH THE BAROMETRIC RELIEF OPTION INSTALLED

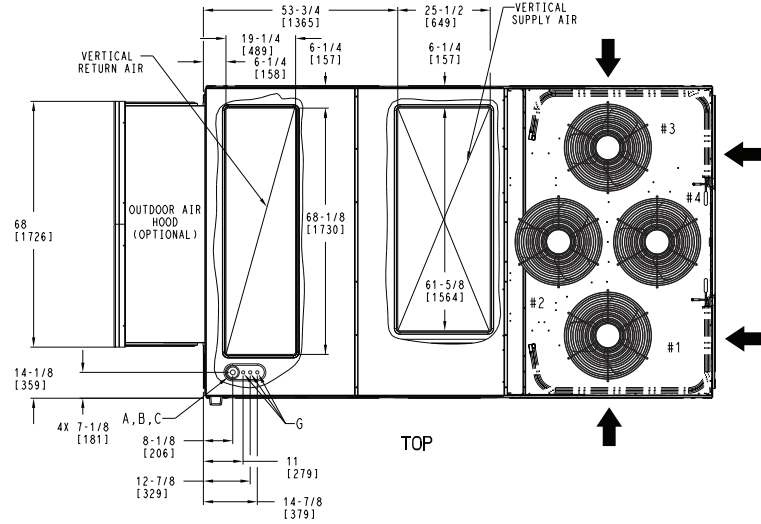


TOP

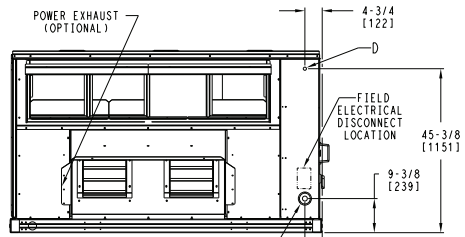

LEFT  
SHOWN WITH THE POWER EXHAUST OPTION INSTALLED

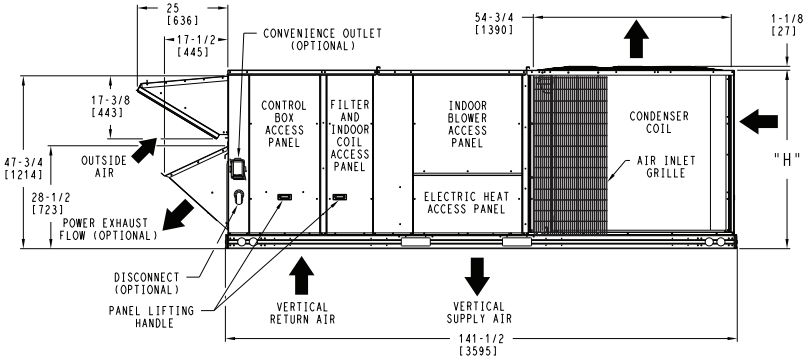

FRONT

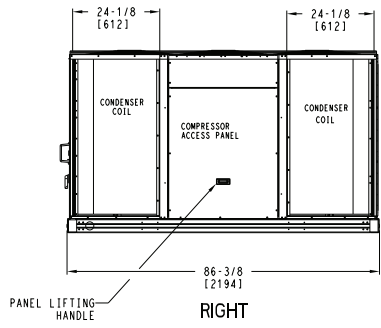

RIGHT

DEDICATED VERTICAL AIRFLOW UNIT  
240, 300 SIZE


ITC CLASSIFICATION U.S. ECCN:NSR	SHEET 1 OF 5	DATE 11/03/22	SUPERCEDES 8/29/22	RHV 240, 300 SINGLE ZONE ELECTRICAL HEAT PUMP	50HE006194	REV A
-------------------------------------	-----------------	------------------	-----------------------	---	------------	----------

### RHV240-300 Base Unit Dimensions (cont)



THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PARTY PERFORMANCE OR ACCEPTANCE OF CONTRACT.

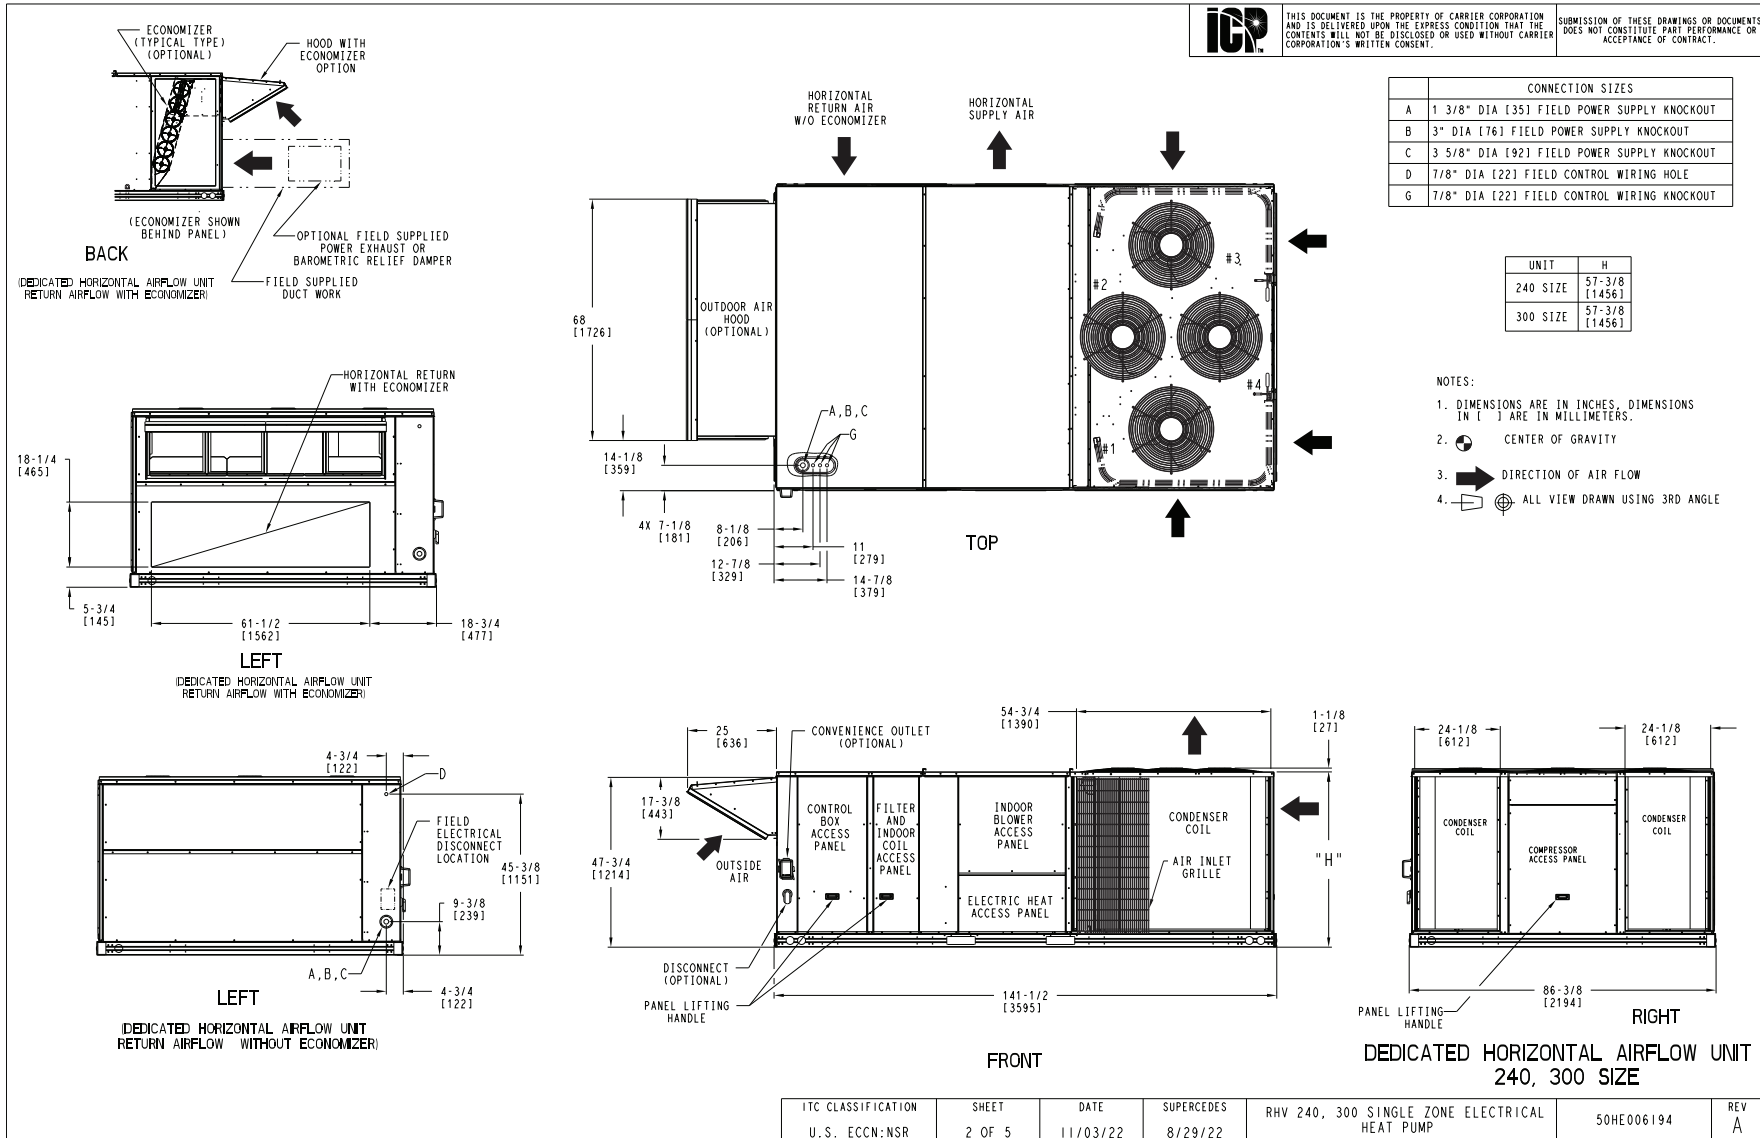

ITC CLASSIFICATION U.S. ECCN:NSR	SHEET 2 OF 5	DATE 11/03/22	SUPERCEDES 8/29/22	RHV 240, 300 SINGLE ZONE ELECTRICAL HEAT PUMP	50HE006194	REV A
-------------------------------------	-----------------	------------------	-----------------------	---	------------	----------

RHV240-300 Base Unit Dimensions (cont)






CONNECTION SIZES	
E	3/4" -14 NPT CONDENSATE DRAIN



THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PARTY PERFORMANCE OR ACCEPTANCE OF CONTRACT.

UNIT	G
240 SIZE	49-1/4 [1251]
300 SIZE	49-1/4 [1251]

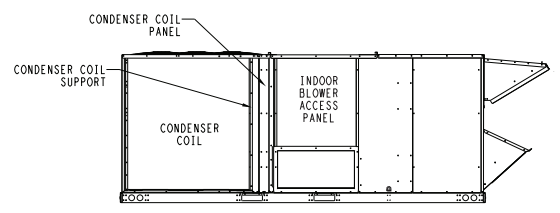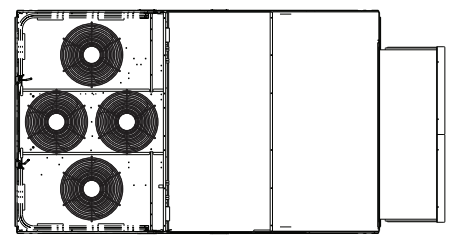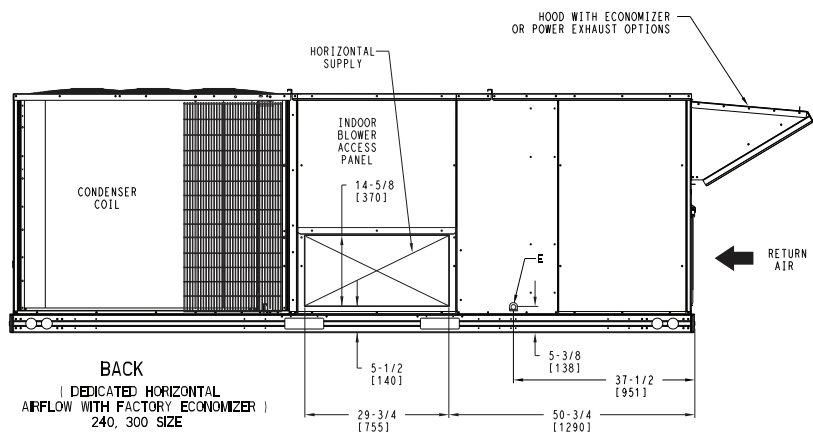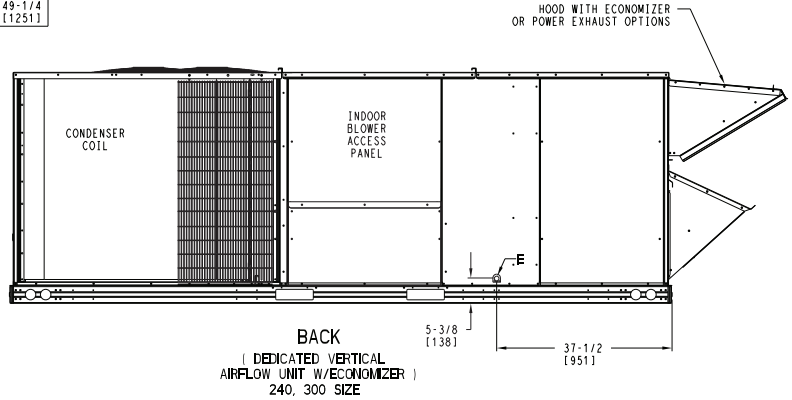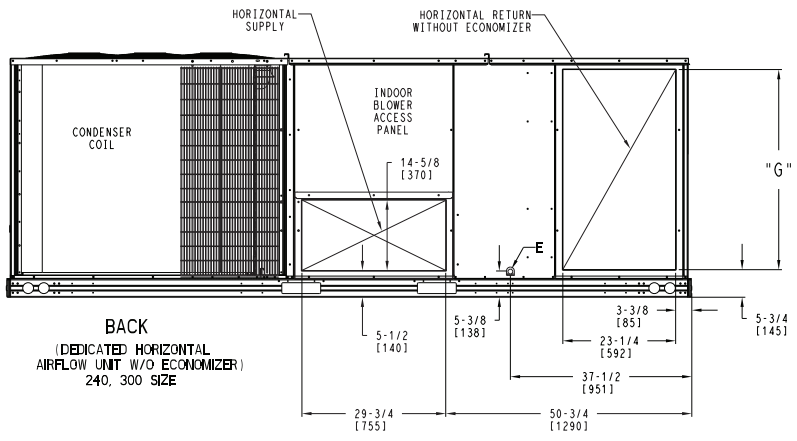

ITC CLASSIFICATION	SHEET	DATE	SUPERCEDES	RHV 240, 300 SINGLE ZONE ELECTRICAL HEAT PUMP	50HE006194	REV
U.S. ECCN:NSR	3 OF 5	11/03/22	8/29/22			A

RHV240-300 Base Unit Dimensions (cont)




UNIT	STD. UNIT WEIGHT *		CORNER WEIGHT (A)		CORNER WEIGHT (B)		CORNER WEIGHT (C)		CORNER WEIGHT (D)		C.G.		
	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	LBS.	KG.	X	Y	Z
RHV 240	2057	933	466	211	531	241	565	256	495	225	75 3/8 [1915]	44 1/2 [1130]	19 [483]
RHV 300	2125	964	465	211	556	252	601	273	503	228	77 [1956]	44 7/8 [1140]	19 [483]



THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.

SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PARTY PERFORMANCE OR ACCEPTANCE OF CONTRACT.

\* STANDARD UNIT WEIGHT IS WITHOUT ELECTRIC HEAT AND WITHOUT PACKAGING. FOR OTHER OPTIONS AND ACCESSORIES, REFER TO THE PRODUCT DATA CATALOG.

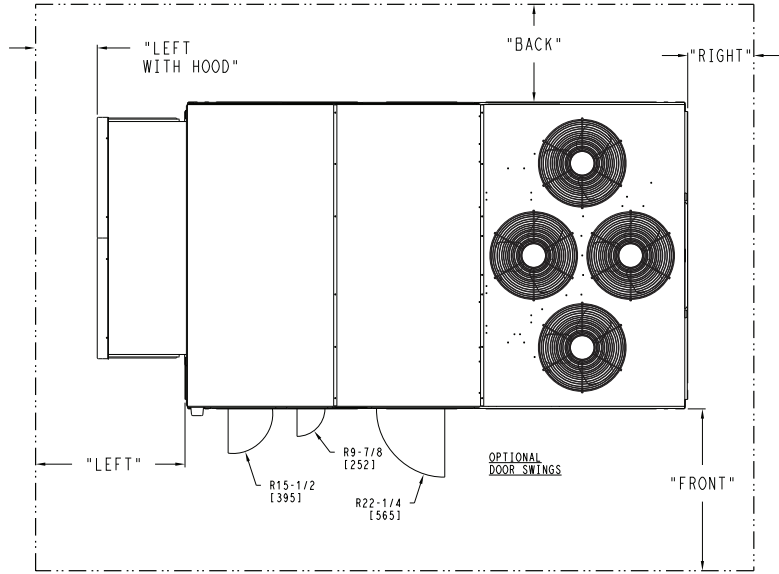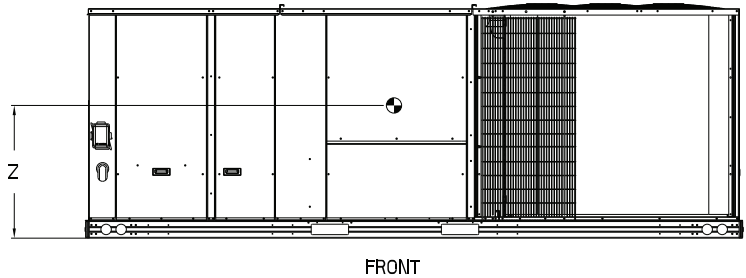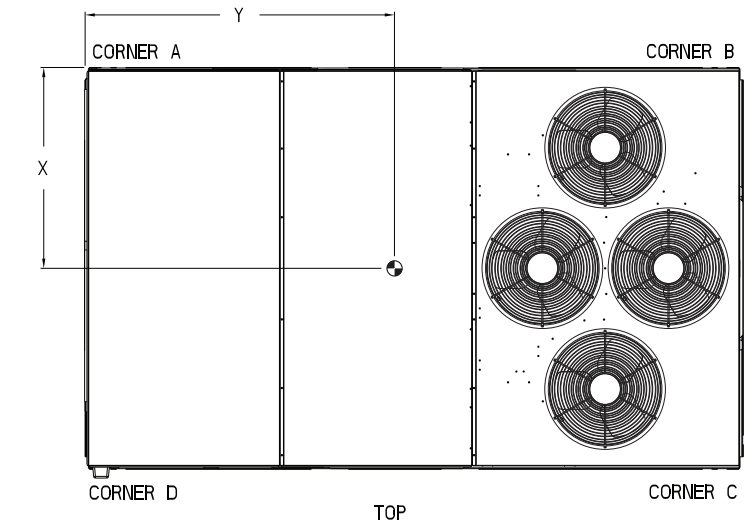

NOTES:

1. CLEARANCE ABOVE THE UNIT TO BE 72"
2. FOR ALL MINIMUM CLEARANCES LOCAL CODES OR JURISDICTIONS MAY PREVAIL.

SURFACE	CLEARANCE		OPERATING CLEARANCE
	SERVICE WITH CONDUCTIVE BARRIER	SERVICE WITH NONCONDUCTIVE BARRIER	
FRONT	48 [1219mm]	36 [914mm]	18 [457mm]
LEFT	48 [1219mm]	42 [1067mm]	18 [457mm]
BACK	42 [1067mm]	36 [914mm]	18 [457mm]
LEFT WITH HOOD	36 [914mm]	36 [914mm]	18 [457mm]
RIGHT	36 [914mm]	36 [914mm]	18 [457mm]
TOP	72 [1829mm]	72 [1829mm]	72 [1829mm]



ITC CLASSIFICATION U.S. ECCN:NSR	SHEET 4 OF 5	DATE 11/03/22	SUPERCEDES 8/29/22	RHV 240, 300 SINGLE ZONE ELECTRICAL HEAT PUMP	50HE006194	REV A
-------------------------------------	-----------------	------------------	-----------------------	---	------------	----------

RHV240-300 Base Unit Dimensions (cont)




THIS DOCUMENT IS THE PROPERTY OF CARRIER CORPORATION AND IS DELIVERED UPON THE EXPRESS CONDITION THAT THE CONTENTS WILL NOT BE DISCLOSED OR USED WITHOUT CARRIER CORPORATION'S WRITTEN CONSENT.


SUBMISSION OF THESE DRAWINGS OR DOCUMENTS DOES NOT CONSTITUTE PART PERFORMANCE OR ACCEPTANCE OF CONTRACT.

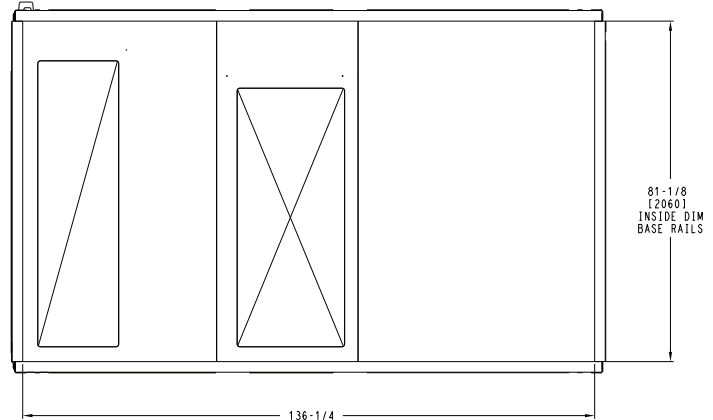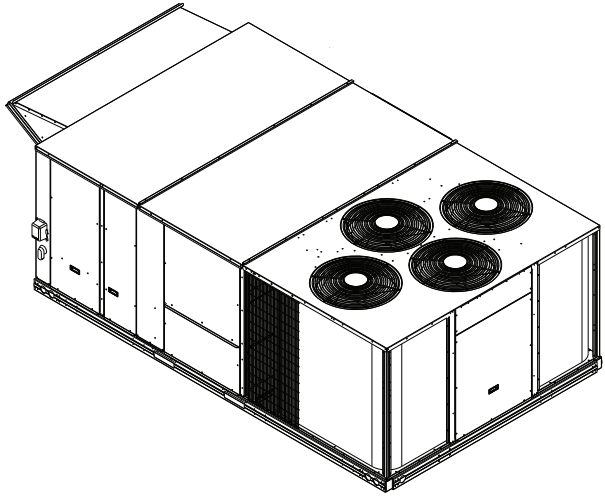

**BOTTOM**  
INSIDE BASERAIL DIMENSIONS

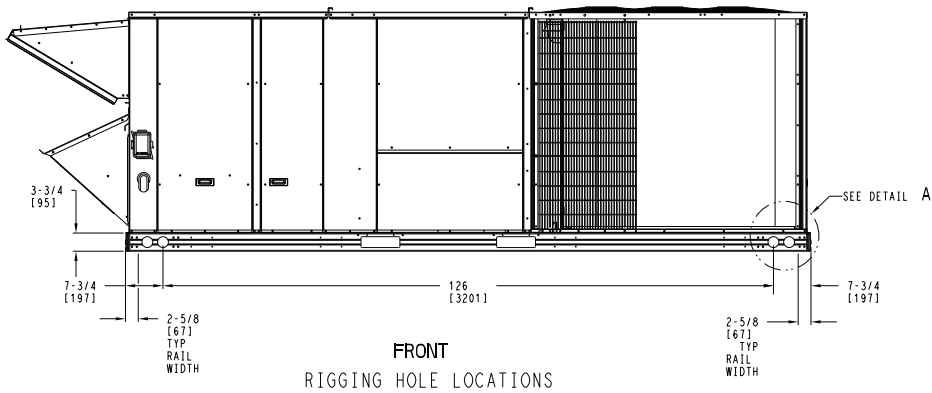

**FRONT**  
RIGGING HOLE LOCATIONS

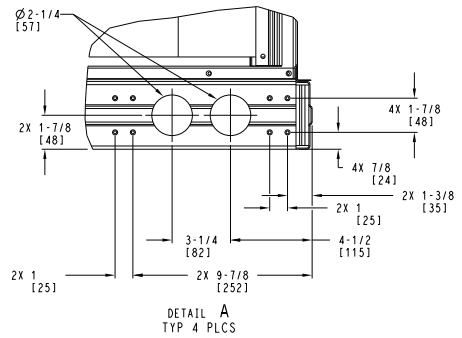


**DETAIL A**  
TYP 4 PLCS

ITC CLASSIFICATION U.S. ECCN:NSR	SHEET 5 OF 5	DATE 11/03/22	SUPERCEDES 8/29/22	RHV 240, 300 SINGLE ZONE ELECTRICAL HEAT PUMP	50HE006194	REV A
-------------------------------------	-----------------	------------------	-----------------------	--	------------	----------

# Base unit dimensions (cont)







## Roof Curb Dimensions — RHV181

"A"	ROOF CURB ACCESSORY
1'-2" [356.0]	CRRFCURB045A00
2'-0" [610.0]	CRRFCURB046A00

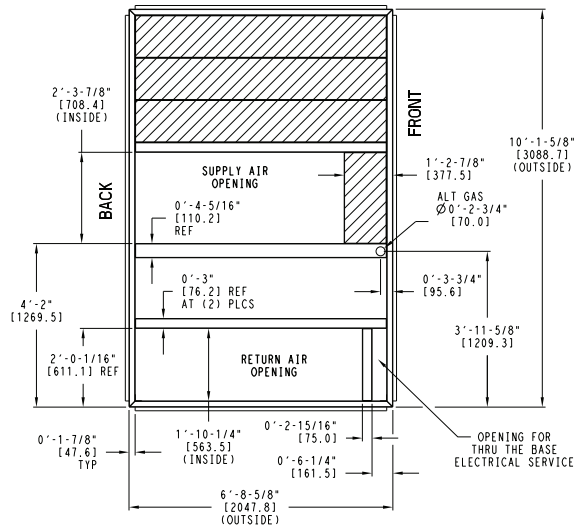

- NOTES:
- 1 ROOF CURB ACCESSORY IS SHIPPED UNASSEMBLED.
  - 2 DIMENSIONS IN ( ) ARE IN MILLIMETERS.
  - 3 ROOF CURB GALVANIZED STEEL.
  - 4 ATTACH DUCTWORK TO CURB (FLANGES ON DUCT REST ON CURB)
  - 5 SERVICE CLEARANCE 4 FI ON EACH SIDE


➔ DIRECTION OF AIR FLOW

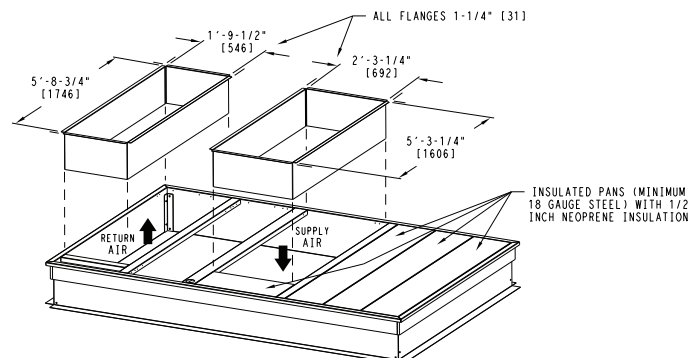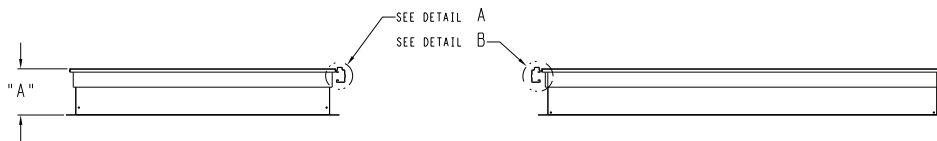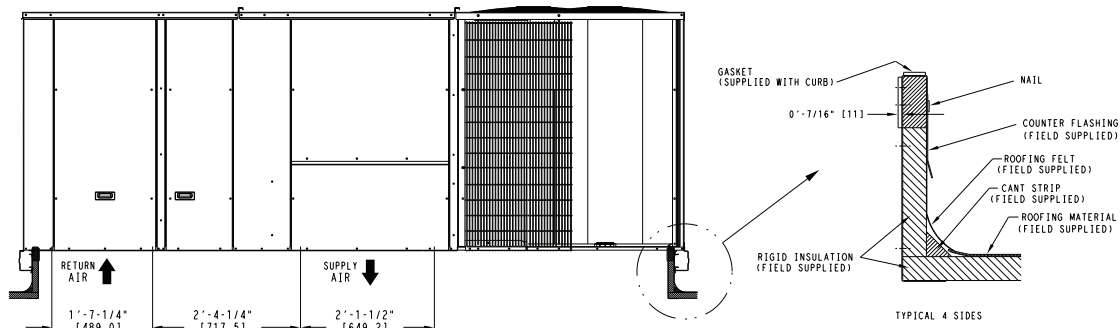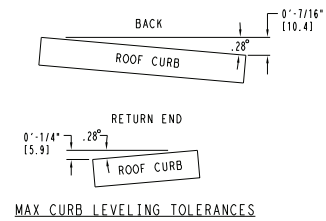

# Accessory dimensions

## Roof Curb Dimensions — RHV240-300



"A"	ROOF CURB ACCESSORY
1'-2" [356.0]	CRRFCURB047A00
2'-0" [610.0]	CRRFCURB048A00

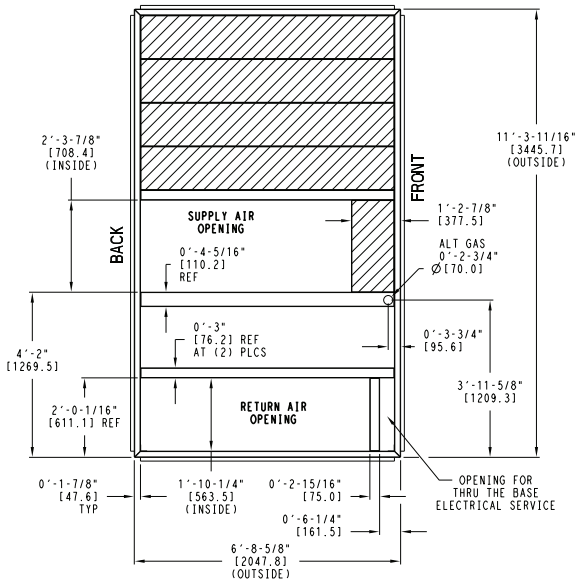






NOTES:

- 1 ROOF CURB ACCESSORY IS SHIPPED UNASSEMBLED.
- 2 DIMENSIONS IN ( ) ARE IN MILLIMETERS.
- 3 ROOF CURB GALVANIZED STEEL.
- 4 ATTACH DUCTWORK TO CURB (FLANGES ON DUCT REST ON CURB)
- 5 SERVICE CLEARANCE 4 FT ON EACH SIDE

➔ DIRECTION OF AIR FLOW



MAX CURB LEVELING TOLERANCES

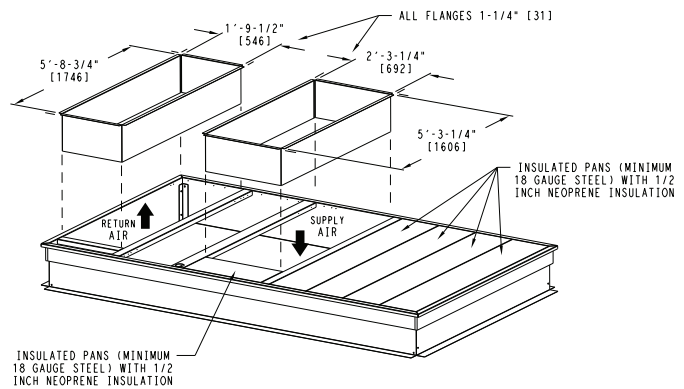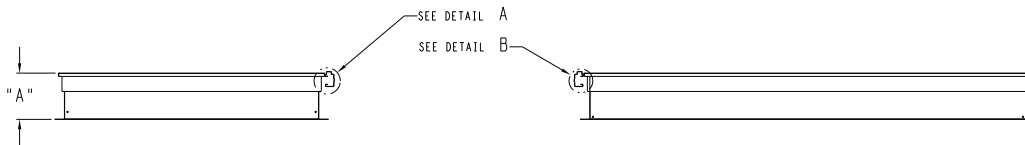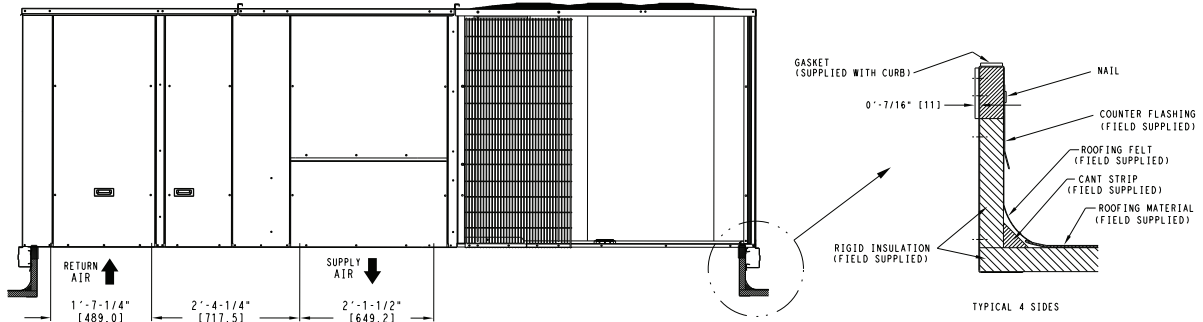

# Performance data

## RHV181 Two Stage Cooling Capacities

RHV181			AMBIENT TEMPERATURE (F)																
			85			95			105			115			125				
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
4500 cfm	EAT (wb)	58	TC	144.9	144.9	157.4	136.8	136.8	146.8	126.6	126.6	141.0	116.6	116.6	133.8	107.6	107.6	123.9	
			SHC	121.1	139.2	157.4	112.7	129.8	146.8	106.4	123.7	141.0	99.5	116.6	133.8	91.3	107.6	123.9	
		62	TC	154.0	154.0	154.0	143.9	143.9	143.9	133.2	133.2	135.7	122.6	122.6	129.3	111.6	111.6	122.6	
			SHC	108.8	128.5	148.3	102.5	122.3	142.1	96.1	115.9	135.7	89.6	109.5	129.3	83.0	102.8	122.6	
		67	TC	170.8	170.8	170.8	159.9	159.9	159.9	148.7	148.7	148.7	137.3	137.3	137.3	125.6	125.6	125.6	
			SHC	89.5	108.7	127.9	83.2	102.7	122.1	76.9	96.5	116.1	70.5	90.2	109.9	64.2	84.0	103.8	
	72	TC	189.7	189.7	189.7	178.0	178.0	178.0	166.2	166.2	166.2	154.1	154.1	154.1	141.5	141.5	141.5		
		SHC	71.7	88.4	105.1	64.8	82.5	100.2	58.2	76.6	94.9	51.7	70.5	89.3	45.1	64.4	83.6		
	76	TC	—	205.0	205.0	—	193.7	193.7	—	181.4	181.4	—	168.4	168.4	—	155.0	155.0		
		SHC	—	73.7	98.5	—	65.8	90.6	—	58.9	83.6	—	53.3	78.0	—	47.8	72.5		
	5250 cfm	EAT (wb)	58	TC	153.3	153.3	166.4	142.2	142.2	161.8	133.2	133.2	152.0	123.9	123.9	141.9	114.4	114.4	131.5
				SHC	128.3	147.4	166.4	122.6	142.2	161.8	114.4	133.2	152.0	105.9	123.9	141.9	97.3	114.4	131.5
62			TC	155.9	155.9	166.7	148.9	148.9	156.3	138.1	138.1	149.6	126.9	126.9	142.3	115.7	115.7	134.1	
			SHC	121.0	143.9	166.7	111.1	133.7	156.3	104.5	127.1	149.6	97.6	119.9	142.3	90.2	112.2	134.1	
67			TC	176.2	176.2	176.2	165.0	165.0	165.0	153.4	153.4	153.4	141.6	141.6	141.6	129.4	129.4	129.4	
			SHC	95.4	117.6	139.9	89.1	111.5	133.9	82.7	105.2	127.7	76.2	98.9	121.5	69.7	92.5	115.2	
72		TC	195.3	195.3	195.3	183.4	183.4	183.4	171.0	171.0	171.0	158.3	158.3	158.3	145.4	145.4	145.4		
		SHC	73.8	94.6	115.4	67.3	88.6	109.9	60.8	82.5	104.2	54.3	76.3	98.4	47.7	70.0	92.3		
76		TC	—	212.2	212.2	—	199.4	199.4	—	186.1	186.1	—	172.6	172.6	—	159.0	159.0		
		SHC	—	74.3	103.2	—	68.5	97.4	—	63.3	92.1	—	57.4	86.2	—	51.3	70.8		
6000 cfm		EAT (wb)	58	TC	158.1	158.1	179.3	149.1	149.1	169.5	139.7	139.7	159.2	129.9	129.9	148.6	120.0	120.0	137.7
				SHC	136.9	158.1	179.3	128.7	149.1	169.5	120.1	139.7	159.2	111.3	129.9	148.6	102.2	120.0	137.7
	62		TC	163.9	163.9	175.8	152.9	152.9	168.8	142.0	142.0	161.4	132.7	132.7	150.7	122.4	122.4	139.4	
			SHC	125.5	150.6	175.8	118.7	143.8	168.8	111.7	136.6	161.4	103.4	127.1	150.7	94.5	117.0	139.4	
	67		TC	180.5	180.5	180.5	169.0	169.0	169.0	157.0	157.0	157.0	144.8	144.8	144.8	132.3	132.3	132.3	
			SHC	100.7	125.8	150.8	94.4	119.6	144.8	88.0	113.3	138.6	81.4	106.8	132.2	74.8	100.3	125.7	
	72	TC	199.7	199.7	199.7	187.3	187.3	187.3	174.6	174.6	174.6	161.6	161.6	161.6	148.3	148.3	148.3		
		SHC	76.2	100.2	124.2	69.7	94.1	118.5	63.2	87.9	112.6	56.6	81.5	106.5	50.0	75.2	100.3		
	76	TC	—	216.3	216.3	—	203.3	203.3	—	189.8	189.8	—	176.0	176.0	—	162.2	162.2		
		SHC	—	78.3	111.3	—	72.6	105.6	—	66.7	86.8	—	60.5	82.6	—	54.5	77.9		
	6750 cfm	EAT (wb)	58	TC	164.4	164.4	186.3	155.0	155.0	176.0	145.2	145.2	165.3	135.1	135.1	154.3	124.8	124.8	143.1
				SHC	142.5	164.4	186.3	133.9	155.0	176.0	125.0	145.2	165.3	115.8	135.1	154.3	106.5	124.8	143.1
62			TC	167.5	167.5	187.2	159.2	159.2	169.1	147.9	147.9	165.5	137.7	137.7	155.9	126.9	126.9	143.2	
			SHC	132.4	159.8	187.2	120.4	144.8	169.1	115.3	140.4	165.5	107.3	131.6	155.9	97.6	120.4	143.2	
67			TC	184.1	184.1	184.1	161.3	161.3	170.0	159.9	159.9	159.9	147.4	147.4	147.4	134.7	134.7	135.7	
			SHC	105.8	133.6	161.4	109.9	140.0	170.0	92.9	120.9	148.8	86.3	114.3	142.3	79.6	107.7	135.7	
72		TC	203.2	203.2	203.2	190.6	190.6	190.6	177.5	177.5	177.5	164.2	164.2	164.2	150.7	150.7	150.7		
		SHC	78.4	105.4	132.4	72.0	99.2	126.5	65.4	92.9	120.4	58.8	86.5	114.3	52.1	80.1	108.0		
76		TC	—	219.9	219.9	—	206.5	206.5	—	192.8	192.8	—	179.0	179.0	—	164.7	164.7		
		SHC	—	81.8	118.9	—	75.8	98.6	—	69.7	94.3	—	63.6	89.4	—	57.3	83.9		
7500 cfm		EAT (wb)	58	TC	169.7	169.7	192.2	160.0	160.0	181.6	149.8	149.8	170.6	139.5	139.5	159.2	128.8	128.8	147.6
				SHC	147.2	169.7	192.2	138.3	160.0	181.6	129.1	149.8	170.6	119.7	139.5	159.2	110.1	128.8	147.6
	62		TC	172.7	172.7	194.8	163.2	163.2	183.6	153.2	153.2	169.9	142.1	142.1	158.8	128.9	128.9	154.0	
			SHC	137.6	166.2	194.8	129.0	156.3	183.6	118.9	144.4	169.9	110.0	134.4	158.8	103.9	128.9	154.0	
	67		TC	187.0	187.0	187.0	174.8	174.8	174.8	155.0	155.0	173.8	150.0	150.0	152.3	136.6	136.6	145.1	
			SHC	110.7	141.0	171.4	104.2	134.6	165.1	110.2	142.0	173.8	91.1	121.7	152.3	84.1	114.6	145.1	
	72	TC	206.1	206.1	206.1	193.2	193.2	193.2	179.9	179.9	179.9	166.4	166.4	166.4	152.7	152.7	152.7		
		SHC	80.5	110.3	140.0	74.1	104.1	134.1	67.5	97.7	127.9	60.8	91.2	121.6	54.2	84.8	115.4		
	76	TC	—	222.9	222.9	—	209.3	209.3	—	195.2	195.2	—	181.2	181.2	—	166.6	166.6		
		SHC	—	84.8	110.3	—	78.6	105.4	—	72.5	100.5	—	66.4	95.3	—	60.0	89.6		

### LEGEND

- Do Not Operate
- cfm — Cubic Feet Per Minute (Supply Air)
- EAT (db) — Entering Air Temperature (dry bulb)
- EAT (wb) — Entering Air Temperature (wet bulb)
- SHC — Sensible Heat Capacity (1000 Btuh) Gross
- TC — Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 5.

# Performance data (cont)

## RHV181 Single Stage Cooling Capacities

RHV181			AMBIENT TEMPERATURE (F)																
			85			95			105			115			125				
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
2700 cfm	EAT (wb)	58	TC	91.8	91.8	101.9	85.4	85.4	95.1	78.0	78.0	89.8	71.3	71.3	82.8	64.5	64.5	75.4	
			SHC	77.0	89.4	101.9	71.1	83.1	95.1	65.9	77.9	89.8	59.9	71.3	82.8	53.6	64.5	75.4	
		62	TC	99.8	99.8	99.8	92.2	92.2	92.2	84.6	84.6	84.6	76.3	76.3	78.2	68.1	68.1	73.0	
			SHC	68.0	80.7	93.4	62.9	75.7	88.4	57.9	70.7	83.4	52.7	65.4	78.2	47.4	60.2	73.0	
		67	TC	111.8	111.8	111.8	103.7	103.7	103.7	95.3	95.3	95.3	86.8	86.8	86.8	78.1	78.1	78.1	
			SHC	56.0	68.3	80.7	50.9	63.4	75.8	45.7	58.3	70.9	40.6	53.2	65.8	35.4	48.1	60.8	
	72	TC	125.2	125.2	125.2	116.6	116.6	116.6	107.8	107.8	107.8	98.7	98.7	98.7	89.5	89.5	89.5		
		SHC	45.2	55.8	66.5	39.6	50.9	62.3	34.2	46.0	57.7	28.9	40.9	53.0	23.5	35.8	48.1		
	76	TC	—	136.3	136.3	—	127.5	127.5	—	118.7	118.7	—	109.3	109.3	—	99.4	99.4		
		SHC	—	46.6	61.4	—	41.5	56.4	—	35.5	50.4	—	30.2	45.0	—	25.5	40.4		
	3150 cfm	EAT (wb)	58	TC	97.7	97.7	109.5	90.5	90.5	103.6	83.7	83.7	96.3	76.6	76.6	88.7	69.4	69.4	80.9
				SHC	82.9	96.2	109.5	77.3	90.5	103.6	71.1	83.7	96.3	64.6	76.6	88.7	58.0	69.4	80.9
62			TC	104.0	104.0	104.0	96.1	96.1	98.3	87.9	87.9	93.0	79.6	79.6	87.7	71.0	71.0	82.0	
			SHC	74.3	88.9	103.5	69.1	83.7	98.3	63.8	78.4	93.0	58.5	73.1	87.7	53.0	67.5	82.0	
67			TC	116.0	116.0	116.0	107.5	107.5	107.5	98.9	98.9	98.9	90.0	90.0	90.0	81.0	81.0	81.0	
			SHC	60.2	74.5	88.9	55.0	69.5	83.9	49.8	64.3	78.8	44.5	59.1	73.7	39.3	53.9	68.5	
72		TC	129.6	129.6	129.6	120.7	120.7	120.7	111.5	111.5	111.5	102.1	102.1	102.1	92.5	92.5	92.5		
		SHC	46.8	60.1	73.5	41.5	55.2	68.9	36.1	50.1	64.0	30.8	44.9	59.1	25.4	39.7	54.0		
76		TC	—	141.7	141.7	—	132.5	132.5	—	122.6	122.6	—	112.6	112.6	—	102.4	102.4		
		SHC	—	48.1	65.4	—	42.6	60.0	—	38.0	55.3	—	33.1	50.4	—	28.0	40.2		
3600 cfm		EAT (wb)	58	TC	102.5	102.5	116.7	95.6	95.6	109.3	88.5	88.5	101.6	81.1	81.1	93.6	73.6	73.6	85.5
				SHC	88.3	102.5	116.7	81.9	95.6	109.3	75.3	88.5	101.6	68.6	81.1	93.6	61.7	73.6	85.5
	62		TC	107.3	107.3	112.8	99.2	99.2	107.4	90.8	90.8	101.7	82.4	82.4	95.9	74.3	74.3	87.8	
			SHC	79.9	96.4	112.8	74.7	91.0	107.4	69.2	85.5	101.7	63.6	79.7	95.9	57.0	72.4	87.8	
	67		TC	119.3	119.3	119.3	110.7	110.7	110.7	101.8	101.8	101.8	92.6	92.6	92.6	83.4	83.4	83.4	
			SHC	64.1	80.4	96.6	58.9	75.2	91.5	53.6	70.0	86.4	48.3	64.7	81.1	42.9	59.4	75.9	
	72	TC	133.1	133.1	133.1	123.9	123.9	123.9	114.4	114.4	114.4	104.7	104.7	104.7	94.8	94.8	94.8		
		SHC	48.6	64.1	79.7	43.2	59.0	74.8	37.9	53.9	69.9	32.5	48.6	64.8	27.1	43.3	59.6		
	76	TC	—	145.4	145.4	—	135.6	135.6	—	125.5	125.5	—	115.3	115.3	—	105.0	105.0		
		SHC	—	50.2	70.0	—	45.5	65.3	—	40.5	60.3	—	35.4	49.5	—	30.3	45.3		
	4050 cfm	EAT (wb)	58	TC	107.1	107.1	121.9	100.0	100.0	114.1	92.6	92.6	106.2	84.9	84.9	97.9	77.1	77.1	89.4
				SHC	92.4	107.1	121.9	85.8	100.0	114.1	79.0	92.6	106.2	72.0	84.9	97.9	64.8	77.1	89.4
62			TC	109.8	109.8	120.9	101.9	101.9	115.5	93.6	93.6	108.8	85.2	85.2	101.9	77.7	77.7	92.2	
			SHC	84.9	102.9	120.9	79.6	97.6	115.5	73.6	91.2	108.8	67.5	84.7	101.9	60.1	76.2	92.2	
67			TC	122.1	122.1	122.1	113.2	113.2	113.2	104.1	104.1	104.1	94.7	94.7	94.7	85.3	85.3	85.3	
			SHC	67.7	85.9	104.0	62.5	80.6	98.8	57.2	75.4	93.6	51.8	70.0	88.2	46.4	64.7	83.0	
72		TC	135.9	135.9	135.9	126.5	126.5	126.5	116.8	116.8	116.8	106.9	106.9	106.9	96.8	96.8	96.8		
		SHC	50.2	67.8	85.4	44.9	62.6	80.4	39.6	57.4	75.3	34.2	52.2	70.2	28.7	46.8	65.0		
76		TC	—	148.1	148.1	—	138.2	138.2	—	127.9	127.9	—	117.6	117.6	—	106.9	106.9		
		SHC	—	52.8	75.1	—	47.9	62.4	—	42.8	58.6	—	37.6	54.3	—	32.3	49.6		
4500 cfm		EAT (wb)	58	TC	111.1	111.1	126.3	103.8	103.8	118.4	96.1	96.1	110.0	88.2	88.2	101.6	80.2	80.2	92.9
				SHC	96.0	111.1	126.3	89.2	103.8	118.4	82.1	96.1	110.0	74.9	88.2	101.6	67.6	80.2	92.9
	62		TC	112.7	112.7	128.6	105.0	105.0	120.8	97.3	97.3	112.3	89.2	89.2	104.2	80.3	80.3	97.2	
			SHC	89.7	109.1	128.6	83.3	102.1	120.8	76.4	94.3	112.3	69.7	87.0	104.2	63.4	80.3	97.2	
	67		TC	124.3	124.3	124.3	115.3	115.3	115.3	106.0	106.0	106.0	96.4	96.4	96.4	86.6	86.6	89.4	
			SHC	71.2	91.1	111.0	65.9	85.8	105.8	60.5	80.5	100.4	55.1	75.1	95.0	49.5	69.5	89.4	
	72	TC	138.2	138.2	138.2	128.6	128.6	128.6	118.7	118.7	118.7	108.6	108.6	108.6	98.3	98.3	98.3		
		SHC	51.8	71.3	90.7	46.5	66.1	85.7	41.1	60.8	80.5	35.7	55.5	75.3	30.2	50.1	70.0		
	76	TC	—	150.5	150.5	—	140.4	140.4	—	130.0	130.0	—	119.3	119.3	—	108.5	108.5		
		SHC	—	55.0	71.5	—	49.9	67.5	—	44.8	63.1	—	39.5	58.4	—	34.2	53.4		

### LEGEND

- — Do Not Operate
- cfm — Cubic Feet Per Minute (Supply Air)
- EAT (db) — Entering Air Temperature (dry bulb)
- EAT (wb) — Entering Air Temperature (wet bulb)
- SHC — Sensible Heat Capacity (1000 Btuh) Gross
- TC — Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 5.

# Performance data (cont)

## RHV240 Two Stage Cooling Capacities

RHV240			AMBIENT TEMPERATURE (F)																
			85			95			105			115			125				
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
6000 cfm	EAT (wb)	58	TC	205.6	205.6	233.9	193.7	193.7	221.0	181.2	181.2	207.3	168.1	168.1	193.1	154.2	154.2	177.9	
			SHC	177.3	205.6	233.9	166.5	193.7	221.0	155.0	181.2	207.3	143.1	168.1	193.1	130.5	154.2	177.9	
		62	TC	217.8	217.8	222.3	203.5	203.5	213.4	188.3	188.3	204.1	172.4	172.4	194.4	155.9	155.9	184.2	
			SHC	159.7	191.0	222.3	150.7	182.0	213.4	141.5	172.8	204.1	132.0	163.2	194.4	122.0	153.1	184.2	
		67	TC	242.0	242.0	242.0	226.8	226.8	226.8	210.6	210.6	210.6	193.8	193.8	193.8	176.1	176.1	176.1	
			SHC	130.2	161.6	193.0	121.3	152.7	184.1	112.1	143.5	174.9	102.7	134.1	165.5	93.1	124.4	155.8	
	72	TC	268.3	268.3	268.3	252.0	252.0	252.0	234.9	234.9	234.9	216.9	216.9	216.9	198.0	198.0	198.0		
		SHC	100.2	131.5	162.8	91.4	122.6	153.9	82.2	113.5	144.8	72.9	104.1	135.4	63.2	94.5	125.7		
	76	TC	—	290.5	290.5	—	273.4	273.4	—	255.3	255.3	—	236.4	236.4	—	—	—		
		SHC	—	106.9	137.1	—	98.1	128.5	—	89.0	119.5	—	79.6	110.2	—	—	—		
	7000 cfm	EAT (wb)	58	TC	218.8	218.8	248.6	206.2	206.2	234.9	192.9	192.9	220.4	178.9	178.9	205.1	164.5	164.5	189.4
				SHC	189.0	218.8	248.6	177.5	206.2	234.9	165.5	192.9	220.4	152.7	178.9	205.1	139.6	164.5	189.4
62			TC	225.7	225.7	246.3	210.7	210.7	236.9	195.0	195.0	226.9	181.8	181.8	207.7	168.8	168.8	185.7	
			SHC	174.1	210.2	246.3	164.9	200.9	236.9	155.2	191.1	226.9	141.3	174.5	207.7	125.9	155.8	185.7	
67			TC	250.0	250.0	250.0	234.1	234.1	234.1	217.3	217.3	217.3	199.8	199.8	199.8	181.4	181.4	181.4	
			SHC	139.6	175.9	212.2	130.6	166.8	203.1	121.3	157.5	193.7	111.7	147.9	184.1	101.9	138.1	174.3	
72		TC	276.5	276.5	276.5	259.6	259.6	259.6	241.7	241.7	241.7	223.0	223.0	223.0	203.4	203.4	203.4		
		SHC	104.4	140.5	176.7	95.4	131.5	167.6	86.1	122.2	158.4	76.6	112.7	148.8	66.9	103.0	139.1		
76		TC	—	299.0	299.0	—	281.1	281.1	—	262.3	262.3	—	242.7	242.7	—	—	—		
		SHC	—	111.7	146.9	—	102.7	138.0	—	93.5	128.8	—	84.0	119.4	—	—	—		
8000 cfm		EAT (wb)	58	TC	229.8	229.8	260.8	216.6	216.6	246.4	202.7	202.7	231.3	188.1	188.1	215.3	172.8	172.8	198.6
				SHC	198.8	229.8	260.8	186.7	216.6	246.4	174.1	202.7	231.3	160.9	188.1	215.3	147.0	172.8	198.6
	62		TC	232.0	232.0	268.1	220.6	220.6	245.6	202.9	202.9	241.1	188.3	188.3	224.7	172.6	172.6	207.0	
			SHC	187.2	227.7	268.1	171.9	208.7	245.6	164.7	202.9	241.1	151.9	188.3	224.7	138.2	172.6	207.0	
	67		TC	256.1	256.1	256.1	239.7	239.7	239.7	222.3	222.3	222.3	204.3	204.3	204.3	185.4	185.4	192.0	
			SHC	148.4	189.4	230.4	139.3	180.2	221.2	129.8	170.8	211.7	120.2	161.1	202.0	110.3	151.2	192.0	
	72	TC	282.8	282.8	282.8	265.3	265.3	265.3	246.9	246.9	246.9	227.7	227.7	227.7	207.5	207.5	207.5		
		SHC	108.1	148.9	189.8	99.0	139.8	180.6	89.6	130.4	171.2	80.0	120.8	161.6	70.1	110.9	151.7		
	76	TC	—	305.3	305.3	—	286.9	286.9	—	267.6	267.6	—	247.4	247.4	—	—	—		
		SHC	—	115.9	155.8	—	106.8	146.7	—	97.5	137.5	—	87.9	128.0	—	—	—		
	9000 cfm	EAT (wb)	58	TC	239.2	239.2	271.2	225.4	225.4	256.2	211.4	211.4	241.0	195.8	195.8	223.9	179.8	179.8	206.4
				SHC	207.1	239.2	271.2	194.5	225.4	256.2	181.8	211.4	241.0	167.7	195.8	223.9	153.2	179.8	206.4
62			TC	242.8	242.8	271.2	225.6	225.6	266.8	211.1	211.1	250.5	196.0	196.0	233.6	180.0	180.0	215.5	
			SHC	191.4	231.3	271.2	184.4	225.6	266.8	171.7	211.1	250.5	158.5	196.0	233.6	144.5	180.0	215.5	
67			TC	261.0	261.0	261.0	244.1	244.1	244.1	226.3	226.3	229.1	207.9	207.9	219.3	188.5	188.5	209.2	
			SHC	156.7	202.4	248.0	147.5	193.1	238.7	138.0	183.6	229.1	128.3	173.8	219.3	118.4	163.8	209.2	
72		TC	287.7	287.7	287.7	269.8	269.8	269.8	251.0	251.0	251.0	231.2	231.2	231.2	210.6	210.6	210.6		
		SHC	111.3	156.8	202.2	102.2	147.6	193.1	92.7	138.2	183.6	83.0	128.5	173.9	73.1	118.5	163.9		
76		TC	—	310.4	310.4	—	291.5	291.5	—	271.7	271.7	—	251.1	251.1	—	—	—		
		SHC	—	119.8	164.2	—	110.6	155.1	—	101.1	145.7	—	91.5	136.0	—	—	—		
10000 cfm		EAT (wb)	58	TC	247.1	247.1	280.1	232.9	232.9	264.5	217.9	217.9	248.2	202.3	202.3	231.1	185.7	185.7	212.9
				SHC	214.1	247.1	280.1	201.2	232.9	264.5	187.6	217.9	248.2	173.4	202.3	231.1	158.5	185.7	212.9
	62		TC	247.4	247.4	291.4	233.1	233.1	275.5	218.2	218.2	258.7	202.5	202.5	241.0	185.9	185.9	222.3	
			SHC	203.3	247.4	291.4	190.8	233.1	275.5	177.7	218.2	258.7	164.0	202.5	241.0	149.5	185.9	222.3	
	67		TC	264.9	264.9	265.1	247.7	247.7	255.7	229.6	229.6	246.0	210.8	210.8	236.0	191.1	191.1	225.8	
			SHC	164.8	214.9	265.1	155.5	205.6	255.7	145.9	196.0	246.0	136.2	186.1	236.0	126.2	176.0	225.8	
	72	TC	291.7	291.7	291.7	273.3	273.3	273.3	254.1	254.1	254.1	234.1	234.1	234.1	—	—	—		
		SHC	114.3	164.4	214.4	105.1	155.1	205.1	95.6	145.6	195.5	85.9	135.8	185.8	—	—	—		
	76	TC	—	314.5	314.5	—	295.3	295.3	—	275.0	275.0	—	254.0	254.0	—	—	—		
		SHC	—	123.2	172.1	—	114.0	163.0	—	104.5	153.5	—	94.8	143.8	—	—	—		

### LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EAT (db)	Entering Air Temperature (dry bulb)
EAT (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 5.

# Performance data (cont)

## RHV240 Single Stage Cooling Capacities

RHV240			AMBIENT TEMPERATURE (F)																
			85			95			105			115			125				
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
3600 cfm	EAT (wb)	58	TC	118.1	118.1	146.7	109.6	109.6	137.2	100.6	100.6	127.2	91.3	91.3	116.6	81.4	81.4	105.4	
			SHC	89.5	118.1	146.7	82.0	109.6	137.2	74.1	100.6	127.2	65.9	91.3	116.6	57.4	81.4	105.4	
		62	TC	125.5	125.5	142.3	115.2	115.2	135.3	104.4	104.4	128.1	93.5	93.5	120.8	81.9	81.9	112.9	
			SHC	78.2	110.3	142.3	71.2	103.3	135.3	64.1	96.1	128.1	56.9	88.9	120.8	49.4	81.1	112.9	
		67	TC	141.1	141.1	141.1	130.5	130.5	130.5	119.3	119.3	119.3	107.6	107.6	107.6	95.1	95.1	96.8	
			SHC	61.3	93.4	125.6	54.4	86.5	118.6	47.3	79.5	111.6	40.1	72.2	104.3	32.7	64.8	96.8	
	72	TC	158.4	158.4	158.4	147.2	147.2	147.2	135.4	135.4	135.4	123.0	123.0	123.0	109.8	109.8	109.8		
		SHC	44.1	76.2	108.3	37.3	69.3	101.4	30.3	62.3	94.4	23.1	55.1	87.1	15.7	47.7	79.7		
	76	TC	—	173.4	173.4	—	161.6	161.6	—	149.2	149.2	—	136.1	136.1	—	122.3	122.3		
		SHC	—	62.2	93.4	—	55.4	86.6	—	48.4	79.7	—	41.1	72.6	—	33.7	65.2		
	4200 cfm	EAT (wb)	58	TC	126.8	126.8	157.0	117.8	117.8	146.9	131.6	131.6	150.9	98.5	98.5	125.1	88.0	88.0	113.2
				SHC	96.7	126.8	157.0	88.7	117.8	146.9	112.4	131.6	150.9	71.9	98.5	125.1	62.8	88.0	113.2
62			TC	130.5	130.5	159.6	120.1	120.1	152.4	109.1	109.1	144.7	98.6	98.6	134.2	88.2	88.2	121.9	
			SHC	85.4	122.5	159.6	78.4	115.4	152.4	71.1	107.9	144.7	63.0	98.6	134.2	54.5	88.2	121.9	
67			TC	146.5	146.5	146.5	135.3	135.3	135.3	123.7	123.7	125.7	111.4	111.4	118.3	98.5	98.5	110.7	
			SHC	65.5	102.7	139.9	58.4	95.6	132.9	51.3	88.5	125.7	43.9	81.1	118.3	36.3	73.5	110.7	
72		TC	164.1	164.1	164.1	152.3	152.3	152.3	140.0	140.0	140.0	127.0	127.0	127.0	113.4	113.4	113.4		
		SHC	45.2	82.4	119.6	38.2	75.4	112.5	31.1	68.2	105.3	23.7	60.8	97.9	16.2	53.3	90.4		
76		TC	—	179.2	179.2	—	166.8	166.8	—	153.9	153.9	—	140.3	140.3	—	125.9	125.9		
		SHC	—	65.8	102.1	—	58.8	95.2	—	51.7	88.1	—	44.3	80.7	—	36.8	73.2		
4800 cfm		EAT (wb)	58	TC	134.1	134.1	165.6	124.8	124.8	155.2	137.0	137.0	156.8	104.5	104.5	132.2	112.2	112.2	129.9
				SHC	102.6	134.1	165.6	94.5	124.8	155.2	117.2	137.0	156.8	76.8	104.5	132.2	94.5	112.2	129.9
	62		TC	134.8	134.8	175.4	124.9	124.9	165.4	115.0	115.0	153.8	104.6	104.6	141.6	93.7	93.7	128.7	
			SHC	92.1	133.7	175.4	84.4	124.9	165.4	76.2	115.0	153.8	67.7	104.6	141.6	58.7	93.7	128.7	
	67		TC	150.5	150.5	153.8	139.0	139.0	146.6	127.0	127.0	139.3	114.4	114.4	131.8	101.2	101.2	124.0	
			SHC	69.3	111.5	153.8	62.2	104.4	146.6	54.9	97.1	139.3	47.4	89.6	131.8	39.8	81.9	124.0	
	72	TC	168.3	168.3	168.3	156.1	156.1	156.1	143.4	143.4	143.4	130.0	130.0	130.0	116.0	116.0	116.0		
		SHC	45.9	88.2	130.4	38.8	81.0	123.2	31.6	73.7	115.9	24.1	66.2	108.4	16.5	58.6	100.7		
	76	TC	—	183.6	183.6	—	170.8	170.8	—	157.5	157.5	—	143.4	143.4	—	128.6	128.6		
		SHC	—	69.0	110.3	—	61.9	103.2	—	54.6	95.9	—	47.2	88.5	—	39.5	80.8		
	5400 cfm	EAT (wb)	58	TC	140.3	140.3	172.9	130.6	130.6	161.9	120.3	120.3	150.4	109.6	109.6	138.2	98.2	98.2	125.2
				SHC	107.7	140.3	172.9	99.2	130.6	161.9	90.3	120.3	150.4	81.0	109.6	138.2	71.2	98.2	125.2
62			TC	140.5	140.5	184.0	130.7	130.7	172.6	120.5	120.5	160.6	109.7	109.7	147.9	98.4	98.4	134.4	
			SHC	97.0	140.5	184.0	88.8	130.7	172.6	80.4	120.5	160.6	71.5	109.7	147.9	62.3	98.4	134.4	
67			TC	153.7	153.7	167.2	142.0	142.0	160.0	129.7	129.7	152.6	116.7	116.7	144.9	103.3	103.3	137.0	
			SHC	72.8	120.0	167.2	65.6	112.8	160.0	58.3	105.4	152.6	50.7	97.8	144.9	43.0	90.0	137.0	
72		TC	171.6	171.6	171.6	159.1	159.1	159.1	146.2	146.2	146.2	132.5	132.5	132.5	118.1	118.1	118.1		
		SHC	46.4	93.6	140.8	39.2	86.4	133.5	31.9	79.0	126.1	24.4	71.4	118.5	16.7	63.7	110.7		
76		TC	—	187.0	187.0	—	174.0	174.0	—	160.3	160.3	—	145.9	145.9	—	130.8	130.8		
		SHC	—	71.9	118.1	—	64.7	110.9	—	57.4	103.5	—	49.8	95.9	—	42.0	88.0		
6000 cfm		EAT (wb)	58	TC	145.7	145.7	179.3	135.7	135.7	168.0	125.1	125.1	155.9	113.9	113.9	143.3	102.2	102.2	130.0
				SHC	112.2	145.7	179.3	103.4	135.7	168.0	94.2	125.1	155.9	84.6	113.9	143.3	74.5	102.2	130.0
	62		TC	145.9	145.9	190.7	135.8	135.8	178.9	125.2	125.2	166.5	114.1	114.1	153.3	102.4	102.4	139.4	
			SHC	101.1	145.9	190.7	92.7	135.8	178.9	83.9	125.2	166.5	74.8	114.1	153.3	65.3	102.4	139.4	
	67		TC	156.4	156.4	180.3	144.4	144.4	173.0	131.9	131.9	165.5	118.6	118.6	157.7	105.0	105.0	149.5	
			SHC	76.2	128.3	180.3	69.0	121.0	173.0	61.6	113.5	165.5	53.9	105.8	157.7	46.1	97.8	149.5	
	72	TC	174.4	174.4	174.4	161.6	161.6	161.6	148.4	148.4	148.4	134.5	134.5	134.5	119.8	119.8	120.5		
		SHC	46.7	98.8	150.8	39.5	91.5	143.5	32.1	84.1	136.1	24.5	76.4	128.4	16.8	68.6	120.5		
	76	TC	—	189.8	189.8	—	176.5	176.5	—	162.5	162.5	—	147.9	147.9	—	132.4	132.4		
		SHC	—	74.6	125.6	—	67.4	118.3	—	59.9	110.8	—	52.3	103.0	—	44.4	95.0		

### LEGEND

- Do Not Operate
- cfm — Cubic Feet Per Minute (Supply Air)
- EAT (db) — Entering Air Temperature (dry bulb)
- EAT (wb) — Entering Air Temperature (wet bulb)
- SHC — Sensible Heat Capacity (1000 Btuh) Gross
- TC — Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 5.

# Performance data (cont)

## RHV300 Two Stage Cooling Capacities

RHV300			AMBIENT TEMPERATURE (F)																
			85			95			105			115			125				
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
7500 cfm	EAT (wb)	58	TC	253.6	253.6	277.3	237.2	237.2	269.7	222.7	222.7	253.8	207.4	207.4	237.1	191.5	191.5	219.6	
			SHC	213.5	245.4	277.3	204.7	237.2	269.7	191.6	222.7	253.8	177.8	207.4	237.1	163.4	191.5	219.6	
		62	TC	266.7	266.7	266.7	249.6	249.6	256.9	231.9	231.9	246.8	213.3	213.3	236.0	194.0	194.0	224.0	
			SHC	194.1	230.4	266.7	184.1	220.5	256.9	174.0	210.4	246.8	163.3	199.6	236.0	151.9	188.0	224.0	
		67	TC	294.5	294.5	294.5	276.2	276.2	276.2	256.7	256.7	256.7	236.9	236.9	236.9	216.4	216.4	216.4	
			SHC	158.7	194.6	230.6	148.7	184.8	220.9	138.3	174.6	210.9	128.0	164.3	200.7	117.4	153.8	190.3	
	72	TC	325.2	325.2	325.2	305.0	305.0	305.0	284.2	284.2	284.2	262.7	262.7	262.7	—	—	—		
		SHC	123.5	158.0	192.4	113.1	148.1	183.1	102.7	138.1	173.5	92.1	127.9	163.7	—	—	—		
	76	TC	—	351.7	351.7	—	330.5	330.5	—	308.0	308.0	—	285.1	285.1	—	—	—		
		SHC	—	127.6	168.9	—	117.5	158.8	—	108.4	136.2	—	98.5	131.8	—	—	—		
	8750 cfm	EAT (wb)	58	TC	265.6	265.6	301.1	251.0	251.0	285.1	235.5	235.5	268.1	219.3	219.3	250.4	202.5	202.5	231.8
				SHC	230.2	265.6	301.1	216.9	251.0	285.1	202.9	235.5	268.1	188.3	219.3	250.4	173.2	202.5	231.8
62			TC	275.4	275.4	293.9	257.3	257.3	282.7	243.3	243.3	274.8	221.8	221.8	255.0	202.7	202.7	241.9	
			SHC	210.3	252.1	293.9	199.5	241.1	282.7	192.5	233.6	274.8	175.4	215.2	255.0	163.5	202.7	241.9	
67			TC	303.2	303.2	303.2	284.0	284.0	284.0	264.1	264.1	264.1	243.4	243.4	243.4	222.1	222.1	222.1	
			SHC	168.8	210.3	251.8	158.7	200.3	241.9	148.4	190.1	231.8	137.8	179.6	221.4	127.1	169.0	210.8	
72		TC	333.6	333.6	333.6	312.7	312.7	312.7	291.3	291.3	291.3	269.2	269.2	269.2	—	—	—		
		SHC	127.4	167.8	208.2	117.0	157.8	198.6	106.6	147.7	188.7	96.0	137.3	178.6	—	—	—		
76		TC	—	360.2	360.2	—	337.9	337.9	—	314.9	314.9	—	291.0	291.0	—	—	—		
		SHC	—	133.1	181.3	—	123.5	160.1	—	113.6	152.3	—	103.3	143.3	—	—	—		
10000 cfm		EAT (wb)	58	TC	277.9	277.9	314.8	262.4	262.4	297.8	246.0	246.0	279.8	229.1	229.1	261.2	211.3	211.3	241.7
				SHC	241.0	277.9	314.8	227.0	262.4	297.8	212.2	246.0	279.8	197.0	229.1	261.2	181.0	211.3	241.7
	62		TC	282.9	282.9	317.3	264.4	264.4	304.7	253.8	253.8	273.2	234.1	234.1	258.2	212.5	212.5	250.5	
			SHC	224.5	270.9	317.3	212.9	258.8	304.7	193.0	233.1	273.2	180.0	219.1	258.2	170.4	210.4	250.5	
	67		TC	310.2	310.2	310.2	290.2	290.2	290.2	269.8	269.8	269.8	248.5	248.5	248.5	—	—	—	
			SHC	178.4	225.2	272.0	168.1	215.0	261.9	157.7	204.7	251.7	147.1	194.1	241.1	—	—	—	
	72	TC	340.4	340.4	340.4	319.0	319.0	319.0	296.9	296.9	296.9	274.2	274.2	274.2	—	—	—		
		SHC	131.1	177.0	223.0	120.7	166.9	213.1	110.2	156.6	203.0	99.5	146.1	192.7	—	—	—		
	76	TC	—	366.8	366.8	—	343.9	343.9	—	320.0	320.0	—	295.7	295.7	—	—	—		
		SHC	—	138.1	180.3	—	128.2	172.1	—	117.9	162.9	—	107.5	153.3	—	—	—		
	11250 cfm	EAT (wb)	58	TC	288.0	288.0	326.0	271.8	271.8	308.2	254.8	254.8	289.6	237.1	237.1	270.1	219.0	219.0	250.2
				SHC	249.9	288.0	326.0	235.3	271.8	308.2	220.0	254.8	289.6	204.1	237.1	270.1	187.8	219.0	250.2
62			TC	289.6	289.6	334.9	274.7	274.7	312.9	259.0	259.0	289.6	238.2	238.2	279.2	219.1	219.1	260.8	
			SHC	235.5	285.2	334.9	219.7	266.3	312.9	203.0	246.3	289.6	192.2	235.7	279.2	177.4	219.1	260.8	
67			TC	315.7	315.7	315.7	295.2	295.2	295.2	274.1	274.1	274.1	252.4	252.4	260.1	—	—	—	
			SHC	187.5	239.5	291.5	177.2	229.2	281.3	166.6	218.7	270.8	156.0	208.0	260.1	—	—	—	
72		TC	345.8	345.8	345.8	323.9	323.9	323.9	301.4	301.4	301.4	278.1	278.1	278.1	—	—	—		
		SHC	134.4	185.6	236.8	123.9	175.4	226.8	113.4	165.0	216.6	102.7	154.4	206.2	—	—	—		
76		TC	—	372.3	372.3	—	348.6	348.6	—	324.0	324.0	—	299.3	299.3	—	—	—		
		SHC	—	142.3	191.1	—	132.2	182.0	—	121.7	172.3	—	111.2	162.4	—	—	—		
12500 cfm		EAT (wb)	58	TC	296.7	296.7	335.7	279.8	279.8	317.2	262.4	262.4	298.1	244.3	244.3	278.1	—	—	—
				SHC	257.6	296.7	335.7	242.4	279.8	317.2	226.8	262.4	298.1	210.4	244.3	278.1	—	—	—
	62		TC	301.5	301.5	334.8	282.2	282.2	323.6	263.8	263.8	307.4	244.4	244.4	289.6	—	—	—	
			SHC	238.1	286.5	334.8	227.1	275.4	323.6	213.7	260.5	307.4	199.2	244.4	289.6	—	—	—	
	67		TC	320.2	320.2	320.2	299.3	299.3	299.9	277.8	277.8	289.3	255.7	255.7	278.3	—	—	—	
			SHC	196.3	253.2	310.2	185.9	242.9	299.9	175.3	232.3	289.3	164.5	221.4	278.3	—	—	—	
	72	TC	350.3	350.3	350.3	328.2	328.2	328.2	305.0	305.0	305.0	281.3	281.3	281.3	—	—	—		
		SHC	137.4	193.7	250.1	127.0	183.5	240.0	116.3	173.0	229.6	105.6	162.3	219.1	—	—	—		
	76	TC	—	376.4	376.4	—	352.2	352.2	—	327.5	327.5	—	302.6	302.6	—	—	—		
		SHC	—	146.1	200.6	—	135.7	191.0	—	125.2	181.1	—	114.7	170.9	—	—	—		

### LEGEND

—	Do Not Operate
cfm	Cubic Feet Per Minute (Supply Air)
EAT (db)	Entering Air Temperature (dry bulb)
EAT (wb)	Entering Air Temperature (wet bulb)
SHC	Sensible Heat Capacity (1000 Btuh) Gross
TC	Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 5.

# Performance data (cont)

## RHV300 Single Stage Cooling Capacities

RHV300			AMBIENT TEMPERATURE (F)																
			85			95			105			115			125				
			EAT (db)			EAT (db)			EAT (db)			EAT (db)			EAT (db)				
			75	80	85	75	80	85	75	80	85	75	80	85	75	80	85		
4500 cfm	EAT (wb)	58	TC	147.5	147.5	168.2	137.8	137.8	157.8	128.0	128.0	147.1	117.5	117.5	135.8	106.3	106.3	123.7	
			SHC	126.7	147.5	168.2	117.9	137.8	157.8	108.8	128.0	147.1	99.1	117.5	135.8	88.9	106.3	123.7	
		62	TC	156.5	156.5	160.3	145.0	145.0	152.9	133.1	133.1	145.3	120.4	120.4	137.2	107.2	107.2	128.4	
			SHC	114.2	137.2	160.3	106.7	129.8	152.9	99.2	122.2	145.3	91.2	114.2	137.2	82.8	105.6	128.4	
		67	TC	175.1	175.1	175.1	162.7	162.7	162.7	149.9	149.9	149.9	136.4	136.4	136.4	122.3	122.3	122.3	
			SHC	93.0	115.8	138.7	85.5	108.4	131.3	77.9	100.9	123.8	70.1	93.1	116.1	62.1	85.1	108.2	
	72	TC	195.4	195.4	195.4	182.2	182.2	182.2	168.4	168.4	168.4	154.0	154.0	154.0	138.7	138.7	138.7		
		SHC	71.9	94.1	116.2	64.4	86.7	109.1	56.6	79.1	101.6	48.7	71.4	94.0	40.6	63.4	86.2		
	76	TC	—	213.2	213.2	—	199.0	199.0	—	184.2	184.2	—	169.0	169.0	—	153.4	153.4		
		SHC	—	75.5	100.2	—	68.6	93.4	—	61.2	80.3	—	53.7	74.4	—	46.0	67.6		
	5250 cfm	EAT (wb)	58	TC	157.4	157.4	179.2	147.3	147.3	168.3	136.7	136.7	156.9	125.5	125.5	144.7	113.7	113.7	131.9
				SHC	135.6	157.4	179.2	126.2	147.3	168.3	116.6	136.7	156.9	106.3	125.5	144.7	95.5	113.7	131.9
62			TC	162.4	162.4	178.0	150.4	150.4	170.2	138.0	138.0	161.6	125.7	125.7	151.4	113.9	113.9	138.2	
			SHC	124.9	151.4	178.0	117.2	143.7	170.2	109.0	135.3	161.6	100.0	125.7	151.4	89.6	113.9	138.2	
67			TC	181.1	181.1	181.1	168.2	168.2	168.2	154.9	154.9	154.9	140.8	140.8	140.8	126.1	126.1	126.1	
			SHC	100.1	126.6	153.1	92.5	119.1	145.6	84.8	111.4	138.0	76.8	103.4	130.0	68.7	95.4	122.0	
72		TC	201.9	201.9	201.9	188.1	188.1	188.1	173.8	173.8	173.8	158.7	158.7	158.7	142.9	142.9	142.9		
		SHC	75.3	101.2	127.1	67.6	93.7	119.8	59.8	86.0	112.2	51.8	78.1	104.4	43.5	69.9	96.4		
76		TC	—	219.7	219.7	—	204.9	204.9	—	189.7	189.7	—	173.7	173.7	—	157.3	157.3		
		SHC	—	80.3	102.0	—	72.8	96.4	—	65.2	89.7	—	57.4	82.5	—	49.4	75.0		
6000 cfm		EAT (wb)	58	TC	165.8	165.8	188.5	155.1	155.1	176.9	144.0	144.0	164.9	132.3	132.3	152.2	119.8	119.8	138.6
				SHC	143.0	165.8	188.5	133.2	155.1	176.9	123.0	144.0	164.9	112.3	132.3	152.2	101.0	119.8	138.6
	62		TC	167.2	167.2	193.6	156.9	156.9	180.9	145.2	145.2	169.4	133.0	133.0	159.8	120.3	120.3	145.5	
			SHC	134.4	164.0	193.6	124.5	152.7	180.9	115.0	142.2	169.4	106.3	133.0	159.8	95.1	120.3	145.5	
	67		TC	185.9	185.9	185.9	172.6	172.6	172.6	158.7	158.7	158.7	144.2	144.2	144.2	128.9	128.9	135.2	
			SHC	106.9	136.9	166.9	99.2	129.2	159.3	91.3	121.4	151.4	83.3	113.5	143.7	74.9	105.0	135.2	
	72	TC	206.8	206.8	206.8	192.5	192.5	192.5	177.7	177.7	177.7	162.4	162.4	162.4	145.7	145.7	145.7		
		SHC	78.2	107.8	137.3	70.5	100.2	129.8	62.6	92.3	122.1	54.5	84.3	114.2	46.1	76.0	106.0		
	76	TC	—	224.6	224.6	—	209.6	209.6	—	193.8	193.8	—	177.4	177.4	—	160.4	160.4		
		SHC	—	84.0	111.2	—	76.5	104.4	—	68.7	97.2	—	60.7	89.6	—	52.6	81.8		
	6750 cfm	EAT (wb)	58	TC	172.9	172.9	196.4	161.8	161.8	184.4	150.2	150.2	171.8	137.9	137.9	158.5	125.0	125.0	144.4
				SHC	149.3	172.9	196.4	139.2	161.8	184.4	128.6	150.2	171.8	117.4	137.9	158.5	105.6	125.0	144.4
62			TC	173.2	173.2	203.8	162.0	162.0	191.7	150.4	150.4	179.2	138.2	138.2	165.7	125.2	125.2	151.1	
			SHC	141.3	172.5	203.8	131.5	161.6	191.7	121.5	150.4	179.2	110.8	138.2	165.7	99.2	125.2	151.1	
67			TC	189.7	189.7	189.7	176.0	176.0	176.0	161.7	161.7	164.5	146.8	146.8	156.3	131.2	131.2	148.0	
			SHC	113.3	146.7	180.2	105.4	139.0	172.5	97.5	131.0	164.5	89.3	122.8	156.3	81.0	114.5	148.0	
72		TC	210.8	210.8	210.8	195.9	195.9	195.9	180.9	180.9	180.9	164.9	164.9	164.9	148.2	148.2	148.2		
		SHC	81.0	114.0	147.0	73.1	106.2	139.4	65.1	98.3	131.6	56.9	90.3	123.6	48.5	81.9	115.3		
76		TC	—	229.0	229.0	—	213.4	213.4	—	197.2	197.2	—	180.6	180.6	—	162.9	162.9		
		SHC	—	87.5	118.9	—	79.8	111.6	—	71.9	104.1	—	63.9	96.4	—	55.5	88.3		
7500 cfm		EAT (wb)	58	TC	178.9	178.9	203.1	167.5	167.5	190.7	155.5	155.5	177.7	142.8	142.8	163.9	129.5	129.5	149.4
				SHC	154.7	178.9	203.1	144.2	167.5	190.7	133.3	155.5	177.7	121.7	142.8	163.9	109.6	129.5	149.4
	62		TC	179.2	179.2	211.5	167.6	167.6	198.7	155.7	155.7	185.3	143.6	143.6	171.9	129.6	129.6	156.1	
			SHC	146.8	179.2	211.5	136.6	167.6	198.7	126.0	155.7	185.3	115.3	143.6	171.9	103.0	129.6	156.1	
	67		TC	192.8	192.8	193.0	178.7	178.7	185.1	164.3	164.3	177.1	150.0	150.0	169.1	133.0	133.0	159.8	
			SHC	119.3	156.1	193.0	111.4	148.2	185.1	103.4	140.3	177.1	95.5	132.3	169.1	86.5	123.1	159.8	
	72	TC	214.1	214.1	214.1	198.9	198.9	198.9	183.4	183.4	183.4	167.1	167.1	167.1	150.1	150.1	150.1		
		SHC	83.5	120.0	156.4	75.5	112.1	148.6	67.5	104.2	140.8	59.2	95.9	132.6	50.8	87.5	124.3		
	76	TC	—	232.2	232.2	—	216.3	216.3	—	199.9	199.9	—	182.7	182.7	—	165.0	165.0		
		SHC	—	90.6	125.6	—	82.8	118.2	—	74.8	110.5	—	66.6	102.6	—	58.3	94.4		

### LEGEND

- Do Not Operate
- cfm — Cubic Feet Per Minute (Supply Air)
- EAT (db) — Entering Air Temperature (dry bulb)
- EAT (wb) — Entering Air Temperature (wet bulb)
- SHC — Sensible Heat Capacity (1000 Btuh) Gross
- TC — Total Capacity (1000 Btuh) Gross

NOTE: See minimum-maximum airflow ratings on page 5.

# Performance data (cont)

## RHV181 Heating Capacities

RHV181 (15 Tons)											
Return Air (°F db)	CFM (Standard Air)		Temperature Air Entering Outdoor Coil (°F db at 70% rh)								
			-10	0	10	17	30	40	47	50	60
55	4500	Capacity	—	63.2	85.4	97.9	122.4	149.4	165.1	170.5	193.4
		Int. Cap.	—	58.1	78.4	89.2	107.3	149.4	165.1	170.5	193.4
	6000	Capacity	—	65.0	87.7	100.6	126.4	153.9	170.8	176.4	201.3
		Int. Cap.	—	59.8	80.5	91.7	110.8	153.9	170.8	176.4	201.3
	7500	Capacity	—	67.0	89.7	102.9	129.5	157.3	174.9	180.7	206.8
		Int. Cap.	—	61.6	82.3	93.8	113.4	157.3	174.9	180.7	206.8
70	4500	Capacity	42.1	57.2	79.8	91.8	115.2	142.5	157.4	162.7	184.3
		Int. Cap.	38.9	52.7	73.3	83.7	100.9	142.5	157.4	162.7	184.3
	6000	Capacity	43.8	59.3	82.2	94.6	119.1	147.0	162.8	168.3	191.6
		Int. Cap.	40.5	54.6	75.5	86.3	104.4	147.0	162.8	168.3	191.6
	7500	Capacity	45.5	61.4	84.3	97.0	122.2	150.3	166.8	172.5	196.9
		Int. Cap.	42.1	56.5	77.4	88.4	107.1	150.3	166.8	172.5	196.9
80	4500	Capacity	38.1	52.8	75.9	87.5	110.3	138.1	152.4	157.6	178.2
		Int. Cap.	35.2	48.6	69.7	79.8	96.6	138.1	152.4	157.6	178.2
	6000	Capacity	39.9	55.1	78.4	90.3	114.2	142.4	157.6	163.0	185.3
		Int. Cap.	36.9	50.7	72.0	82.4	100.1	142.4	157.6	163.0	185.3
	7500	Capacity	42.5	57.1	80.5	92.7	117.2	145.7	161.5	167.1	190.5
		Int. Cap.	39.3	52.5	73.8	84.5	102.7	145.7	161.5	167.1	190.5

### LEGEND

- Do Not Operate
- Capacity** — Instantaneous Capacity (1000 Btuh) - includes indoor fan motor heat at AHRI static conditions
- Int. Cap.** — Integrated Capacity = instantaneous capacity minus the effects of frost on the OD coil and the heat required to defrost it
- rh** — Relative Humidity
- db** — Dry Bulb

## RHV240 Heating Capacities

RHV240 (20 Tons)											
Return Air (°F db)	CFM (Standard Air)		Temperature Air Entering Outdoor Coil (°F db at 70% rh)								
			-10	0	10	17	30	40	47	50	60
55	6000	Capacity	—	89.5	121.0	140.6	181.0	220.7	245.6	254.0	292.4
		Int. Cap.	—	82.4	111.1	128.2	158.6	220.7	245.6	254.0	292.4
	8000	Capacity	—	92.4	123.9	144.0	185.9	227.2	253.9	262.9	305.0
		Int. Cap.	—	85.0	113.7	131.3	162.9	227.2	253.9	262.9	305.0
	10000	Capacity	—	95.0	126.6	146.8	189.4	231.2	259.2	268.3	312.7
		Int. Cap.	—	87.4	116.2	133.9	166.0	231.2	259.2	268.3	312.7
70	6000	Capacity	56.8	80.0	111.6	130.7	169.5	208.9	232.7	240.7	276.7
		Int. Cap.	52.6	73.6	102.4	119.2	148.5	208.9	232.7	240.7	276.7
	8000	Capacity	59.5	82.9	114.6	134.2	174.7	215.5	241.1	249.8	289.5
		Int. Cap.	55.0	76.3	105.2	122.4	153.0	215.5	241.1	249.8	289.5
	10000	Capacity	62.3	85.4	117.3	137.1	178.2	219.7	246.3	255.4	297.4
		Int. Cap.	57.6	78.6	107.7	125.0	156.2	219.7	246.3	255.4	297.4
80	6000	Capacity	50.0	72.9	105.0	123.8	161.5	200.9	223.8	231.6	265.9
		Int. Cap.	46.2	67.1	96.3	112.9	141.5	200.9	223.8	231.6	265.9
	8000	Capacity	52.7	76.0	108.0	127.4	167.0	207.7	232.3	240.9	278.8
		Int. Cap.	48.8	69.9	99.1	116.2	146.3	207.7	232.3	240.9	278.8
	10000	Capacity	55.3	78.7	110.9	130.4	170.5	211.9	237.7	246.5	286.9
		Int. Cap.	51.2	72.4	101.8	118.9	149.4	211.9	237.7	246.5	286.9

### LEGEND

- Do Not Operate
- Capacity** — Instantaneous Capacity (1000 Btuh) - includes indoor fan motor heat at AHRI static conditions
- Int. Cap.** — Integrated Capacity = instantaneous capacity minus the effects of frost on the OD coil and the heat required to defrost it
- rh** — Relative Humidity
- db** — Dry Bulb

# Performance data (cont)

## RHV300 Heating Capacities


RHV300 (25 Tons)											
Return Air (°F db)	CFM (Standard Air)		Temperature Air Entering Outdoor Coil (°F db at 70% rh)								
			-10	0	10	17	30	40	47	50	60
55	7500	Capacity	—	121.3	153.9	175.2	219.1	260.4	287.9	297.1	339.8
		Int. Cap.	—	111.6	141.3	159.8	191.9	260.4	287.9	297.1	339.8
	10000	Capacity	—	124.9	157.5	179.1	224.4	267.1	296.4	306.0	351.8
		Int. Cap.	—	114.9	144.6	163.3	196.6	267.1	296.4	306.0	351.8
	12500	Capacity	—	129.0	161.6	183.3	229.2	272.7	302.9	312.8	360.5
		Int. Cap.	—	118.7	148.4	167.1	200.8	272.7	302.9	312.8	360.5
70	7500	Capacity	—	112.9	145.8	166.6	208.9	249.7	275.8	284.4	324.7
		Int. Cap.	—	103.9	133.8	151.9	183.1	249.7	275.8	284.4	324.7
	10000	Capacity	—	116.4	149.5	170.9	214.6	256.5	284.3	293.6	336.8
		Int. Cap.	—	107.1	137.3	155.8	188.0	256.5	284.3	293.6	336.8
	12500	Capacity	—	120.8	153.8	175.4	219.6	262.2	290.8	300.5	345.8
		Int. Cap.	—	111.2	141.2	159.9	192.4	262.2	290.8	300.5	345.8
80	7500	Capacity	—	107.1	140.1	160.6	202.0	242.2	267.6	276.0	314.3
		Int. Cap.	—	98.6	128.5	146.4	177.0	242.2	267.6	276.0	314.3
	10000	Capacity	—	110.9	144.0	164.9	207.9	249.3	276.3	285.3	326.7
		Int. Cap.	—	102.0	132.2	150.3	182.1	249.3	276.3	285.3	326.7
	12500	Capacity	—	114.8	148.5	169.4	212.9	254.9	283.1	292.2	335.9
		Int. Cap.	—	105.7	136.3	154.5	186.5	254.9	283.1	292.2	335.9

### LEGEND


- — Do Not Operate
- Capacity** — Instantaneous Capacity (1000 Btuh) - includes indoor fan motor heat at AHRI static conditions
- Int. Cap.** — Integrated Capacity = instantaneous capacity minus the effects of frost on the OD coil and the heat required to defrost it
- rh** — Relative Humidity
- db** — Dry Bulb

# Performance data (cont)


## Pressure Drop for Electric Heating Units 15 to 25 Ton Units

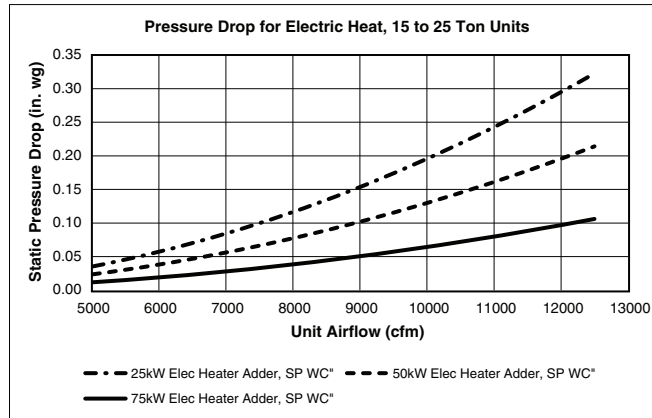

## Static Pressure Drop - Accessory Economizer 15 to 25 Ton Units

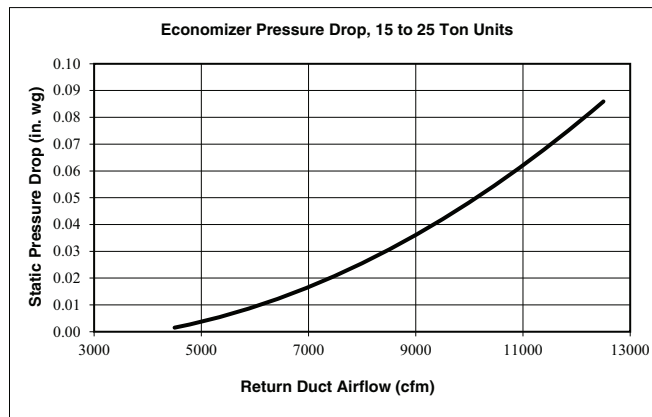

## Outside Air Damper Leakage 15 to 25 Ton Units

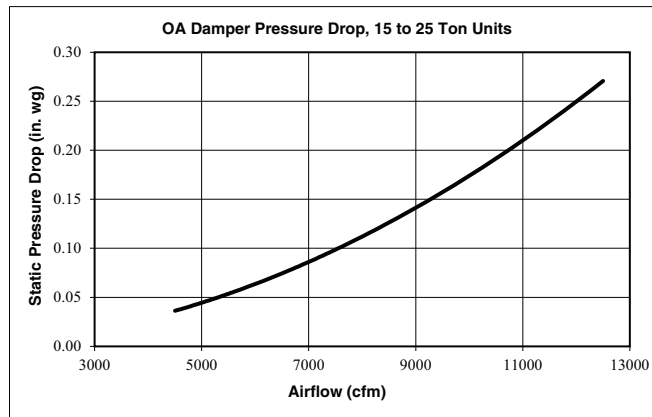

# Fan data

## General Fan Performance Notes

1. Interpolation is permissible. Do not extrapolate.
2. External static pressure is the static pressure difference between the return duct and the supply duct plus the static pressure caused by any FIOPs or accessories.
3. Tabular data accounts for pressure loss due to clean filters, unit casing, and wet coils.
4. Factory options and accessories may effect static pressure losses. Selection software is available, through your salesperson, to help you select the best motor/drive combination for your application.
5. The fan performance tables offer motor/drive recommendations. In cases when two motor/drive combinations would work, the lower horsepower option is recommended.
6. For information on the electrical properties of the fan motors, please see the Electrical information section of this book.
7. For more information on the performance limits of the fan motors, see the application data section of this book.
8. The EPACT (Energy Policy Act of 1992) regulates energy requirements for specific types of indoor fan motors. Motors regulated by EPACT include any general purpose, T-frame (three-digit, 143 and larger), single-speed, foot mounted, polyphase, squirrel cage induction motors of NEMA (National Electrical Manufacturers Association) design A and B, manufactured for use in the United States. Ranging from 1 to 200 Hp, these continuous-duty motors operate on 230 and 460 volt, 60 Hz power. If a motor does not fit into these specifications, the motor does not have to be replaced by an EPACT compliant energy-efficient motor. Variable-speed motors are exempt from EPACT compliance requirements.

# Fan data (cont)

## RHV181 — 15 Ton Vertical Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
4500	936	0.61	1065	0.90	1180	1.23	1285	1.59	1380	1.97
4875	991	0.73	1112	1.03	1224	1.37	1325	1.74	1418	2.14
5250	1048	0.86	1161	1.18	1268	1.53	1366	1.91	1457	2.32
5625	1106	1.02	1211	1.34	1314	1.71	1410	2.11	1498	2.53
6000	1166	1.19	1263	1.52	1362	1.90	1454	2.31	1540	2.75
6375	1226	1.38	1317	1.72	1410	2.11	1499	2.53	1584	2.99
6750	1287	1.59	1371	1.93	1460	2.33	1546	2.76	1628	3.23
7125	1349	1.82	1428	2.16	1511	2.56	1594	3.01	1674	3.48
7500	1412	2.07	1485	2.40	1563	2.80	1643	3.26	1721	3.74

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
4500	1470	2.38	1554	2.81	1634	3.27	1710	3.74	1782	4.24
4875	1505	2.55	1588	3.00	1666	3.46	1741	3.95	1812	4.46
5250	1542	2.75	1623	3.21	1700	3.69	1773	4.18	1844	4.71
5625	1581	2.97	1660	3.44	1735	3.93	1807	4.44	1876	4.97
6000	1622	3.21	1699	3.69	1772	4.19	1843	4.71	1911	5.25
6375	1663	3.46	1739	3.95	1811	4.46	1880	4.99	1946	5.54
6750	1706	3.71	1780	4.22	1850	4.74	1918	5.28	1983	5.83
7125	1750	3.98	1822	4.49	1891	5.02	1958	5.57	2022	6.14
7500	1794	4.24	1866	4.77	1933	5.30	1999	5.86	—	—

Std/Med Static 936-2000 rpm, 4.8 Max bhp (2.4 Max bhp per fan motor)

High Static 936-2200 rpm, 6.0 Max bhp (3.0 Max bhp per fan motor)

## RHV181 – Standard/Medium Static — 15 Ton Vertical Supply (rpm - Vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
4500	936	4.5	1065	5.2	1180	5.8	1285	6.3	1380	6.8
4875	991	4.8	1112	5.4	1224	6.0	1325	6.5	1418	7.0
5250	1048	5.1	1161	5.7	1268	6.2	1366	6.7	1457	7.2
5625	1106	5.4	1211	5.9	1314	6.5	1410	7.0	1498	7.4
6000	1166	5.7	1263	6.2	1362	6.7	1454	7.2	1540	7.6
6375	1226	6.0	1317	6.5	1410	7.0	1499	7.4	1584	7.9
6750	1287	6.3	1371	6.8	1460	7.2	1546	7.7	1628	8.1
7125	1349	6.7	1428	7.1	1511	7.5	1594	7.9	1674	8.3
7500	1412	7.0	1485	7.4	1563	7.8	1643	8.2	1721	8.6

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
4500	1470	7.3	1554	7.7	1634	8.1	1710	8.5	1782	8.9
4875	1505	7.5	1588	7.9	1666	8.3	1741	8.7	1812	9.0
5250	1542	7.6	1623	8.1	1700	8.5	1773	8.8	1844	9.2
5625	1581	7.8	1660	8.3	1735	8.6	1807	9.0	1876	9.4
6000	1622	8.1	1699	8.5	1772	8.8	1843	9.2	—	—
6375	1663	8.3	1739	8.7	1811	9.0	1880	9.4	—	—
6750	1706	8.5	1780	8.9	1850	9.2	—	—	—	—
7125	1750	8.7	1822	9.1	1891	9.4	—	—	—	—
7500	1794	8.9	1866	9.3	—	—	—	—	—	—

Std/Med Static 936-2000 rpm

# Fan data (cont)

## RHV181 – High Static — 15 Ton Vertical Supply (rpm - Vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
4500	936	4.2	1065	4.8	1180	5.3	1285	5.8	1380	6.2
4875	991	4.4	1112	5.0	1224	5.5	1325	6.0	1418	6.4
5250	1048	4.7	1161	5.2	1268	5.7	1366	6.2	1457	6.6
5625	1106	5.0	1211	5.4	1314	5.9	1410	6.4	1498	6.8
6000	1166	5.2	1263	5.7	1362	6.1	1454	6.6	1540	7.0
6375	1226	5.5	1317	5.9	1410	6.4	1499	6.8	1584	7.2
6750	1287	5.8	1371	6.2	1460	6.6	1546	7.0	1628	7.4
7125	1349	6.1	1428	6.4	1511	6.8	1594	7.2	1674	7.6
7500	1412	6.4	1485	6.7	1563	7.1	1643	7.4	1721	7.8

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
4500	1470	6.6	1554	7.0	1634	7.4	1710	7.7	1782	8.1
4875	1505	6.8	1588	7.2	1666	7.5	1741	7.9	1812	8.2
5250	1542	7.0	1623	7.3	1700	7.7	1773	8.0	1844	8.4
5625	1581	7.1	1660	7.5	1735	7.9	1807	8.2	1876	8.5
6000	1622	7.3	1699	7.7	1772	8.0	1843	8.4	1911	8.7
6375	1663	7.5	1739	7.9	1811	8.2	1880	8.5	1946	8.8
6750	1706	7.7	1780	8.1	1850	8.4	1918	8.7	1983	9.0
7125	1750	7.9	1822	8.3	1891	8.6	1958	8.9	2022	9.2
7500	1794	8.1	1866	8.5	1933	8.8	1999	9.1	—	—

High Static 936-2200 rpm

# Fan data (cont)

## RHV240 — 20 Ton Vertical Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6000	1038	0.84	1148	1.14	1251	1.47	1351	1.86	1448	2.28
6500	1103	1.01	1207	1.32	1304	1.66	1398	2.05	1490	2.48
7000	1169	1.19	1269	1.52	1360	1.87	1448	2.26	1535	2.69
7500	1234	1.38	1332	1.74	1418	2.09	1501	2.48	1583	2.91
8000	1299	1.58	1395	1.95	1478	2.32	1557	2.72	1634	3.14
8500	1364	1.78	1459	2.18	1540	2.56	1615	2.95	1689	3.37
9000	1427	1.97	1524	2.40	1602	2.79	1674	3.18	1745	3.60
9500	1491	2.17	1589	2.62	1665	3.02	1735	3.41	1802	3.83
10000	1553	2.36	1653	2.84	1729	3.25	1797	3.65	1862	4.06

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6000	1539	2.74	1624	3.22	1703	3.72	1777	4.22	1847	4.74
6500	1578	2.95	1662	3.44	1741	3.96	1816	4.49	1887	5.04
7000	1619	3.16	1701	3.66	1779	4.19	1854	4.74	1924	5.30
7500	1663	3.38	1742	3.88	1818	4.41	1892	4.97	1962	5.55
8000	1711	3.60	1786	4.10	1859	4.62	1931	5.18	2000	5.76
8500	1761	3.83	1832	4.31	1903	4.83	1972	5.37	2039	5.94
9000	1813	4.04	1882	4.52	1949	5.02	2015	5.55	2081	6.11
9500	1868	4.26	1933	4.72	1998	5.21	2061	5.72	2124	6.27
10000	1925	4.49	1987	4.94	2049	5.41	2110	5.91	2170	6.43

Std/Med Static 1038-2000 rpm, 4.8 Max bhp (2.4 Max bhp per fan motor)

High Static 1038-2200 rpm, 10.0 Max bhp (5.0 Max bhp per fan motor)

## RHV240 – Standard/Medium Static — 20 Ton Vertical Supply (rpm - Vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
6000	1038	5.1	1148	5.6	1251	6.1	1351	6.7	1448	7.2
6500	1103	5.4	1207	5.9	1304	6.4	1398	6.9	1490	7.4
7000	1169	5.7	1269	6.2	1360	6.7	1448	7.2	1535	7.6
7500	1234	6.1	1332	6.6	1418	7.0	1501	7.4	1583	7.9
8000	1299	6.4	1395	6.9	1478	7.3	1557	7.7	1634	8.1
8500	1364	6.7	1459	7.2	1540	7.6	1615	8.0	1689	8.4
9000	1427	7.1	1524	7.6	1602	8.0	1674	8.3	1745	8.7
9500	1491	7.4	1589	7.9	1665	8.3	1735	8.6	1802	9.0
10000	1553	7.7	1653	8.2	1729	8.6	1797	9.0	1862	9.3

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
6000	1539	7.6	1624	8.1	1703	8.5	1777	8.9	1847	9.2
6500	1578	7.8	1662	8.3	1741	8.7	1816	9.1	1887	9.4
7000	1619	8.0	1701	8.5	1779	8.9	1854	9.2	—	—
7500	1663	8.3	1742	8.7	1818	9.1	1892	9.4	—	—
8000	1711	8.5	1786	8.9	1859	9.3	—	—	—	—
8500	1761	8.8	1832	9.1	1903	9.5	—	—	—	—
9000	1813	9.0	1882	9.4	1949	9.7	—	—	—	—
9500	1868	9.3	1933	9.7	—	—	—	—	—	—
10000	1925	9.6	1987	9.9	—	—	—	—	—	—

Std/Med Static 1038-2000 rpm

# Fan data (cont)

## RHV240 – High Static — 20 Ton Vertical Supply (rpm - Vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
6000	1038	4.6	1148	5.1	1251	5.6	1351	6.1	1448	6.5
6500	1103	4.9	1207	5.4	1304	5.9	1398	6.3	1490	6.7
7000	1169	5.2	1269	5.7	1360	6.1	1448	6.5	1535	6.9
7500	1234	5.5	1332	6.0	1418	6.4	1501	6.8	1583	7.2
8000	1299	5.8	1395	6.3	1478	6.7	1557	7.0	1634	7.4
8500	1364	6.1	1459	6.6	1540	7.0	1615	7.3	1689	7.6
9000	1427	6.4	1524	6.9	1602	7.2	1674	7.6	1745	7.9
9500	1491	6.7	1589	7.2	1665	7.5	1735	7.9	1802	8.2
10000	1553	7.0	1653	7.5	1729	7.8	1797	8.1	1862	8.4

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
6000	1539	6.9	1624	7.3	1703	7.7	1777	8.0	1847	8.4
6500	1578	7.1	1662	7.5	1741	7.9	1816	8.2	1887	8.6
7000	1619	7.3	1701	7.7	1779	8.1	1854	8.4	1924	8.7
7500	1663	7.5	1742	7.9	1818	8.2	1892	8.6	1962	8.9
8000	1711	7.7	1786	8.1	1859	8.4	1931	8.8	2000	9.1
8500	1761	8.0	1832	8.3	1903	8.6	1972	8.9	2039	9.3
9000	1813	8.2	1882	8.5	1949	8.8	2015	9.1	2081	9.5
9500	1868	8.5	1933	8.8	1998	9.1	2061	9.4	2124	9.6
10000	1925	8.7	1987	9.0	2049	9.3	2110	9.6	2170	9.9

High Static 1038-2200 rpm

# Fan data (cont)

## RHV300 — 25 Ton Vertical Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
7500	1099	1.27	1174	1.55	1256	1.90	1343	2.32	1433	2.82
8125	1177	1.58	1246	1.87	1319	2.22	1397	2.64	1479	3.13
8750	1256	1.92	1319	2.23	1385	2.58	1456	3.00	1530	3.48
9375	1337	2.32	1394	2.63	1455	2.99	1519	3.40	1586	3.87
10000	1417	2.74	1471	3.06	1526	3.42	1585	3.83	1646	4.29
10625	1498	3.18	1548	3.51	1600	3.88	1654	4.28	1710	4.73
11250	1579	3.65	1626	3.98	1675	4.36	1725	4.76	1777	5.20
11875	1661	4.17	1705	4.51	1751	4.88	1798	5.29	1846	5.72
12500	1743	4.78	1785	5.14	1828	5.52	1872	5.93	1917	6.37

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
7500	1521	3.38	1604	3.96	1683	4.58	1757	5.21	1828	5.86
8125	1561	3.68	1642	4.28	1720	4.92	1794	5.58	1864	6.26
8750	1606	4.02	1683	4.63	1758	5.28	1830	5.95	1900	6.66
9375	1655	4.40	1727	5.00	1798	5.64	1869	6.33	1937	7.05
10000	1710	4.81	1776	5.39	1843	6.02	1910	6.70	1976	7.42
10625	1769	5.24	1829	5.79	1891	6.40	1954	7.06	2018	7.78
11250	1831	5.69	1887	6.23	1944	6.81	2003	7.45	2063	8.14
11875	1896	6.20	1948	6.72	2001	7.29	2056	7.90	2111	8.56
12500	1964	6.85	2012	7.36	2061	7.91	2112	8.51	2164	9.16

Std/Med Static 1099-2000 rpm, 6.0 Max bhp (3.0 Max bhp per fan motor)

High Static 1099-2200 rpm, 10.0 Max bhp (5.0 Max bhp per fan motor)

## RHV300 – Standard/Medium Static — 25 Ton Vertical Supply (rpm - Vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
7500	1099	4.9	1174	5.3	1256	5.6	1343	6.0	1433	6.5
8125	1177	5.3	1246	5.6	1319	5.9	1397	6.3	1479	6.7
8750	1256	5.6	1319	5.9	1385	6.2	1456	6.6	1530	6.9
9375	1337	6.0	1394	6.3	1455	6.6	1519	6.9	1586	7.2
10000	1417	6.4	1471	6.6	1526	6.9	1585	7.2	1646	7.4
10625	1498	6.8	1548	7.0	1600	7.2	1654	7.5	1710	7.7
11250	1579	7.1	1626	7.4	1675	7.6	1725	7.8	1777	8.0
11875	1661	7.5	1705	7.7	1751	7.9	1798	8.1	1846	8.4
12500	1743	7.9	1785	8.1	1828	8.3	1872	8.5	1917	8.7

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
7500	1521	6.9	1604	7.2	1683	7.6	1757	8.0	1828	8.3
8125	1561	7.1	1642	7.4	1720	7.8	1794	8.1	1864	8.4
8750	1606	7.3	1683	7.6	1758	8.0	1830	8.3	—	—
9375	1655	7.5	1727	7.8	1798	8.1	1869	8.5	—	—
10000	1710	7.7	1776	8.0	1843	8.4	—	—	—	—
10625	1769	8.0	1829	8.3	1891	8.6	—	—	—	—
11250	1831	8.3	1887	8.6	—	—	—	—	—	—
11875	1896	8.6	—	—	—	—	—	—	—	—
12500	—	—	—	—	—	—	—	—	—	—

Std/Med Static 1099-2000 rpm

# Fan data (cont)

## RHV300 – High Static — 25 Ton Vertical Supply (rpm - Vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
7500	1099	4.9	1174	5.3	1256	5.6	1343	6.0	1433	6.5
8125	1177	5.3	1246	5.6	1319	5.9	1397	6.3	1479	6.7
8750	1256	5.6	1319	5.9	1385	6.2	1456	6.6	1530	6.9
9375	1337	6.0	1394	6.3	1455	6.6	1519	6.9	1586	7.2
10000	1417	6.4	1471	6.6	1526	6.9	1585	7.2	1646	7.4
10625	1498	6.8	1548	7.0	1600	7.2	1654	7.5	1710	7.7
11250	1579	7.1	1626	7.4	1675	7.6	1725	7.8	1777	8.0
11875	1661	7.5	1705	7.7	1751	7.9	1798	8.1	1846	8.4
12500	1743	7.9	1785	8.1	1828	8.3	1872	8.5	1917	8.7

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
7500	1521	6.9	1604	7.2	1683	7.6	1757	8.0	1828	8.3
8125	1561	7.1	1642	7.4	1720	7.8	1794	8.1	1864	8.4
8750	1606	7.3	1683	7.6	1758	8.0	1830	8.3	1900	8.6
9375	1655	7.5	1727	7.8	1798	8.1	1869	8.5	1937	8.8
10000	1710	7.7	1776	8.0	1843	8.4	1910	8.7	1976	9.0
10625	1769	8.0	1829	8.3	1891	8.6	1954	8.9	2018	9.2
11250	1831	8.3	1887	8.6	1944	8.8	2003	9.1	2063	9.4
11875	1896	8.6	1948	8.8	2001	9.1	2056	9.3	2111	9.6
12500	1964	8.9	2012	9.1	2061	9.4	2112	9.6	2164	9.8

High Static 1099-2200 rpm

# Fan data (cont)

## RHV181 — 15 Ton Horizontal Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
4500	1055	0.71	1171	0.97	1279	1.26	1379	1.58	1472	1.92
4875	1122	0.85	1231	1.12	1334	1.43	1430	1.76	1520	2.11
5250	1190	1.01	1293	1.30	1390	1.61	1482	1.95	1569	2.32
5625	1259	1.19	1356	1.49	1448	1.81	1536	2.16	1621	2.54
6000	1329	1.39	1420	1.69	1508	2.03	1592	2.39	1674	2.78
6375	1399	1.60	1486	1.92	1570	2.26	1650	2.63	1728	3.02
6750	1470	1.83	1553	2.16	1632	2.51	1710	2.89	1785	3.28
7125	1541	2.08	1620	2.42	1696	2.77	1770	3.15	1842	3.56
7500	1612	2.34	1688	2.69	1761	3.06	1832	3.44	1902	3.85

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
4500	1560	2.29	1642	2.67	1721	3.29	1796	3.74	1870	4.22
4875	1605	2.49	1685	2.88	1762	3.29	1835	3.99	1906	4.47
5250	1652	2.70	1730	3.10	1805	3.53	1877	4.27	1946	4.75
5625	1701	2.94	1777	3.35	1850	3.78	1920	4.57	1988	5.07
6000	1751	3.18	1826	3.60	1897	4.04	1966	4.90	2032	5.41
6375	1803	3.43	1876	3.86	1945	4.31	2013	5.26	2078	5.79
6750	1857	3.70	1927	4.13	1995	4.59	2061	5.65	2125	6.19
7125	1913	3.98	1981	4.42	2047	4.88	2111	6.07	2173	6.62
7500	1969	4.27	2035	4.72	2099	5.18	2162	6.52	—	—

High Static 1055-2200 rpm, 10.0 Max bhp (5.0 Max bhp per fan motor)

## RHV181 – High Static — 15 Ton Horizontal Supply (rpm - Vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
4500	1055	4.7	1171	5.3	1279	5.7	1379	6.2	1472	6.6
4875	1122	5.0	1231	5.5	1334	6.0	1430	6.4	1520	6.9
5250	1190	5.3	1293	5.8	1390	6.3	1482	6.7	1569	7.1
5625	1259	5.7	1356	6.1	1448	6.5	1536	6.9	1621	7.3
6000	1329	6.0	1420	6.4	1508	6.8	1592	7.2	1674	7.6
6375	1399	6.3	1486	6.7	1570	7.1	1650	7.5	1728	7.8
6750	1470	6.6	1553	7.0	1632	7.4	1710	7.7	1785	8.1
7125	1541	7.0	1620	7.3	1696	7.7	1770	8.0	1842	8.3
7500	1612	7.3	1688	7.6	1761	8.0	1832	8.3	1902	8.6

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
4500	1560	7.0	1642	7.4	1721	7.8	1796	8.1	1870	8.5
4875	1605	7.3	1685	7.6	1762	8.0	1835	8.3	1906	8.6
5250	1652	7.5	1730	7.8	1805	8.2	1877	8.5	1946	8.8
5625	1701	7.7	1777	8.0	1850	8.4	1920	8.7	1988	9.0
6000	1751	7.9	1826	8.3	1897	8.6	1966	8.9	2032	9.2
6375	1803	8.2	1876	8.5	1945	8.8	2013	9.1	2078	9.4
6750	1857	8.4	1927	8.7	1995	9.1	2061	9.4	2125	9.7
7125	1913	8.7	1981	9.0	2047	9.3	2111	9.6	2173	9.9
7500	1969	8.9	2035	9.2	2099	9.5	2162	9.8	—	—

High Static 1055-2200 rpm

# Fan data (cont)

## RHV240 — 20 Ton Horizontal Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6000	1267	1.20	1361	1.49	1451	1.81	1538	2.15	1621	2.52
6500	1356	1.45	1443	1.75	1527	2.07	1609	2.43	1688	2.80
7000	1446	1.73	1527	2.04	1606	2.37	1683	2.73	1758	3.11
7500	1537	2.03	1612	2.35	1687	2.69	1760	3.05	1831	3.44
8000	1628	2.36	1699	2.68	1769	3.03	1838	3.40	1906	3.79
8500	1719	2.71	1786	3.04	1853	3.40	1918	3.77	1983	4.16
9000	1811	3.09	1875	3.43	1938	3.79	2000	4.17	2061	4.56
9500	1904	3.50	1964	3.85	2024	4.21	2083	4.59	2142	4.99
10000	1997	3.94	2054	4.29	2111	4.66	2167	5.04	—	—

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
6000	1700	2.90	1777	3.32	1850	3.74	1921	4.19	1989	4.65
6500	1764	3.20	1838	3.62	1909	4.05	1977	4.50	2043	4.97
7000	1831	3.51	1901	3.93	1970	4.37	2036	4.83	2100	5.30
7500	1900	3.84	1968	4.27	2033	4.71	2098	5.17	2160	5.64
8000	1972	4.20	2037	4.63	2100	5.07	2162	5.53	—	—
8500	2046	4.57	2108	5.00	2169	5.45	—	—	—	—
9000	2122	4.97	2181	5.40	—	—	—	—	—	—
9500	2199	5.40	—	—	—	—	—	—	—	—
10000	—	—	—	—	—	—	—	—	—	—

High Static 1267-2200 rpm, 10.0 Max bhp (5.0 Max bhp per fan motor)

## RHV240 – High Static — 20 Ton Horizontal Supply (rpm - Vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
6000	1267	5.7	1361	6.1	1451	6.5	1538	6.9	1621	7.3
6500	1356	6.1	1443	6.5	1527	6.9	1609	7.3	1688	7.6
7000	1446	6.5	1527	6.9	1606	7.3	1683	7.6	1758	8.0
7500	1537	6.9	1612	7.3	1687	7.6	1760	8.0	1831	8.3
8000	1628	7.4	1699	7.7	1769	8.0	1838	8.3	1906	8.6
8500	1719	7.8	1786	8.1	1853	8.4	1918	8.7	1983	9.0
9000	1811	8.2	1875	8.5	1938	8.8	2000	9.1	2061	9.4
9500	1904	8.6	1964	8.9	2024	9.2	2083	9.5	2142	9.7
10000	1997	9.1	2054	9.3	2111	9.6	2167	9.8	—	—

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
6000	1700	7.7	1777	8.0	1850	8.4	1921	8.7	1989	9.0
6500	1764	8.0	1838	8.3	1909	8.7	1977	9.0	2043	9.3
7000	1831	8.3	1901	8.6	1970	8.9	2036	9.2	2100	9.5
7500	1900	8.6	1968	8.9	2033	9.2	2098	9.5	2160	9.8
8000	1972	8.9	2037	9.2	2100	9.5	2162	9.8	—	—
8500	2046	9.3	2108	9.6	2169	9.9	—	—	—	—
9000	2122	9.6	2181	9.9	—	—	—	—	—	—
9500	2199	10.0	—	—	—	—	—	—	—	—
10000	—	—	—	—	—	—	—	—	—	—

High Static 1267-2200 rpm

# Fan data (cont)

## RHV300 — 25 Ton Horizontal Supply (rpm - bhp)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
7500	1406	2.11	1483	2.47	1559	2.87	1636	3.32	1711	3.80
8125	1509	2.60	1580	2.98	1651	3.40	1722	3.86	1792	4.35
8750	1614	3.16	1679	3.56	1744	3.98	1810	4.45	1876	4.96
9375	1719	3.78	1779	4.19	1840	4.63	1902	5.11	1963	5.62
10000	1824	4.44	1880	4.87	1938	5.33	1995	5.81	2053	6.34
10625	1930	5.16	1983	5.60	2036	6.06	2091	6.56	2145	7.09
11250	2036	5.91	2086	6.35	2137	6.83	2187	7.32	—	—
11875	2143	6.67	2190	7.12	—	—	—	—	—	—
12500	—	—	—	—	—	—	—	—	—	—

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp	rpm	bhp
7500	1783	4.30	1853	4.82	1921	5.37	1986	5.94	2048	6.51
8125	1861	4.87	1928	5.42	1993	5.98	2055	6.56	2116	7.16
8750	1941	5.49	2005	6.05	2067	6.63	2128	7.24	2187	7.86
9375	2024	6.16	2085	6.74	2144	7.33	—	—	—	—
10000	2111	6.89	2168	7.46	—	—	—	—	—	—
10625	2199	7.63	—	—	—	—	—	—	—	—
11250	—	—	—	—	—	—	—	—	—	—
11875	—	—	—	—	—	—	—	—	—	—
12500	—	—	—	—	—	—	—	—	—	—

High Static 1406-2200 rpm, 10.0 Max bhp (5.0 Max bhp per fan motor)

## RHV300 – High Static — 25 Ton Horizontal Supply (rpm - Vdc)

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	0.2		0.4		0.6		0.8		1.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
7500	1406	6.3	1483	6.7	1559	7.0	1636	7.4	1711	7.7
8125	1509	6.8	1580	7.1	1651	7.5	1722	7.8	1792	8.1
8750	1614	7.3	1679	7.6	1744	7.9	1810	8.2	1876	8.5
9375	1719	7.8	1779	8.1	1840	8.3	1902	8.6	1963	8.9
10000	1824	8.3	1880	8.5	1938	8.8	1995	9.1	2053	9.3
10625	1930	8.8	1983	9.0	2036	9.2	2091	9.5	2145	9.7
11250	2036	9.2	2086	9.5	2137	9.7	2187	9.9	—	—
11875	2143	9.7	2190	10.0	—	—	—	—	—	—
12500	—	—	—	—	—	—	—	—	—	—

CFM	AVAILABLE EXTERNAL STATIC PRESSURE (in. wg)									
	1.2		1.4		1.6		1.8		2.0	
	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc	rpm	Vdc
7500	1783	8.1	1853	8.4	1921	8.7	1986	9.0	2048	9.3
8125	1861	8.4	1928	8.7	1993	9.0	2055	9.3	2116	9.6
8750	1941	8.8	2005	9.1	2067	9.4	2128	9.7	2187	9.9
9375	2024	9.2	2085	9.5	2144	9.7	—	—	—	—
10000	2111	9.6	2168	9.9	—	—	—	—	—	—
10625	2199	10.0	—	—	—	—	—	—	—	—
11250	—	—	—	—	—	—	—	—	—	—
11875	—	—	—	—	—	—	—	—	—	—
12500	—	—	—	—	—	—	—	—	—	—

High Static 1406-2200 rpm

# Electrical data

## Legend and Notes

Applicable for Electrical Data Tables on pages 43 to 52

### LEGEND


<b>BRKR</b>	—	Circuit Breaker
<b>C.O.</b>	—	Convenience Outlet
<b>FLA</b>	—	Full Load Amps
<b>IFM</b>	—	Indoor Fan Motor
<b>LRA</b>	—	Locked Rotor Amps
<b>MCA</b>	—	Minimum Circuit Amps
<b>P.E.</b>	—	Power Exhaust
<b>PWRD C.O.</b>	—	Powered Convenience Outlet
<b>RLA</b>	—	Rated Load Amps
<b>SCCR</b>	—	Short Circuit Current Rating
<b>UNPWR C.O.</b>	—	Unpowered Convenience Outlet

### NOTES:

1. In compliance with NEC requirements for multi-motor and combination load equipment (refer to NEC Articles 430 and 440), the overcurrent protective device for the unit shall be fuse or HACR breaker. Canadian units may be fuse or circuit breaker.
2. For 208/230 v units, where one value is show it is the same for either 208 or 230 volts.
3. **Unbalanced 3-Phase Supply Voltage:** Never operate a motor where a phase imbalance in supply voltage is greater than 2%. Use the following formula to determine the percentage of voltage imbalance.

$$\% \text{ Voltage Imbalance} = 100 \times \frac{\text{max voltage deviation from average voltage}}{\text{average voltage}}$$

Example: Supply voltage is 230-3-60



AB = 224-v  
BC = 231-v  
AC = 226-v

$$\text{Average Voltage} = \frac{(224 + 231 + 226)}{3} = \frac{681}{3} = 227$$

Determine maximum deviation from average voltage.

(AB) 227-224 = 3-v

(BC) 231-227 = 4-v

(AC) 227-226 = 1-v

Maximum deviation is 4-v.

Determine percent of voltage imbalance.

$$\% \text{ Voltage Imbalance} = 100 \times \frac{4}{227} = 1.78\%$$

This amount of phase imbalance is satisfactory as it is below the maximum allowable 2%.

**IMPORTANT:** If the supply voltage phase imbalance is more than 2%, contact your local electric utility company immediately.

# Electrical data (cont)

## RHV181-300 Cooling Electrical Data

RHV UNIT SIZE	V-Ph-Hz	UNIT VOLTAGE		COMP 1		COMP 2		OFM (EA)		IFM		
		RANGE		RLA	LRA	RLA	LRA	WATTS	FLA	TYPE	EFFCY AT FULL LOAD	FLA
		MIN	MAX									
RHV181 Vertical	208-3-60	187	253	28.2	240	19.6	136	350	1.5	STD/MED HIGH	90.0%	6.4 7.5
	230-3-60	187	253	28.2	240	19.6	136	350	1.5	STD/MED HIGH	90.0%	6.4 7.5
	460-3-60	414	506	14.7	130	8.2	66	277	0.9	STD/MED HIGH	90.0%	3.0 3.5
	575-3-60	518	633	11.3	94	6.6	55	397	0.6	STD/MED HIGH	90.0%	2.5 3.0
RHV181 Horizontal	208-3-60	187	253	28.2	240	19.6	136	350	1.5	HIGH	90.0%	12.6
	230-3-60	187	253	28.2	240	19.6	136	350	1.5	HIGH	90.0%	12.6
	460-3-60	414	506	14.7	130	8.2	66	277	0.9	HIGH	90.0%	5.6
	575-3-60	518	633	11.3	94	6.6	55	397	0.6	HIGH	90.0%	4.6
RHV240 Vertical	208-3-60	187	253	34.0	240	34.0	240	397	1.9	STD/MED HIGH	90.0%	6.4 12.6
	230-3-60	187	253	34.0	240	34.0	240	397	1.9	STD/MED HIGH	90.0%	6.4 12.6
	460-3-60	414	506	16.0	140	16.0	140	397	0.9	STD/MED HIGH	90.0%	3.0 5.6
	575-3-60	518	633	12.9	108	12.9	108	397	0.7	STD/MED HIGH	90.0%	2.5 4.6
RHV240 Horizontal	208-3-60	187	253	34.0	240	34.0	240	397	1.9	HIGH	90.0%	12.6
	230-3-60	187	253	34.0	240	34.0	240	397	1.9	HIGH	90.0%	12.6
	460-3-60	414	506	16.0	140	16.0	140	397	0.9	HIGH	90.0%	5.6
	575-3-60	518	633	12.9	1085	12.9	1085	397	0.7	HIGH	90.0%	4.6
RHV300 Vertical	208-3-60	187	253	51.3	300	48.1	245	350	1.9	STD/MED HIGH	90.0%	7.5 12.6
	230-3-60	187	253	51.3	300	48.1	245	350	1.9	STD/MED HIGH	90.0%	7.5 12.6
	460-3-60	414	506	22.4	150	18.6	125	277	0.9	STD/MED HIGH	90.0%	3.5 5.6
	575-3-60	518	633	19.9	109	14.7	100	397	0.7	STD/MED HIGH	90.0%	3.0 4.6
RHV300 Horizontal	208-3-60	187	253	51.3	300	48.1	245	397	1.9	HIGH	90.0%	12.6
	230-3-60	187	253	51.3	300	48.1	245	397	1.9	HIGH	90.0%	12.6
	460-3-60	414	506	22.4	150	18.6	125	397	0.9	HIGH	90.0%	5.6
	575-3-60	518	633	19.9	109	14.7	100	397	0.7	HIGH	90.0%	4.6

# Electrical data (cont)

## RHV181 MCA MOCAP Electrical Data

RHV UNIT SIZE	NOM. V-PH-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			NO CONVENIENCE OUTLET or UNPOWERED CONVENIENCE OUTLET							
				CRHEATER ****00	NOM (kW)	FLA	NO POWER EXHAUST				w/ POWER EXHAUST (powered from unit)			
							MCA	FUSE OR HACR BRKR	DISCONNECT SIZE		MCA	FUSE OR HACR BRKR	DISCONNECT SIZE	
									FLA	LRA			FLA	LRA
RHV181 Vertical	208/230-3-60	STD/MED	5	—	—	—	72	100	75	403	84	100	88	423
				454A	18.8/25.0	52.1/60.1	137/147	150/150	135/144	455/463	149/159	150/175	148/158	475/483
				455A	37.6/50.0	104.2/120.3	202/192	225/200	195/213	507/523	214/204	225/225	208/227	527/543
		456A	56.3/75.0	156.4/180.4	229/253	250/300	255/282	559/583	240/264	250/300	268/296	579/603		
		HIGH	5	—	—	—	74	100	77	407	86	100	91	427
				454A	18.8/25.0	52.1/60.1	140/150	150/150	137/147	459/467	151/161	175/175	151/160	479/487
	455A			37.6/50.0	104.2/120.3	205/195	225/225	197/216	511/527	216/206	225/225	211/229	531/547	
	456A	56.3/75.0	156.4/180.4	231/255	250/300	257/285	563/587	243/267	250/300	271/298	583/607			
	460-3-60	STD/MED	5	—	—	—	35	45	36	210	42	50	43	222
				457A	25.0	30.1	73	80	71	240	79	80	78	252
				458A	50.0	60.1	95	100	105	270	102	110	113	282
		459A	75.0	90.2	126	150	140	300	132	150	147	312		
		HIGH	5	—	—	—	36	50	37	212	42	50	45	224
				457A	25.0	30.1	74	80	72	242	80	90	79	254
	458A			50.0	60.1	96	110	107	272	103	110	114	284	
	459A	75.0	90.2	126	150	141	302	133	150	148	314			
	575-3-60	STD/MED	5	—	—	—	28	35	28	163	32	40	34	171
				460A	24.8	23.9	57	60	56	187	62	70	61	195
				461A	49.6	47.7	87	90	83	211	92	100	89	219
		462A	74.4	71.6	99	110	111	235	104	110	116	243		
		HIGH	5	—	—	—	28	35	30	163	33	40	35	171
				460A	24.8	23.9	58	60	57	187	63	70	63	195
	461A			49.6	47.7	88	90	84	211	93	100	90	219	
	462A	74.4	71.6	100	110	112	235	105	110	117	243			
RHV181 Horizontal	208/230-3-60	HIGH	5	—	—	—	85	100	89	421	96	110	103	441
				463A	18.8/25.0	52.1/60.1	150/160	150/175	149/158	473/481	162/172	175/175	163/172	493/501
				464A	37.6/50.0	104.2/120.3	215/205	225/225	209/227	525/541	227/217	250/225	223/241	545/561
				465A	56.3/75.0	156.4/180.4	241/265	250/300	269/297	577/601	253/277	300/300	283/310	597/621
	460-3-60	HIGH	5	—	—	—	40	50	42	218	47	60	49	230
				466A	25.0	30.1	78	80	77	248	84	90	84	260
				467A	50.0	60.1	101	110	111	278	107	125	119	290
				468A	75.0	90.2	131	150	146	308	137	150	153	320
	575-3-60	HIGH	5	—	—	—	32	40	33	167	36	45	39	175
				469A	24.8	23.9	62	70	61	191	66	70	66	199
				470A	49.6	47.7	91	100	88	215	96	100	94	223
				471A	74.4	71.6	103	110	116	239	108	125	121	247

# Electrical data (cont)

## RHV181 MCA MOCP Electrical Data (cont)

RHV UNIT SIZE	RHM NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			w/ POWERED CONVENIENCE OUTLET								
				CRHEATER ****00	NOM (kW)	FLA	NO POWER EXHAUST				w/ POWER EXHAUST (powered from unit)				
							MCA	FUSE OR HACR BRKR	DISCONNECT SIZE		MCA	FUSE OR HACR BRKR	DISCONNECT SIZE		
									FLA	LRA			FLA	LRA	
RHV181 Vertical	208/230-3-60	STD/MED	5	—	—	—	77	100	80	408	89	100	94	428	
				454A	18.8/25.0	52.1/60.1	142/152	150/175	140/150	460/468	154/164	175/175	154/163	480/488	
				455A	37.6/50.0	104.2/120.3	207/197	225/225	200/219	512/528	219/209	225/225	214/232	532/548	
		456A	56.3/75.0	156.4/180.4	233/257	250/300	260/288	564/588	245/269	300/300	274/301	584/608			
		HIGH	5	—	—	—	79	100	83	412	91	100	96	432	
				454A	18.8/25.0	52.1/60.1	144/154	150/175	143/152	464/472	156/166	175/175	156/166	484/492	
	455A			37.6/50.0	104.2/120.3	209/200	225/225	203/221	516/532	221/211	225/225	216/235	536/552		
	460-3-60	STD/MED	5	—	—	—	38	50	39	212	44	50	46	224	
				457A	25.0	30.1	75	80	73	242	81	90	81	254	
				458A	50.0	60.1	98	110	108	272	104	110	115	284	
		HIGH	5	—	—	—	38	50	40	214	45	50	47	226	
				457A	25.0	30.1	76	80	75	244	82	90	82	256	
				458A	50.0	60.1	99	110	109	274	105	110	116	286	
		459A	75.0	90.2	129	150	144	304	135	150	151	316			
		575-3-60	STD/MED	5	—	—	—	29	40	30	165	34	45	36	173
					460A	24.8	23.9	59	60	58	189	64	70	63	197
					461A	49.6	47.7	89	90	85	213	94	100	91	221
			HIGH	5	—	—	—	30	40	32	165	35	45	37	173
					460A	24.8	23.9	60	70	59	189	65	70	65	197
	461A				49.6	47.7	90	90	86	213	95	100	92	221	
	462A	74.4	71.6	102	110	114	237	107	110	119	245				
	RHV181 Horizontal	208/230-3-60	HIGH	5	—	—	—	89	100	95	426	101	125	108	446
					463A	18.8/25.0	52.1/60.1	154/164	175/175	155/164	478/486	166/176	175/200	168/177	498/506
					464A	37.6/50.0	104.2/120.3	220/210	225/225	214/233	530/546	231/222	250/250	228/247	550/566
465A		56.3/75.0	156.4/180.4	246/270	300/300	275/302	582/606	258/282	300/300	288/316	602/626				
460-3-60		HIGH	5	—	—	—	43	50	45	220	49	60	52	232	
				466A	25.0	30.1	80	90	79	250	86	90	87	262	
				467A	50.0	60.1	103	110	114	280	109	125	121	292	
				468A	75.0	90.2	133	150	149	310	139	150	156	322	
575-3-60		HIGH	5	—	—	—	33	40	35	169	38	45	41	177	
				469A	24.8	23.9	63	70	63	193	68	70	68	201	
				470A	49.6	47.7	93	100	90	217	98	100	96	225	
				471A	74.4	71.6	105	110	118	241	110	125	123	249	

# Electrical data (cont)

## RHV240 MCA MOCOP Electrical Data

RHV UNIT SIZE	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			NO CONVENIENCE OUTLET or UNPOWERED CONVENIENCE OUTLET									
			CRHEATER *****00	NOM (kW)	FLA	NO POWER EXHAUST				w/ POWER EXHAUST (powered from unit)					
						MCA	FUSE OR HACR BRKR	DISCONNECT SIZE		MCA	FUSE OR HACR BRKR	DISCONNECT SIZE			
								FLA	LRA			FLA	LRA		
RHV240 Vertical	208/230-3-60	STD/MED	5	—	—	—	97	125	102	510	109	125	115	530	
				454A	18.8/25.0	52.1/60.1	162/172	175/175	162/171	562/570	174/184	175/200	175/184	582/590	
				455A	37.6/50.0	104.2/120.3	227/217	250/250	221/240	614/630	239/229	250/250	235/254	634/650	
		456A	56.3/75.0	156.4/180.4	253/277	300/300	282/309	666/690	265/289	300/300	295/323	686/710			
		HIGH	5	—	—	—	109	125	116	528	121	150	129	548	
				454A	18.8/25.0	52.1/60.1	174/184	175/200	176/185	580/588	186/196	200/200	189/199	600/608	
	455A			37.6/50.0	104.2/120.3	240/230	250/250	236/254	632/648	251/241	300/250	249/268	652/668		
	460-3-60	STD/MED	5	—	—	—	46	60	48	296	52	60	55	308	
				457A	25.0	30.1	83	90	82	326	89	90	90	338	
				458A	50.0	60.1	106	110	117	356	112	125	124	368	
		459A	75.0	90.2	136	150	152	386	142	150	159	398			
		HIGH	5	—	—	—	51	60	54	304	57	70	61	316	
				457A	25.0	30.1	88	90	88	334	95	100	96	346	
	458A			50.0	60.1	111	125	123	364	117	125	130	376		
	575-3-60	STD/MED	5	—	—	—	37	45	39	232	42	50	44	240	
				460A	24.8	23.9	67	70	66	256	72	80	72	264	
				461A	49.6	47.7	96	100	93	280	101	110	99	288	
		462A	74.4	71.6	108	125	121	304	113	125	127	312			
		HIGH	5	—	—	—	41	50	43	236	46	50	49	244	
				460A	24.8	23.9	71	80	71	260	76	80	76	268	
	461A			49.6	47.7	101	110	98	284	106	110	104	292		
	RHV240 Horizontal	208/230-3-60	HIGH	5	—	—	—	109	125	116	528	121	150	129	548
					463A	18.8/25.0	52.1/60.1	174/184	175/200	176/185	580/588	186/196	200/200	189/199	600/608
					464A	37.6/50.0	104.2/120.3	240/230	250/250	236/254	632/648	251/241	300/250	249/268	652/668
465A			56.3/75.0	156.4/180.4	266/290	300/300	296/323	684/708	278/302	300/350	309/337	704/728			
HIGH			5	—	—	—	51	60	54	304	57	70	61	316	
				466A	25.0	30.1	88	90	88	334	95	100	96	346	
		467A		50.0	60.1	111	125	123	364	117	125	130	376		
460-3-60		HIGH	5	468A	75.0	90.2	141	150	158	394	147	175	165	406	
				—	—	—	41	50	43	236	46	50	49	244	
				469A	24.8	23.9	71	80	71	260	76	80	76	268	
		HIGH	5	470A	49.6	47.7	101	110	98	284	106	110	104	292	
				471A	74.4	71.6	113	125	126	308	117	125	131	316	

# Electrical data (cont)

## RHV240 MCA MOCP Electrical Data (cont)

RHV UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			w/ POWERED CONVENIENCE OUTLET								
				CRHEATER ****00	NOM (kW)	FLA	NO POWER EXHAUST				w/ POWER EXHAUST (powered from unit)				
							MCA	FUSE OR HACR BRKR	DISCONNECT SIZE		MCA	FUSE OR HACR BRKR	DISCONNECT SIZE		
									FLA	LRA			FLA	LRA	
RHV240 Vertical	208/230-3-60	STD/MED	5	—	—	—	102	125	107	515	114	125	121	535	
				454A	18.8/25.0	52.1/60.1	167/177	175/200	167/176	567/575	179/189	200/200	181/190	587/595	
				455A	37.6/50.0	104.2/120.3	232/222	250/250	227/246	619/635	244/234	250/250	241/259	639/655	
		456A	56.3/75.0	156.4/180.4	258/282	300/300	287/315	671/695	270/294	300/350	301/328	691/715			
		HIGH	5	—	—	—	114	125	121	533	126	150	135	553	
				454A	18.8/25.0	52.1/60.1	179/189	200/200	181/191	585/593	191/201	200/225	195/204	605/613	
	455A			37.6/50.0	104.2/120.3	244/234	250/250	241/260	637/653	256/246	300/300	255/273	657/673		
	460-3-60	STD/MED	5	—	—	—	48	60	50	298	54	60	58	310	
				457A	25.0	30.1	85	90	85	328	92	100	92	340	
				458A	50.0	60.1	108	125	119	358	114	125	127	370	
		HIGH	5	459A	75.0	90.2	138	150	154	388	144	150	161	400	
				—	—	—	53	60	56	306	59	70	63	318	
				457A	25.0	30.1	91	100	91	336	97	100	98	348	
		575-3-60	STD/MED	5	458A	50.0	60.1	113	125	125	366	119	125	133	378
					459A	75.0	90.2	143	150	160	396	149	175	167	408
					—	—	—	38	50	41	234	43	50	46	242
			HIGH	5	460A	24.8	23.9	68	70	68	258	73	80	74	266
					461A	49.6	47.7	98	100	95	282	103	110	101	290
					462A	74.4	71.6	110	125	123	306	115	125	128	314
	RHV240 Horizontal	208/230-3-60	HIGH	5	—	—	—	43	50	45	238	48	60	51	246
					460A	24.8	23.9	73	80	73	262	77	80	78	270
					461A	49.6	47.7	102	110	100	286	107	110	106	294
			HIGH	5	462A	74.4	71.6	114	125	128	310	119	125	133	318
					—	—	—	114	125	121	533	126	150	135	553
463A					18.8/25.0	52.1/60.1	179/189	200/200	181/191	585/593	191/201	200/225	195/204	605/613	
460-3-60		HIGH	5	464A	37.6/50.0	104.2/120.3	244/234	250/250	241/260	637/653	256/246	300/300	255/273	657/673	
				465A	56.3/75.0	156.4/180.4	270/294	300/350	301/329	689/713	282/306	300/350	315/342	709/733	
				—	—	—	53	60	56	306	59	70	63	318	
		HIGH	5	466A	25.0	30.1	91	100	91	336	97	100	98	348	
				467A	50.0	60.1	113	125	125	366	119	125	133	378	
				468A	75.0	90.2	143	150	160	396	149	175	167	408	
		575-3-60	HIGH	5	—	—	—	43	50	45	238	48	60	51	246
					469A	24.8	23.9	73	80	73	262	77	80	78	270
					470A	49.6	47.7	102	110	100	286	107	110	106	294
			HIGH	5	471A	74.4	71.6	114	125	128	310	119	125	133	318

# Electrical data (cont)

## RHV300 MCA MOCP Electrical Data

RHV UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			NO CONVENIENCE OUTLET or UNPOWERED CONVENIENCE OUTLET							
				CRHEATER ****00	NOM (kW)	FLA	NO POWER EXHAUST				w/ POWER EXHAUST (powered from unit)			
							MCA	FUSE OR HACR BRKR	DISCONNECT SIZE		MCA	FUSE OR HACR BRKR	DISCONNECT SIZE	
									FLA	LRA			FLA	LRA
RHV300 Vertical	208/230-3-60	STD/MED	5	—	—	—	135	175	140	579	147	175	154	599
				454A	18.8/25.0	52.1/60.1	200/210	225/225	200/209	631/639	212/222	250/250	214/223	651/659
				455A	37.6/50.0	104.2/120.3	265/255	300/300	260/279	683/699	277/267	300/300	274/292	703/719
		456A	56.3/75.0	156.4/180.4	291/315	350/350	320/348	735/759	303/327	350/350	334/361	755/779		
		HIGH	5	—	—	—	145	175	152	593	157	200	166	613
				454A	18.8/25.0	52.1/60.1	210/220	225/250	212/221	645/653	222/232	250/250	226/235	665/673
	455A			37.6/50.0	104.2/120.3	275/265	300/300	272/290	697/713	287/277	300/300	285/304	717/733	
	460-3-60	STD/MED	5	—	—	—	57	70	59	293	63	80	66	305
				457A	25.0	30.1	95	100	94	323	101	110	101	335
				458A	50.0	60.1	117	125	128	353	124	150	136	365
		459A	75.0	90.2	147	175	163	383	154	175	170	395		
		HIGH	5	—	—	—	61	80	64	299	68	90	71	311
				457A	25.0	30.1	99	100	99	329	105	110	106	341
	458A			50.0	60.1	122	150	133	359	128	150	140	371	
	459A	75.0	90.2	152	175	168	389	158	175	175	401			
	575-3-60	STD/MED	5	—	—	—	48	60	50	225	53	60	55	233
				460A	24.8	23.9	78	90	77	249	83	90	83	257
				461A	49.6	47.7	108	110	105	273	113	125	110	281
		462A	74.4	71.6	120	125	132	297	125	150	138	305		
		HIGH	5	—	—	—	52	60	54	229	56	70	59	237
				460A	24.8	23.9	82	90	81	253	86	100	87	261
	461A			49.6	47.7	111	125	108	277	116	125	114	285	
	462A	74.4	71.6	123	150	136	301	128	150	141	309			
	RHV300 Horizontal	208/230-3-60	HIGH	5	—	—	—	145	175	152	593	157	200	166
463A					18.8/25.0	52.1/60.1	210/220	225/250	212/221	645/653	222/232	250/250	226/235	665/673
464A					37.6/50.0	104.2/120.3	275/265	300/300	272/290	697/713	287/277	300/300	285/304	717/733
465A		56.3/75.0	156.4/180.4	301/325	350/350	332/359	749/773	313/337	350/400	345/373	769/793			
460-3-60		HIGH	5	—	—	—	61	80	64	299	68	90	71	311
				466A	25.0	30.1	99	100	99	329	105	110	106	341
				467A	50.0	60.1	122	150	133	359	128	150	140	371
				468A	75.0	90.2	152	175	168	389	158	175	175	401
575-3-60		HIGH	5	—	—	—	52	60	54	229	56	70	59	237
				469A	24.8	23.9	82	90	81	253	86	100	87	261
				470A	49.6	47.7	111	125	108	277	116	125	114	285
				471A	74.4	71.6	123	150	136	301	128	150	141	309
				472A	74.4	71.6	123	150	136	301	128	150	141	309

# Electrical data (cont)

## RHV300 MCA MOCP Electrical Data (cont)

RHV UNIT SIZE	NOM. V-PH-Hz	IFM TYPE	STD SCCR kA	ELECTRIC HEATER			w/ POWERED CONVENIENCE OUTLET							
				CRHEATER *****00	NOM (kW)	FLA	NO POWER EXHAUST				w/ POWER EXHAUST (powered from unit)			
							MCA	FUSE OR HACR BRKR	DISCONNECT SIZE		MCA	FUSE OR HACR BRKR	DISCONNECT SIZE	
									FLA	LRA			FLA	LRA
RHV300 Vertical	208/230-3-60	STD/MED	5	—	—	—	140	175	146	584	151	200	159	604
				454A	18.8/25.0	52.1/60.1	205/215	225/250	206/215	636/644	217/227	250/250	219/229	656/664
				455A	37.6/50.0	104.2/120.3	270/260	300/300	266/284	688/704	282/272	300/300	279/298	708/724
		456A	56.3/75.0	156.4/180.4	296/320	350/350	326/353	740/764	308/332	350/350	339/367	760/784		
		HIGH	5	—	—	—	150	200	158	598	162	200	171	618
				454A	18.8/25.0	52.1/60.1	215/225	250/250	217/227	650/658	227/237	250/250	231/240	670/678
	455A			37.6/50.0	104.2/120.3	280/270	300/300	277/296	702/718	292/282	300/300	291/309	722/738	
	456A	56.3/75.0	156.4/180.4	306/330	350/350	337/365	754/778	318/342	350/400	351/379	774/798			
	460-3-60	STD/MED	5	—	—	—	59	80	62	295	66	80	69	307
				457A	25.0	30.1	97	100	96	325	103	110	104	337
				458A	50.0	60.1	120	150	131	355	126	150	138	367
		459A	75.0	90.2	150	175	166	385	156	175	173	397		
		HIGH	5	—	—	—	64	80	67	301	70	90	74	313
				457A	25.0	30.1	101	110	101	331	107	110	108	343
	458A			50.0	60.1	124	150	136	361	130	150	143	373	
	459A	75.0	90.2	154	175	170	391	160	175	178	403			
	575-3-60	STD/MED	5	—	—	—	50	60	52	227	55	60	57	235
				460A	24.8	23.9	80	90	79	251	85	90	85	259
				461A	49.6	47.7	110	110	107	275	114	125	112	283
		462A	74.4	71.6	122	150	134	299	126	150	140	307		
		HIGH	5	—	—	—	53	60	56	231	58	70	61	239
				460A	24.8	23.9	83	90	83	255	88	100	89	263
	461A			49.6	47.7	113	125	110	279	118	125	116	287	
	462A	74.4	71.6	125	150	138	303	130	150	143	311			
RHV300 Horizontal	208/230-3-60	HIGH	5	—	—	—	150	200	158	598	162	200	171	618
				463A	18.8/25.0	52.1/60.1	215/225	250/250	217/227	650/658	227/237	250/250	231/240	670/678
				464A	37.6/50.0	104.2/120.3	280/270	300/300	277/296	702/718	292/282	300/300	291/309	722/738
	465A	56.3/75.0	156.4/180.4	306/330	350/350	337/365	754/778	318/342	350/400	351/379	774/798			
	460-3-60	HIGH	5	—	—	—	64	80	67	301	70	90	74	313
				466A	25.0	30.1	101	110	101	331	107	110	108	343
				467A	50.0	60.1	124	150	136	361	130	150	143	373
				468A	75.0	90.2	154	175	170	391	160	175	178	403
	575-3-60	HIGH	5	—	—	—	53	60	56	231	58	70	61	239
				469A	24.8	23.9	83	90	83	255	88	100	89	263
				470A	49.6	47.7	113	125	110	279	118	125	116	287
				471A	74.4	71.6	125	150	138	303	130	150	143	311

# Electrical data (cont)

## RHV181 Electric Heat Data

RHV UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	STD SCCR kA	STD ELECTRIC HEATER PART NUMBER	NOMINAL (kW)	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	SINGLE POINT OR JUNCTION KIT PART NUMBER CRSINGLEXXA00			
								NO C.O. OR UNPOWERED C.O.		w/PWRD C.O.	
								NO P.E.	w/ P.E. (pwrd fr/unit)	NO P.E.	w/ P.E. (pwrd fr/unit)
RHV181 Vertical	208/230-3-60	STD/MED	5	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH	5	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
				CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
				CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD/MED	5	CRHEATER457A00	25.0	23.0	78.3	057	057	057	057
				CRHEATER458A00	50.0	45.9	156.7	057	057	057	057
				CRHEATER459A00	75.0	68.9	235.0	057	057	057	057
		HIGH	5	CRHEATER457A00	25.0	23.0	78.3	057	057	057	057
				CRHEATER458A00	50.0	45.9	156.7	057	057	057	057
				CRHEATER459A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD/MED	5	CRHEATER460A00	24.8	22.8	77.7	—	—	—	—
				CRHEATER461A00	49.6	45.6	155.4	057	057	057	057
				CRHEATER462A00	74.4	68.3	233.1	057	057	057	057
HIGH		5	CRHEATER460A00	24.8	22.8	77.7	—	—	—	—	
			CRHEATER461A00	49.6	45.6	155.4	057	057	057	057	
			CRHEATER462A00	74.4	68.3	233.1	057	057	057	057	
RHV181 Horizontal	208/230-3-60	HIGH	5	CRHEATER463A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
				CRHEATER464A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
				CRHEATER465A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	HIGH	5	CRHEATER466A00	25.0	23.0	78.3	057	057	057	057
				CRHEATER467A00	50.0	45.9	156.7	057	057	057	057
				CRHEATER468A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	HIGH	5	CRHEATER469A00	24.8	22.8	77.7	—	—	—	—
				CRHEATER470A00	49.6	45.6	155.4	057	057	057	057
				CRHEATER471A00	74.4	68.3	233.1	057	057	057	057

# Electrical data (cont)

## RHV240 Electric Heat Data

RHV UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER	NOMINAL (kW)	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	SINGLE POINT OR JUNCTION KIT PART NUMBER CRSINGLEXXXA00			
							NO C.O. OR UNPOWERED C.O.		w/PWRD C.O.	
							NO P.E.	w/ P.E. (pwrd fr/unit)	NO P.E.	w/ P.E. (pwrd fr/unit)
RHV240 Vertical	208/230-3-60	STD/ MED	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
			CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
			CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD/ MED	CRHEATER457A00	25.0	23.0	78.3	057	057	057	057
			CRHEATER458A00	50.0	45.9	156.7	057	057	057	057
			CRHEATER459A00	75.0	68.9	235.0	057	057	057	057
		HIGH	CRHEATER457A00	25.0	23.0	78.3	057	057	057	057
			CRHEATER458A00	50.0	45.9	156.7	057	057	057	057
			CRHEATER459A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD/ MED	CRHEATER460A00	24.8	22.8	77.7	—	057	—	057
			CRHEATER461A00	49.6	45.6	155.4	057	057	057	057
			CRHEATER462A00	74.4	68.3	233.1	057	057	057	057
HIGH		CRHEATER460A00	24.8	22.8	77.7	057	057	057	057	
		CRHEATER461A00	49.6	45.6	155.4	057	057	057	057	
		CRHEATER462A00	74.4	68.3	233.1	057	057	057	057	
RHV240 Horizontal	208/230-3-60	HIGH	CRHEATER463A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
			CRHEATER464A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			CRHEATER465A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	HIGH	CRHEATER466A00	25.0	23.0	78.3	057	057	057	057
			CRHEATER467A00	50.0	45.9	156.7	057	057	057	057
			CRHEATER468A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	HIGH	CRHEATER469A00	24.8	22.8	77.7	—	—	—	—
			CRHEATER470A00	49.6	45.6	155.4	057	057	057	057
			CRHEATER471A00	74.4	68.3	233.1	057	057	057	057


# Electrical data (cont)

## RHV300 Electric Heat Data

RHV UNIT SIZE	NOM. V-Ph-Hz	IFM TYPE	ELECTRIC HEATER PART NUMBER	NOMINAL (kW)	APPLICATION (kW)	APPLICATION OUTPUT (MBH)	SINGLE POINT OR JUNCTION KIT PART NUMBER CRSINGLEXXXXA00			
							NO C.O. OR UNPOWERED C.O.		w/PWRD C.O.	
							NO P.E.	w/ P.E. (pwrd fr/unit)	NO P.E.	w/ P.E. (pwrd fr/unit)
RHV300 Vertical	208/230-3-60	STD/MED	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
			CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
		HIGH	CRHEATER454A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
			CRHEATER455A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			CRHEATER456A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	STD/MED	CRHEATER457A00	25.0	23.0	78.3	057	057	057	057
			CRHEATER458A00	50.0	45.9	156.7	057	057	057	057
			CRHEATER459A00	75.0	68.9	235.0	057	057	057	057
		HIGH	CRHEATER457A00	25.0	23.0	78.3	057	057	057	057
			CRHEATER458A00	50.0	45.9	156.7	057	057	057	057
			CRHEATER459A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	STD/MED	CRHEATER460A00	24.8	22.8	77.7	057	057	057	057
			CRHEATER461A00	49.6	45.6	155.4	057	057	057	057
			CRHEATER462A00	74.4	68.3	233.1	057	057	057	057
		HIGH	CRHEATER460A00	24.8	22.8	77.7	057	057	057	057
			CRHEATER461A00	49.6	45.6	155.4	057	057	057	057
			CRHEATER462A00	74.4	68.3	233.1	057	057	057	057
RHV300 Horizontal	208/230-3-60	HIGH	CRHEATER463A00	25.0	18.8/23.0	64.1/78.3	056	056	056	056
			CRHEATER464A00	50.0	37.6/45.9	128.1/156.7	056	056	056	056
			CRHEATER465A00	75.0	56.3/68.9	192.2/235.0	056	056	056	056
	460-3-60	HIGH	CRHEATER466A00	25.0	23.0	78.3	057	057	057	057
			CRHEATER467A00	50.0	45.9	156.7	057	057	057	057
			CRHEATER468A00	75.0	68.9	235.0	057	057	057	057
	575-3-60	HIGH	CRHEATER469A00	24.8	22.8	77.7	057	057	057	057
			CRHEATER470A00	49.6	45.6	155.4	057	057	057	057
			CRHEATER471A00	74.4	68.3	233.1	057	057	057	057

# Typical wiring diagrams


Typical RHV181-300 Control Wiring Diagram, Electro-Mechanical with W7220 Controller, 460V-3-60 Unit Shown

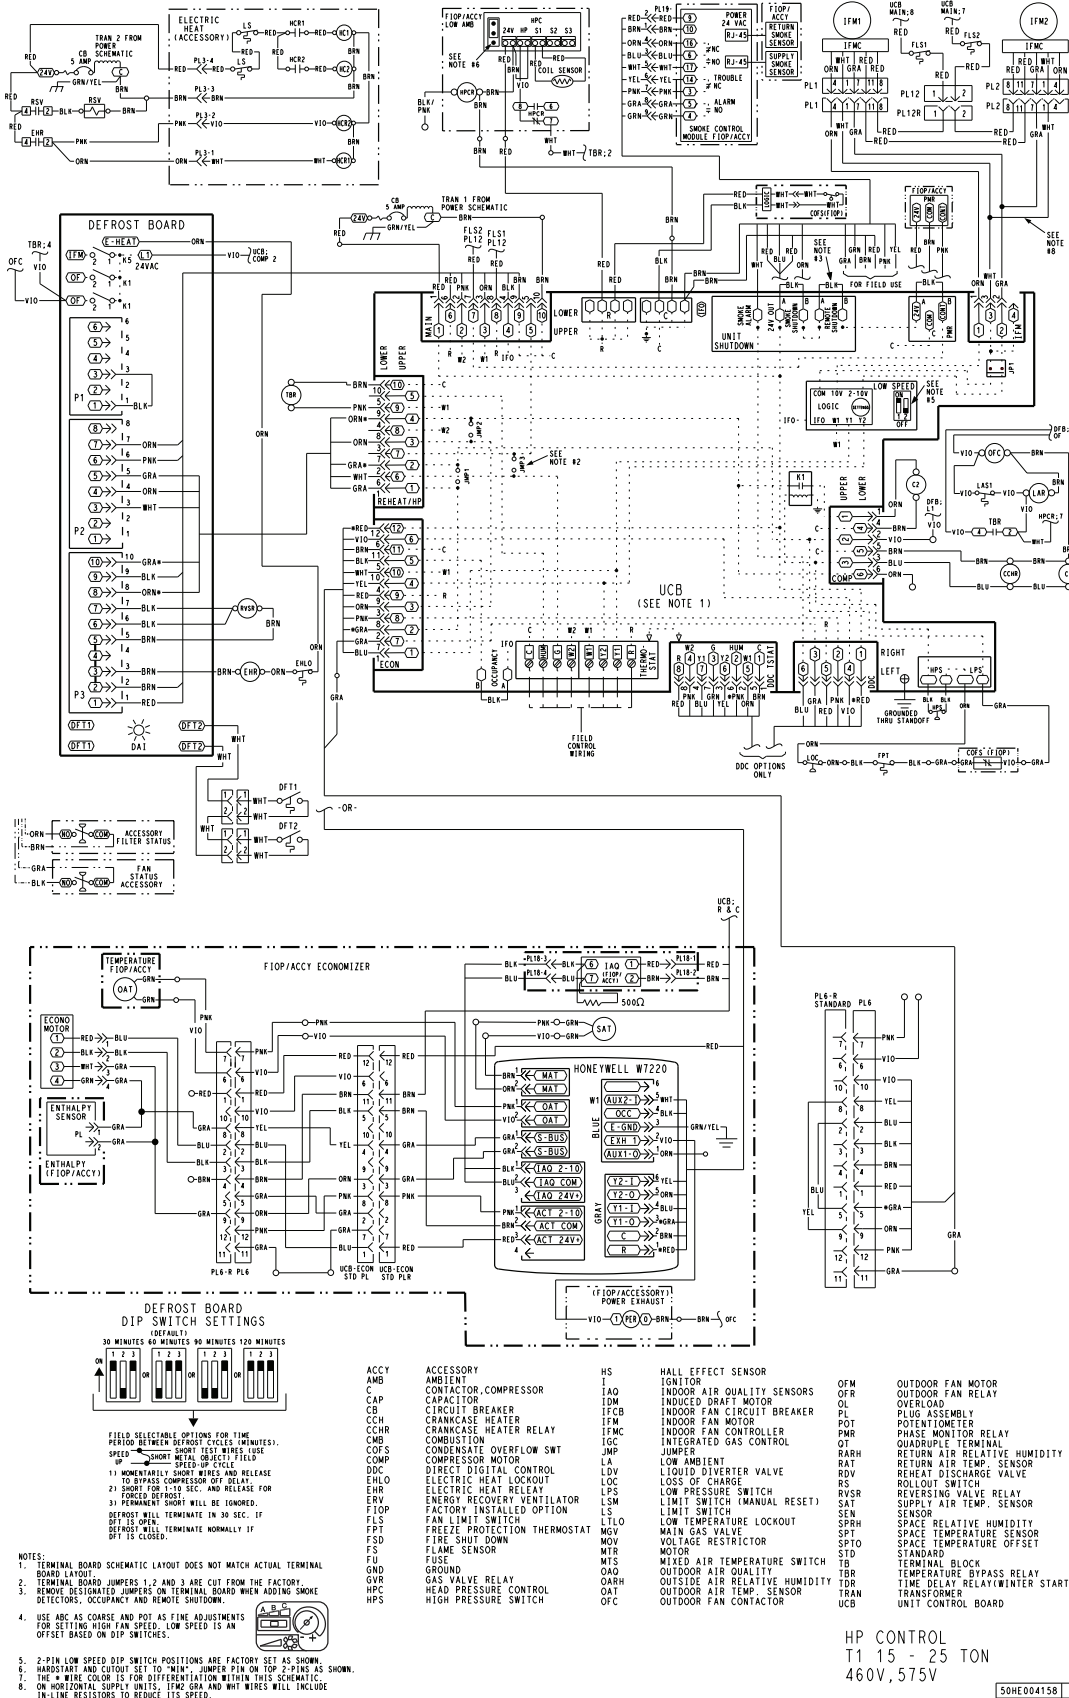

# Typical wiring diagrams (cont)

## Typical RHV181 Power Wiring Diagram, Electro-Mechanical Controller, 15 Ton 460V-3-60 Unit Shown


HP POWER T1 15 TON  
460V

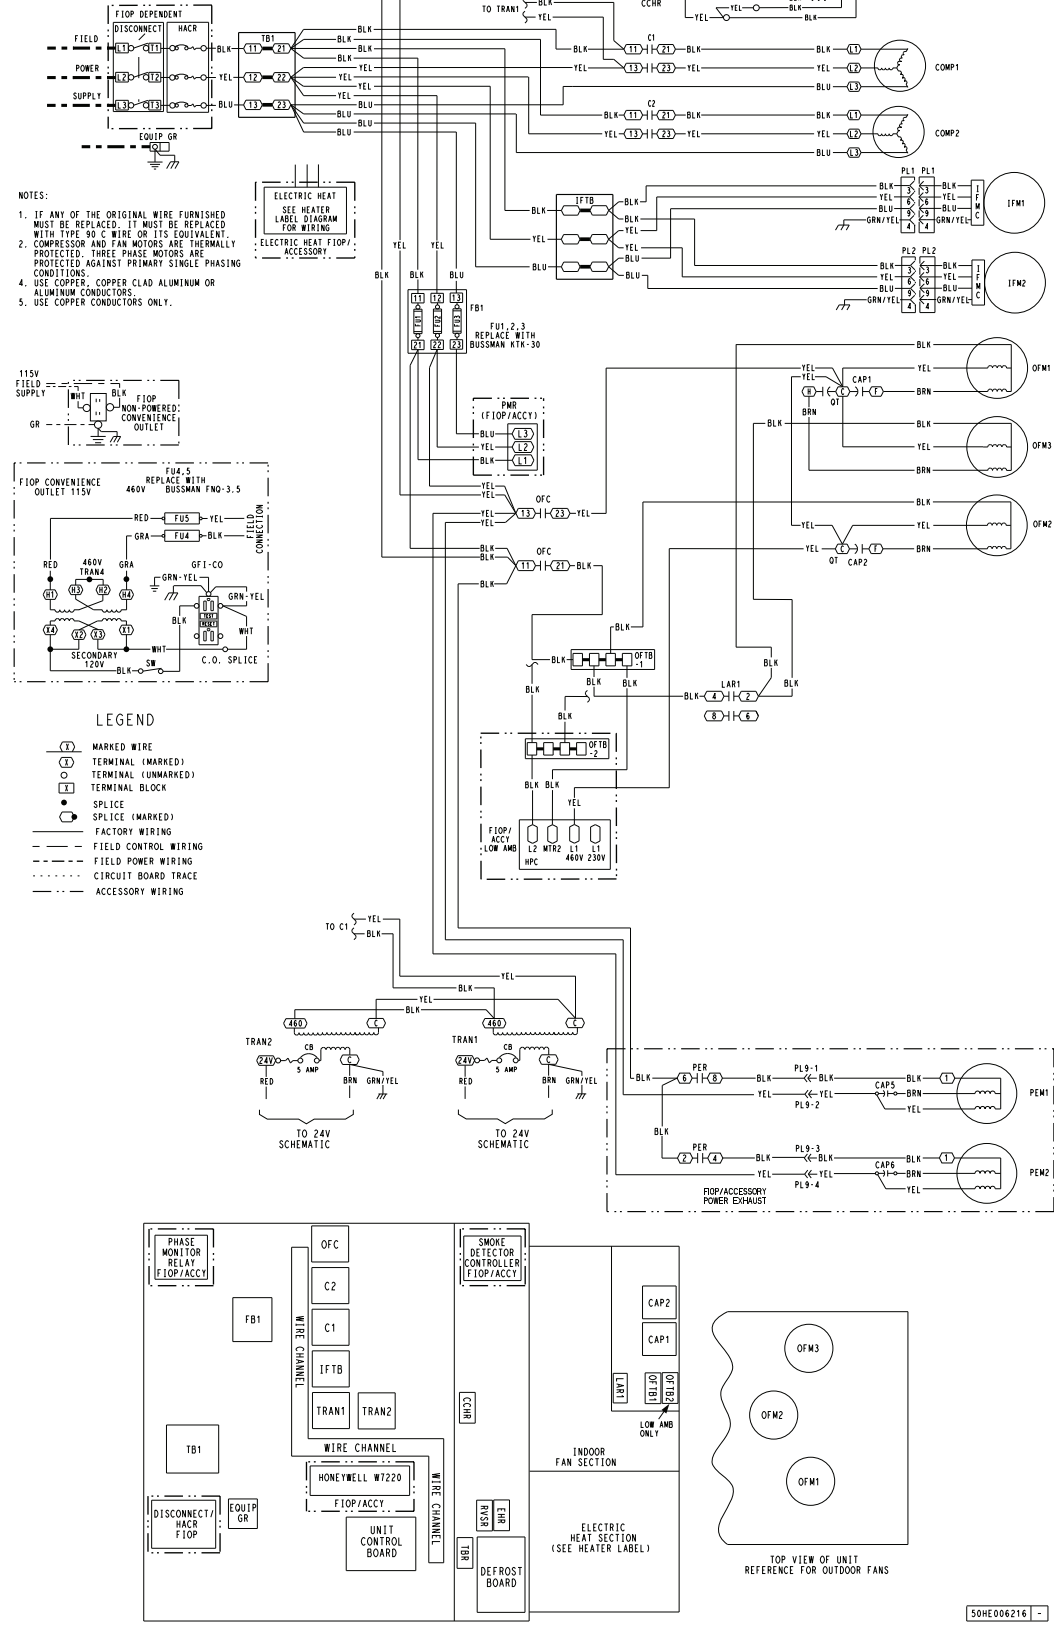

# Typical wiring diagrams (cont)



## Typical RHV240-300 Power Wiring Diagram, Electro-Mechanical Controller, 460V-3-60 Unit Shown

PAC POWER T1 17.5, 20, 25 TON  
 HP POWER T1 20 & 25 TON  
 460V






**NOTES:**

1. IF ANY OF THE ORIGINAL WIRE FURNISHED MUST BE REPLACED, IT MUST BE REPLACED WITH TYPE 90 C WIRE OR ITS EQUIVALENT.
2. COMPRESSOR AND FAN MOTORS ARE THERMALLY PROTECTED. THREE PHASE MOTORS ARE PROTECTED AGAINST PRIMARY SINGLE PHASING CONDITIONS.
3. USE COPPER, COPPER CLAD ALUMINUM OR ALUMINUM CONDUCTORS.
4. USE COPPER, COPPER CLAD ALUMINUM OR ALUMINUM CONDUCTORS ONLY.



**LEGEND**

- (T) MARKED WIRE
- (T) TERMINAL (MARKED)
- (T) TERMINAL (UNMARKED)
- (T) TERMINAL BLOCK
- (T) SPICE
- (T) SPICE (MARKED)
- (T) FACTORY WIRING
- (T) FIELD CONTROL WIRING
- (T) FIELD POWER WIRING
- (T) CIRCUIT BOARD TRACE
- (T) ACCESSORY WIRING

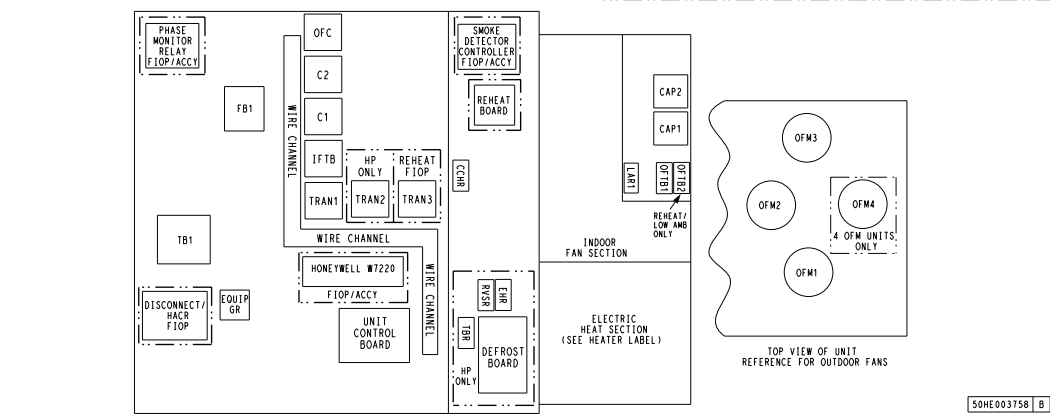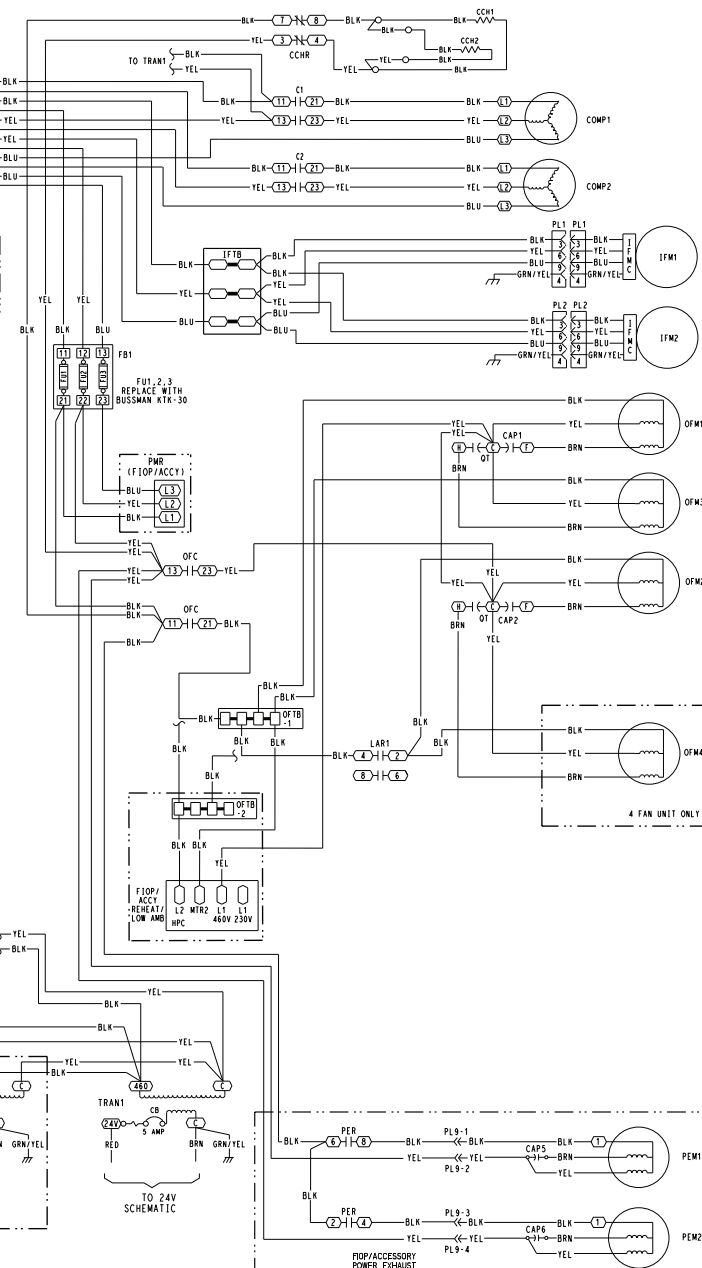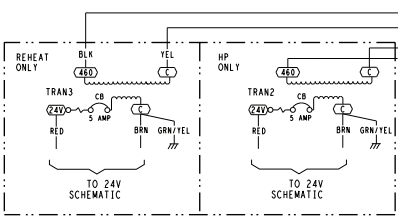

50HE003758 B

# Sequence of operation

## General

The sequence below describes the sequence of operation for an electro-mechanical unit with and without a factory-installed EconoMi\$er® X (W7220 controller). For information regarding a direct digital controller, see the start-up, operations, and troubleshooting manual for the applicable controller.

## Electro-Mechanical Units with No Economizer

### Cooling

When the thermostat calls for cooling, terminals G and Y1 are energized. The indoor fan will run at the low fan speed and the C1 compressor contactor (CC) is energized causing the compressor and outdoor fan to run. The low indoor fan speed is 60% or 66% of the user set fan speed depending on unit size.

If additional cooling is needed, the thermostat will add the call for Y2. This will increase the indoor fan speed to the user set fan speed and energize the C2 contactor and second compressor for full compressor capacity. The outdoor fan is the same speed for Y1 and Y2.

When the thermostat removes the call for Y2 but leaves the Y1, the indoor fan will slow to the reduced percentage of the user set fan speed, the C2 contactor will de-energize, the second compressor will turn off, and the outdoor fan will remain on. When the thermostat removes the call for Y1 the compressor contactor will de-energize shutting down the compressor and the outdoor fan. When the thermostat removes the call for G, the indoor fan will turn off after the specific unit fan off delay.

NOTE: Per ASHRAE 90.1-2019 and IECC-2018 standards, during the first stage cooling operation the Unit Control Board (UCB) will adjust the fan motor speed to provide 60% or 66% of the total cfm established for the unit.

### Defrost

When the temperature of the outdoor coil drops below 28°F (-2°C) as sensed by the defrost thermostat (DFT2) and the defrost timer is at the end of a timed period (adjustable at 30, 60, 90 or 120 minutes), the reversing valve solenoid (RVS) is energized and the OFC is de-energized. This switches the position of the reversing valve and shuts off the outdoor fan. The electric heaters (if installed) will be energized.

### Heating, unit with economizer

Upon a request for heating from the space thermostat terminal, W1 will be energized with 24V. The indoor fan will run at high speed, and outdoor fan contactor (OFC), C1 and C2 will be energized in heating. The indoor fan, outdoor fans, and both stages of the compressor are energized. The reversing valve is de-energized and switch positions. The economizer is set to minimum position (ventilation position). If the space temperature continues to fall with W1 energized, W2 will bring on all electric heat (HC).

As the space temperature rises the W2 will de-energize and the compressors will continue to operate, until the thermostat set point is achieved de-energizing W1. If the thermostat is set to Auto, the indoor fan will de-energize and the economizer will close. If the indoor fan is set to On, the indoor fan will continue to operate and the economizer will remain at minimum position (vent position).

On units equipped for 2 stages of heat, when additional heat is needed, heater contactor no. 2 is energized through W2. The economizer damper moves to the minimum position. When the thermostat is satisfied, the damper moves to the fully closed position.

### Heating, unit without economizer

Upon a request for heating from the space thermostat, terminal W1 will be energized with 24V. The IFC, outdoor fan contactor (OFC), C1, and C2 will be energized. The indoor fan, outdoor fans, and compressor no. 1, and compressor no. 2 are energized and reversing valves are de-energized and switch position.

If the space temperature continues to fall while W1 is energized, W2 will be energized with 24V, and the heater contactor(s) (HC) will be energized, which will energize the electric heater(s).

When the space thermostat is satisfied, W2 will be de-energized first, and the electric heater(s) will be de-energized. Upon a further rise in space temperature, W1 will be de-energized.

**IMPORTANT:** The thermostat must be configured for Electric Heat so it will energize G with the W1 call.

## Electro-Mechanical Units with Factory-Installed EconoMi\$er X

When free cooling is not available, the compressors will be controlled by the zone thermostat. When free cooling is available, the outdoor-air damper is modulated by the EconoMi\$er X control to provide a 50°F (10°C) to 55°F (13°C) mixed-air temperature into the zone. As the mixed air temperature fluctuates above 55°F (13°C) or below 50°F (10°C) dampers will be modulated (open or close) to bring the mixed-air temperature back within control. If mechanical cooling is utilized with free cooling, the outdoor-air damper will maintain its current position at the time the compressor is started. If the increase in cooling capacity causes the mixed-air temperature to drop below 45°F (7°C), then the outdoor-air damper position will be decreased to the minimum position. If the mixed-air temperature continues to fall, the outdoor-air damper will close. Control returns to normal once the mixed-air temperature rises above 48°F (9°C). The power exhaust fans will be energized and de-energized, if installed, as the outdoor-air damper opens and closes.

If field-installed accessory CO<sub>2</sub> sensors are connected to the EconoMi\$er X control, a demand controlled ventilation strategy will begin to operate. As the CO<sub>2</sub> level in the zone increases above the CO<sub>2</sub> set-point, the minimum position of the damper will be increased proportionally. As the CO<sub>2</sub> level decreases because of the increase in fresh air, the outdoor-air damper will be proportionally closed.

## Sequence of operation (cont)

For EconoMi\$er X operation, there must be a thermostat call for the fan (G). If the unit is occupied and the fan is on, the damper will operate at minimum position. Otherwise, the damper will be closed.

When the EconoMi\$er X control is in the occupied mode and a call for cooling exists (Y1 on the thermostat), the control will first check for indoor fan operation. If the fan is not on, then cooling will not be activated. If the fan is on, then the control will open the EconoMi\$er X damper to the minimum position.

On the initial power to the EconoMi\$er X control, it will take the damper up to 2-1/2 minutes before it begins to position itself. After the initial power-up, further changes in damper position can take up to 30 seconds to initiate. Damper movement from full closed to full open (or vice versa) will take between 1-1/2 and 2-1/2 minutes. If free cooling can be used as determined from the appropriate changeover command (switch, dry bulb, enthalpy curve, differential dry bulb, or differential enthalpy), then the control

will modulate the dampers open to maintain the mixed-air temperature set-point at 50°F (10°C) to 55°F (13°C). If there is a further demand for cooling (cooling second stage — Y2 is energized), then the control will bring on compressor stage 1 to maintain the mixed-air temperature setpoint. The EconoMi\$er X damper will be open at maximum position.

**2-Speed Note:** The EconoMi\$er X controller will adjust the damper position as the Indoor Fan Speed changes, per its configured values.

### Heating

The sequence of operation for the heating is the same as an electro-mechanical unit with no economizer. The only difference is how the economizer acts. The economizer will stay at the Economizer Minimum Position while the evaporator fan is operating. The outdoor-air damper is closed when the indoor fan is not operating. Refer to Service and Maintenance Manual for further details.

# Application data

## Minimum operating ambient temperature (cooling)

In mechanical cooling mode, your RHV rooftop unit can safely operate down to an outdoor ambient temperature of 40°F (4°C). It is possible to provide cooling at lower outdoor ambient temperatures by using less outside air, economizers, and/or accessory low ambient kits.

## Maximum operating ambient temperature (cooling)

The maximum operating ambient temperature for cooling mode is 125°F (52°C). While cooling operation above 125°F (52°C) may be possible, it could cause either a reduction in performance, reliability, or a protective action by the unit's internal safety devices.

## Multiple motor packages

Some applications need larger horsepower motors, some need more airflow, and some need both. Regardless of the case, we have a factory installed combination to meet your application. A wide selection of motors are available, factory installed, to handle nearly any application.

## Minimum and maximum airflow (heating and cooling)

To maintain safe and reliable operation of your rooftop, operate within the heating airflow limits during heating mode and cooling airflow limits during cooling mode. Operating above the max may cause blow-off, undesired airflow noise, or airflow related problems with the rooftop unit. Operating below the min may cause problems with coil freeze-up and unsafe heating operation. Heating and cooling limitations differ when evaluating operating CFM, minimum value is the HIGHER of the cooling and heating minimum CFM values published on page 5 and the maximum value is the LOWER of the cooling and heating minimum values published on page 5.

## Heating-to-cooling changeover

Your unit will automatically change from heating to cooling mode when using a thermostat with an auto-changeover feature.

## Airflow

All units are draw-through in cooling mode and blow-through in heating mode.

## Outdoor air application strategies

Economizers reduce operating expenses and compressor run time by providing a free source of cooling and a means of ventilation to match application changing needs. In fact, they should be considered for most applications. Also, consider the various economizer control

methods and their benefits, as well as sensors required to accomplish your application goals. Please contact your local company representative for assistance.

## Motor limits, brake horsepower (bhp)

Due to internal design of RHV units, the air path, and specially designed motors, the full horsepower (maximum continuous bhp) band, as listed in the Fan Performance tables, can be used with the utmost confidence. There is no need for extra safety factors, as our motors are designed and rigorously tested to use the entire, listed bhp range without either nuisance tripping or premature motor failure.

## Sizing a rooftop

Bigger is not necessarily better. While an air conditioner needs to have enough capacity to meet the design loads, it does not need excess capacity. In fact, excess capacity typically results in very poor part load performance and humidity control.

Using higher design temperatures than ASHRAE recommends for your location, adding "safety factors" to the calculated load, are all signs of oversizing air conditioners. Oversizing the air conditioner leads to poor humidity control, reduced efficiency, higher utility bills, larger indoor temperature swings, excessive noise, and increased wear and tear on the air conditioner.

Rather than oversizing an air conditioner, engineers should "right-size" or even slightly "under-size" air conditioners. Correctly sizing an air conditioner controls humidity better; promotes efficiency; reduces utility bills; extends equipment life, and maintains even, comfortable temperatures. Please contact your local company representative for assistance.

## Low ambient applications

The optional economizer can adequately cool your space by bringing in fresh, cool outside air. In fact, when so equipped, accessory low-ambient kit may not be necessary. In low ambient conditions, unless the outdoor air is excessively humid or contaminated, economizer-based "free cooling" is the preferred less costly and energy conscious method. In low ambient applications where outside air might not be desired (such as contaminated or excessively humid outdoor environments), your RHV rooftop can operate to ambient temperatures down to -0°F (-18°C) using the recommended accessory low ambient controller.

# Guide specifications

Note about this specification:

This specification is in the "Masterformat" as published by the Construction Specification Institute. Please feel free to copy this specification directly into your building spec.

## Cooling Only/Electric Heat Packaged Rooftop Heat Pump

### HVAC Guide Specifications

Size Range: **15 to 25 Nominal Tons**

Model Number: **RHV181-300**

#### Part 1 — (23 06 80) Schedules for Decentralized HVAC Equipment

1.01 (23 06 80.13) Decentralized Unitary HVAC Equipment Schedule:

A. (23 06 80.13.A.) Rooftop unit (RTU) schedule:

1. Schedule is per the project specification requirements.

#### Part 2 — (23 07 16) HVAC equipment insulation

2.01 (23 07 16.13) Decentralized, Rooftop Units:

A. (23 07 16.13.A.) Evaporator fan compartment:

1. Interior cabinet surfaces shall be insulated with a minimum 1/2 in. thick, minimum 1-1/2 lb density, flexible fiberglass insulation bonded with a phenolic binder, neoprene coated on the air side.
2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

B. (23 07 16.13.B.) Electric Heat Compartment:

1. Aluminum foil-faced fiberglass insulation shall be used.
2. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.

#### Part 3 — (23 09 13) Instrumentation and control devices for HVAC

3.01 (23 09 13.23) Sensors and Transmitters:

A. (23 09 13.23.A.) Thermostats:

Thermostat must

- a. energize both "W" and "G" when calling for heat.
- b. have capability to energize 1 or 2 different stages of cooling, and 2 different stages of heating.
- c. include capability for occupancy scheduling.

#### Part 4 — (23 09 33) Electric and Electronic Control System for HVAC

4.01 (23 09 33.13) Decentralized, Rooftop Units:

A. (23 09 33.13.A.) General:

1. Shall be complete with self-contained low-voltage control circuit protected by a resettable circuit breaker on the 24-v transformer side. Transformer shall have 75VA capability.

2. Shall utilize color-coded wiring.

3. Shall include a Unit Control Board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, economizer, thermostat, and low and high pressure switches. Controller shall also provide an intuitive means to adjust the indoor fan speed through a simple switch and pot adjustment design.

4. Unit shall include a minimum of one 8-pin screw terminal connection board for connection of control wiring.

5. Shall include integrated defrost system to prevent excessive frost accumulation during heating duty, and shall be controlled as follows:

a. Defrost shall be initiated on the basis of time and coil temperature.

b. A 30, 60, 90, 120 minute timer shall activate the defrost cycle only if the coil temperature is low enough to indicate a heavy frost condition.

c. Defrost cycle shall terminate when defrost thermostat is satisfied and shall have a positive termination time of 10 minutes.

6. Defrost system shall also include:

a. Defrost Cycle Indicator LED.

b. Dip switch selectable defrost time between 30, 60, 90 and 120 minutes. Factory set at 30 minutes.

c. Molded plug connection to ensure proper connection.

B. (23 09 33.13.B.) Safeties:

1. Compressor over-temperature, over-current. High internal pressure differential.

2. Low pressure switch.

a. Low pressure switch shall use different color wire than the high pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.

3. High pressure switch.

a. High pressure switch shall use different color wire than the low pressure switch. The purpose is to assist the installer and service technician to correctly wire and or troubleshoot the rooftop unit.

4. Automatic reset, motor thermal overload protector.

#### Part 5 — (23 09 93) Sequence of Operation for HVAC Controls

5.01 (23 09 93.13) Decentralized, Rooftop Units:

A. (23 09 93.13.A.) INSERT SEQUENCE OF OPERATION

# Guide specifications (cont)

## Part 6 — (23 40 13) Panel Air Filters

### 6.01 (23 40 13.13) Decentralized, Rooftop Units:

- A. (23 40 13.13.A.) Standard filter section:
1. Shall consist of factory installed, low velocity, disposable 2 in. thick fiberglass filters of commercially available sizes.
  2. Filters shall be accessible through a dedicated, weather tight access pane.
  3. Four-inch filter capabilities shall be capable with pre-engineered and approved filter track field installed accessory. This kit requires field furnished filters.

## Part 7 — (23 81 19) Self-Contained Air Conditioners

### 7.01 (23 81 19.13) Small-Capacity Self-Contained Air Conditioners:

- A. (23 81 19.13.A.) General:
1. Outdoor, rooftop mounted, electrically controlled, heating and cooling unit utilizing fully hermetic scroll compressors for cooling duty and optional electric heat for heating duty.
  2. Factory assembled, single-piece heating and cooling rooftop unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and special features required prior to field start-up.
  3. Unit shall use R-410A refrigerant.
  4. Unit shall be installed in accordance with the manufacturer's instructions.
  5. Unit must be selected and installed in compliance with local, state, and federal codes.
- B. (23 81 19.13.B.) Quality Assurance:
1. Unit meets ASHRAE 90.1 minimum efficiency requirements.
  2. Unit shall be rated in accordance with AHRI Standards 340/360.
  3. Unit shall be designed to conform to ASHRAE 15.
  4. Unit shall be UL-tested and certified in accordance with ANSI Z21.47 Standards and UL-listed and certified under Canadian standards as a total package for safety requirements.
  5. Insulation and adhesive shall meet NFPA 90A requirements for flame spread and smoke generation.
  6. Unit casing shall be capable of withstanding 500 hour salt spray exposure per ASTM B117 (scribed specimen).
  7. Unit shall be designed in accordance with ISO 9001, and shall be manufactured in a facility registered by ISO 9001:2015.
  8. Roof curb shall be designed to conform to NRCA Standards.
  9. Unit shall be subjected to a completely automated run test on the assembly line. The data

for each unit will be stored at the factory, and must be available upon request.

10. Unit shall be designed in accordance with UL Standard 60335-2-40, including tested to withstand rain.
  11. Unit shall be constructed to prevent intrusion of snow and tested to prevent snow intrusion into the control box up to 40 mph.
  12. Unit shake tested to assurance level 1, ASTM D4169 to ensure shipping reliability.
- C. (23 81 19.13.C.) Delivery, Storage, and Handling:
1. Unit shall be stored and handled per manufacturer's recommendations.
  2. Lifted by crane requires either shipping top panel or spreader bars.
  3. Unit shall only be stored or positioned in the upright position.
- D. (23 81 19.13.D.) Project Conditions:
1. As specified in the contract.
- E. (23 81 19.13.E.) Operating Characteristics:
1. Unit shall be capable of starting and running at 125°F (52°C) ambient outdoor temperature meeting maximum load criteria of AHRI Standard 340/360 at ±10% voltage.
  2. Compressor with standard controls shall be capable of operation down to 40°F (4°C) ambient outdoor temperatures. Accessory winter start kit is necessary if mechanically cooling at ambient temperatures down to 25°F (-4°C) or 0°F (-18°C).
  3. Unit shall discharge supply air vertically or horizontally as shown on contract drawings.
  4. Unit shall be factory configured for vertical supply and return configurations or horizontal supply and return configurations. Dedicated models provided with no special air conversion kits required.
- F. (23 81 19.13.F.) Electrical Requirements:
1. Main power supply voltage, phase, and frequency must match those required by the manufacturer.
- G. (23 81 19.13.G.) Unit Cabinet:
1. Unit cabinet shall be constructed of galvanized steel, and shall be bonderized and coated with a prepainted baked enamel finish on all externally exposed surfaces.
  2. Unit cabinet exterior paint shall be: film thickness, (dry) 0.003 in. minimum, gloss (per ASTM D523, 60°F/16°C): 60, Hardness: H-2H Pencil hardness.
  3. Evaporator fan compartment interior cabinet insulation shall conform to AHRI Standards 340/360 minimum exterior sweat criteria. Interior surfaces shall be insulated with a minimum 1/2 in. thick, 1 lb density, flexible fiberglass insulation, neoprene coated on the air side.

# Guide specifications (cont)

- Aluminum foil-faced fiberglass insulation shall be used in the heat compartment.
4. Base of unit shall have a minimum of four locations for thru-the-base gas and electrical connections (factory-installed or field-installed), standard.
  5. Base Rail:
    - a. Unit shall have base rails on a minimum of 2 sides.
    - b. Holes shall be provided in the base rails for rigging shackles to facilitate maneuvering and overhead rigging.
    - c. Holes shall be provided in the base rail for moving the rooftop by fork truck.
    - d. Base rail shall be a minimum of 16 gage thickness.
  6. Condensate pan and connections:
    - a. Shall be a sloped condensate drain pan made of a corrosion resistant material.
    - b. Shall comply with ASHRAE Standard 62.
    - c. Shall use a 3/4 in. 14 NPT drain connection, possible either through the bottom or side of the drain pan. Connection shall be made per manufacturer's recommendations.
  7. Top panel:
    - a. Shall be a multi-top panel with watertight flanges and locking systems.
  8. Electrical Connections:
    - a. All unit power wiring shall enter unit cabinet at a single, factory prepared, knockout location.
    - b. Thru-the-base capability.
      - 1) Thru-the-base provisions/connections are available as standard with every unit. When bottom connections are required, field furnished couplings are required.
      - 2) No basepan penetration, other than those authorized by the manufacturer, is permitted.
  9. Component access panels (standard):
    - a. Cabinet panels shall be easily removable for servicing.
    - b. Unit shall have large removable, filter access panel.
    - c. Panels covering control box, indoor fan, indoor fan motor, gas components (where applicable), and compressors shall have molded composite handles.
    - d. Handles shall be UV modified, composite. They shall be permanently attached, and recessed into the panel.
    - e. Screws on the vertical portion of all removable access panel shall engage into heat resistant, molded composite collars.
  - f. Collars shall be removable and easily replaceable using manufacturer recommended parts.
- H. (23 81 19.13.H.) Coils:
1. Standard Aluminum Fin-Copper Tube Coils:
    - a. Standard evaporator and condenser coils shall have aluminum lanced plate fins mechanically bonded to seamless internally grooved copper tubes with all joints brazed.
    - b. Evaporator coils shall be leak tested to 150 psig, pressure tested to 450 psig, and qualified to UL 1995 burst test at 1775 psig.
    - c. Condenser coils shall be leak tested to 150 psig, pressure tested to 650 psig, and qualified to UL 1995 burst test at 1980 psig.
  2. Optional Pre-coated aluminum-fin condenser coils:
    - a. Shall have a durable epoxy-phenolic coating to provide protection in mildly corrosive coastal environments.
    - b. Coating shall be applied to the aluminum fin stock prior to the fin stamping process to create an inert barrier between the aluminum fin and copper tube.
    - c. Epoxy-phenolic barrier shall minimize galvanic action between dissimilar metals.
    - d. Corrosion durability of fin stock shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117-90.
    - e. Corrosion durability of fin stock shall be confirmed through testing to have no visible corrosion after 48 hour immersion in a room temperature solution of 5% salt, 1% acetic acid.
    - f. Fin stock coating shall pass 2000 hours of the following: one week exposure in the prohesion chamber followed by one week of accelerated ultraviolet light testing. Prohesion chamber: the solution shall contain 3.5% sodium chloride and 0.35% ammonium sulfate. The exposure cycle is one hour of salt fog application at ambient followed by one hour drying at 95°F (35°C).
  3. Optional Copper-fin evaporator and condenser coils:
    - a. Shall be constructed of copper fins mechanically bonded to copper tubes and copper tube sheets.
    - b. Galvanized steel tube sheets shall not be acceptable.
    - c. A polymer strip shall prevent coil assembly from contacting the sheet metal coil pan to minimize potential for galvanic corrosion between coil and pan.

# Guide specifications (cont)

4. Optional E-coated aluminum-fin evaporator and condenser coils:
  - a. Shall have a flexible epoxy polymer coating uniformly applied to all coil surface areas without material bridging between fins.
  - b. Coating process shall ensure complete coil encapsulation of tubes, fins and headers.
  - c. Color shall be high gloss black with gloss per ASTM D523-89.
  - d. Uniform dry film thickness from 0.8 to 1.2 mil on all surface areas including fin edges.
  - e. Superior hardness characteristics of 2H per ASTM D3363-92A and cross-hatch adhesion of 4B-5B per ASTM D3359-93.
  - f. Impact resistance shall be up to 160 in.-lb (ASTM D2794-93).
  - g. Humidity and water immersion resistance shall be up to minimum 1000 and 250 hours respectively (ASTM D2247-92 and ASTM D870-92).
  - h. Corrosion durability shall be confirmed through testing to be no less than 1000 hours salt spray per ASTM B117-90.
- I. (23 81 19.13.I.) Refrigerant Components:
  1. Refrigerant circuit shall include the following control, safety, and maintenance features:
    - a. Thermostatic Expansion Valve (TXV) shall help provide optimum performance across the entire operating range. Shall contain removable power element to allow change out of power element and bulb without removing the valve body.
    - b. Refrigerant filter drier - Solid core design.
    - c. Service gauge connections on suction and discharge lines.
    - d. Suction line accumulator to provide protection in all operating modes from cooling, heating and reverse cycle switching.
  2. Compressors:
    - a. Unit shall use two tandem scroll compressors on single independent refrigeration circuit.
    - b. Units shall have single circuit and two stage cooling with two compressors.
    - c. Evaporator coils shall be a full active design to help better control comfort latent removal.
    - d. Compressor motors shall be cooled by refrigerant gas passing through motor windings.
    - e. Compressors shall be internally protected from high discharge temperature conditions.
    - f. Compressors shall be protected from an over-temperature and over-ampereage conditions by an internal, motor overload device.
    - g. Compressor shall be factory mounted on rubber grommets.
    - h. Compressor motors shall have internal line break thermal, current overload and high pressure differential protection.
    - i. Crankcase heaters shall not be required for normal operating range, unless required by compressor manufacturer due to refrigerant charge limits.
    - j. Compressors shall be a two stage cooling capacity design.
- J. (23 81 19.13.J.) Return Air Filter Section:
  1. Filters access is specified in the unit cabinet section of this specification.
  2. Filters shall be held in place by a pivoting filter tray, facilitating easy removal and installation.
  3. Shall consist of factory installed, low velocity, throw-away 2 in. thick fiberglass filters.
  4. Filters shall be standard, commercially available sizes.
  5. Only one size filter per unit is allowed.
- K. (23 81 19.13.K.) Evaporator Fan and Motor with X-Vane™ Fan Technology:
  1. Direct Drive Evaporator fan motor:
    - a. Shall be a ECM motor design.
    - b. Shall have permanently lubricated bearings.
    - c. Shall have inherent automatic-reset thermal overload protection.
    - d. Shall have slow ramp up to speed capabilities.
    - e. Shall require no fan/motor belts for operation, adjustments and or initial fan speed set up.
    - f. Fan DC voltage set up on Unit Control Board can eliminate the need of removal of blower access door, required on conventional belt drive systems.
    - g. Shall be internally protected from electrical phase reversal and loss.
  2. Evaporator Fan:
    - a. Shall be easily set with dedicated selection switch and adjustment pot on unit control board.
    - b. Shall provide two stage cooling capacity control, the indoor fan speed is automatically controlled to meet the code-compliant <66% low fan speed and 100% at full fan speed operation.
    - c. Blower fan shall be a Vane Axial fan design with 75% less moving parts than a conventional belt drive system.
    - d. Shall be constructed of a cast aluminum stator and high impact composite material on stator, rotor and air inlet casing.
    - e. Shall be a patented design with a corrosion resistant material and dynamically balanced.
    - f. Shall have slow ramp up to speed capabilities to help reduce sound and comfort

# Guide specifications (cont)

issues typically associated with single speed belt drive systems.

- g. Units shall contain two separate vane axial fan assemblies.
- h. Shall be a slide out design with removal of a few support brackets.
- 3. Shall include an easily accessible Unit Control Board to conveniently and safely provide connection points for vital control functions such as: smoke detectors, phase monitor, economizer, thermostat, and low, high and mixed air temperature switches. Controller shall also provide an intuitive means to adjust the indoor fan speed through a simple switch and pot adjustment design.
- L. (23 81 19.13.L.) Condenser Fans and Motors:
  - 1. Condenser fan motors:
    - a. Shall be a totally enclosed motor.
    - b. Shall use permanently lubricated bearings.
    - c. Shall have inherent thermal overload protection with an automatic reset feature.
    - d. Shall use a shaft-down design on all sizes.
  - 2. Condenser Fans:
    - a. Shall be a direct-driven propeller type fan.
    - b. Shall have galvalum blades riveted to steel spider that have corrosion-resistant properties and shall be dynamically balanced.
- M. (23 81 19.13.M.) Special Features Options and Accessories:
  - 1. Integrated EconoMi\$er® IV and EconoMi\$er X Low Leak rate models. (EconoMi\$er IV is only available as a field-installed accessory – this design only allows single speed fan operation.)
    - a. Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
    - b. Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory installed option.
    - c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
    - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
    - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
    - f. Standard leak rate shall be equipped with dampers not to exceed 2% leakage at 1 in. wg pressure differential.
  - g. Economizer controller on EconoMi\$er IV models shall be Honeywell W7212 that provides:
    - 1) Combined minimum and DCV maximum damper position potentiometers with compressor staging relay.
    - 2) Functions with solid-state analog enthalpy or dry bulb changeover control sensing.
    - 3) Contain LED indicates for: when free cooling is available, when module is in DCV mode, when exhaust fan contact is closed.
  - h. Economizer controller on EconoMi\$er X models shall be the Honeywell W7220 that provides:
    - 1) 2-line LCD interface screen for setup, configuration and troubleshooting.
    - 2) On-board Fault Detection and Diagnostics (FDD) that senses and alerts when the economizer is not operating properly, per California Title 24, ASHRAE 90.1 and IECC.
    - 3) Sensor failure loss of communication identification.
    - 4) Automatic sensor detection.
    - 5) Capabilities for use with multiple-speed or single speed indoor fan systems.
    - 6) Utilize digital sensors: Dry bulb and Enthalpy.
  - i. Shall be capable of introducing up to 100% outdoor air.
  - j. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
  - k. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
  - l. Dry bulb outdoor air temperature sensor shall be provided as standard. Enthalpy sensor is also available on factory installed only. Outdoor air sensor setpoint shall be adjustable and shall range from 40°F to 100°F (4°C to 38°C). Additional sensor options shall be available as accessories.
  - m. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.
  - n. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy.
  - o. Dampers shall be completely closed when the unit is in the unoccupied mode.

## Guide specifications (cont)

- p. Economizer controller shall accept a 2 to 10 vdc CO<sub>2</sub> sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
  - q. Compressor lockout temperature on W7220 control is adjustable from -45°F to 80°F (-43°C to 27°C), set at a factory default of 32°F (0°C). W7212 control opens at 35°F (2°C) and closes at 50°F (10°C).
  - r. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
  - s. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
2. Integrated EconoMi\$er X Ultra Low Leak rate models.
- a. Integrated, gear driven opposing modulating blade design type capable of simultaneous economizer and compressor operation.
  - b. Independent modules for vertical or horizontal return configuration shall be available. Vertical return modules shall be available as a factory-installed option.
  - c. Damper blades shall be galvanized steel with composite gears. Plastic or composite blades on intake or return shall not be acceptable.
  - d. Shall include all hardware and controls to provide free cooling with outdoor air when temperature and/or humidity are below setpoints.
  - e. Shall be equipped with gear driven dampers for both the outdoor ventilation air and the return air for positive air stream control.
  - f. Ultra Low Leak design meets California Title 24 section 140.4 and ASHRAE 90.1 requirements for 4 cfm per sq ft on the outside air dampers and 10 cfm per sq ft on the return dampers.
  - g. Economizer controller on EconoMi\$er X models shall be the Honeywell W7220 that provides:
    - 1) 2-line LCD interface screen for setup, configuration and troubleshooting.
    - 2) On-board Fault Detection and Diagnostics (FDD) that senses and alerts when the economizer is not operating properly, per California Title 24, ASHRAE 90.1 and IECC.
    - 3) Sensor failure loss of communication identification.
    - 4) Automatic sensor detection.
    - 5) Capabilities for use with multiple-speed indoor fan systems.
- 6) Utilize digital sensors: Dry bulb and Enthalpy.
  - h. Shall be capable of introducing up to 100% outdoor air.
  - i. Shall be equipped with a barometric relief damper capable of relieving up to 100% return air and contain seals that meet ASHRAE 90.1 requirements.
  - j. Shall be designed to close damper(s) during loss-of-power situations with spring return built into motor.
  - k. Dry bulb outdoor air temperature sensor shall be provided as standard. Enthalpy sensor is also available on factory installed only. Outdoor air sensor setpoint shall be adjustable and shall range from 40°F to 100°F (4°C to 38°C). Additional sensor options shall be available as accessories.
  - l. The economizer controller shall also provide control of an accessory power exhaust unit function. Factory set at 100%, with a range of 0% to 100%.
  - m. The economizer shall maintain minimum airflow into the building during occupied period and provide design ventilation rate for full occupancy.
  - n. Dampers shall be completely closed when the unit is in the unoccupied mode.
  - o. Economizer controller shall accept a 2 to 10 vdc CO<sub>2</sub> sensor input for IAQ/DCV control. In this mode, dampers shall modulate the outdoor air damper to provide ventilation based on the sensor input.
  - p. Compressor lockout temperature on W7220 control is adjustable from -45°F to 80°F (-43°C to 27°C), set at a factory default of 32°F (0°C). W7212 control opens at 35°F (2°C) and closes at 50°F (10°C).
  - q. Actuator shall be direct coupled to economizer gear. No linkage arms or control rods shall be acceptable.
  - r. Economizer controller shall provide indications when in free cooling mode, in the DCV mode, or the exhaust fan contact is closed.
3. Two-Position Damper (field-installed only):
- a. Damper shall be a Two-Position Damper. Damper travel shall be from the full closed position to the field adjustable %-open setpoint.
  - b. Damper shall include adjustable damper travel from 25% to 100% (full open).
  - c. Damper shall include single or dual blade, gear driven dampers and actuator motor.
  - d. Actuator shall be direct coupled to damper gear. No linkage arms or control rods shall be acceptable.

# Guide specifications (cont)

- e. Damper will admit up to 100% outdoor air for applicable rooftop units.
  - f. Damper shall close upon indoor (evaporator) fan shutoff and/or loss of power.
  - g. The damper actuator shall plug into the rooftop unit's wiring harness plug. No hard wiring shall be required.
  - h. Outside air hood shall include aluminum water entrainment filter.
4. Manual Damper (field-installed only):
- a. Manual damper package shall consist of damper, air inlet screen, and rain hood which can be preset to admit up to 25% or 50% outdoor air for year round ventilation.
5. Low Ambient Control Package:
- a. Controller shall control coil head pressure by condenser fan speed modulation or condenser fan cycling and wind baffles.
  - b. Shall consist of solid-state control and condenser coil temperature sensor to maintain condensing temperature between 90°F (32°C) and 110°F (43°C) at outdoor ambient temperatures down to 0°F (-18°C).
6. Condenser Coil Hail Guard Assembly:
- a. Shall protect against damage from hail.
  - b. Shall be either hood style or louvered.
7. Unit-Mounted, Non-Fused Disconnect Switch:
- a. Switch shall be factory installed, internally mounted.
  - b. National Electric Code (NEC) and UL approved non-fused switch shall provide unit power shutoff.
  - c. Shall be accessible from outside the unit.
  - d. Shall provide local shutdown and lockout capability.
  - e. Sized only for the unit as ordered from the factory. Does not accommodate field-installed devices.
8. Convenience Outlet:
- a. Powered convenience outlet.
    - 1) Outlet shall be powered from main line power to the rooftop unit.
    - 2) Outlet shall be powered from line side or load side of disconnect by installing contractor, as required by code. If outlet is powered from load side of disconnect, unit electrical ratings shall be UL certified and rated for additional outlet amperage.
    - 3) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
    - 4) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
- 5) Voltage required to operate convenience outlet shall be provided by a factory installed step-down transformer.
  - 6) Outlet shall be accessible from outside the unit.
  - 7) Outlet shall include a field installed "Wet in Use" cover.
- b. Factory-Installed Non-Powered convenience outlet.
  - 1) Outlet shall be powered from a separate 115/120v power source.
  - 2) A transformer shall not be included.
  - 3) Outlet shall be factory-installed and internally mounted with easily accessible 115-v female receptacle.
  - 4) Outlet shall include 15 amp GFI receptacles with independent fuse protection.
  - 5) Outlet shall be accessible from outside the unit.
  - 6) Outlet shall include a field installed "Wet in Use" cover.
- c. Field-Installed Non-Powered convenience outlet.
  - 1) Outlet shall be powered from a separate 115/120v power source.
  - 2) A transformer shall not be included.
  - 3) Outlet shall be field-installed and internally mounted with easily accessible 115-v female receptacle.
  - 4) Outlet shall include 20 amp GFI receptacles. This kit provides a flexible installation method which allows code compliance for height requirements of the GFCI outlet from the finished roof surface as well as the capability to relocate the outlet to a more convenient location.
  - 5) Outlet shall be accessible from outside the unit.
  - 6) Outlet shall include a field installed "Wet in Use" cover.
9. Centrifugal Fan Power Exhaust:
- a. Power exhaust shall be used in conjunction with an integrated economizer.
  - b. Independent modules for vertical or horizontal return configurations shall be available.
  - c. Horizontal power exhaust shall be mounted in return ductwork.
  - d. Power exhaust shall be controlled by economizer controller operation. Exhaust fans shall be energized when dampers open past the 0 to 100% adjustable setpoint on the economizer control.

# Guide specifications (cont)

10. Roof Curbs (Vertical):
  - a. Full perimeter roof curb with exhaust capability providing separate air streams for energy recovery from the exhaust air without supply air contamination.
  - b. Formed galvanized steel with wood nailer strip and shall be capable of supporting entire unit weight.
  - c. Permits installation and securing of ductwork to curb prior to mounting unit on the curb.
11. Outdoor Air Enthalpy Sensor:
  - a. The outdoor air enthalpy sensor shall be used to provide single enthalpy control. When used in conjunction with a return air enthalpy sensor, the unit will provide differential enthalpy control. The sensor allows the unit to determine if outside air is suitable for free cooling.
12. Return Air Enthalpy Sensor:
  - a. The return air enthalpy sensor shall be used in conjunction with an outdoor air enthalpy sensor to provide differential enthalpy control.
13. Indoor Air Quality (CO<sub>2</sub>) Sensor:
  - a. Shall be able to provide demand ventilation indoor air quality (IAQ) control.
  - b. The IAQ sensor shall be available in duct mount, wall mount, or wall mount with LED display. The setpoint shall have adjustment capability.
14. Smoke Detectors:
  - a. Shall be a four-wire controller and detector.
  - b. Shall be environmental compensated with differential sensing for reliable, stable, and drift-free sensitivity.
  - c. Shall use magnet-activated test/reset sensor switches.
  - d. Shall have tool-less connection terminal access.
  - e. Shall have a recessed momentary switch for testing and resetting the detector.
  - f. Controller shall include:
    - 1) One set of normally open alarm initiation contacts for connection to an initiating device circuit on a fire alarm control panel.
    - 2) Two Form-C auxiliary alarm relays for interface with rooftop unit or other equipment.
    - 3) One Form-C supervision (trouble) relay to control the operation of the Trouble LED on a remote test/reset station.
    - 4) Capable of direct connection to two individual detector modules.
- 5) Can be wired to up to 14 other duct smoke detectors for multiple fan shut-down applications.
15. Winter Start Kit:
  - a. Shall contain a bypass device around the low pressure switch.
  - b. Shall be required when mechanical cooling is required down to 25°F (−4°C).
  - c. Shall not be required to operate on an economizer when below an outdoor ambient of 40°F (4°C).
16. Time Guard:
  - a. Shall prevent compressor short-cycling by providing a 5 minute delay (±2 minutes) before restarting a compressor after shut-down for any reason.
  - b. One device shall be required per compressor.
17. Hinged Access Panels:
  - a. Shall provide easy access through integrated quarter turn latches.
  - b. Shall be on major panels of: filter, control box, fan motor, and compressor.
18. 4 in. filter rack kit:
  - a. The 4 in. filter rack accessory kit is designed to hold 4 in. MERV-8 or MERV-13 filters. Filters not included in kit.
19. Phase Monitor Control:
  - a. Shall monitor the sequence of three phase electrical system to provide a phase reversal protection.
  - b. Shall monitor the three phase voltage inputs to provide a phase loss protection for the three phase device.
  - c. Will work on either a Delta or Wye power connection.
20. Horn/Strobe Annunciator:
  - a. Provides an audible/visual signaling device for use with factory-installed option or field installed accessory smoke detectors.
    - 1) Requires installation of a field-supplied 24-v transformer suitable for 4.2 VA (AC) or 3.0 VA (DC) per horn/strobe accessory.
    - 2) Requires field-supplied electrical box, North American 1-gang box, 2 in. (51 mm) x 4 in. (102 mm).
    - 3) Shall have a clear colored lens.
21. Electric Heat:
  - a. Heating Section:
    - 1) Heater element open coil resistance wire, nickel-chrome alloy, 0.29 inches inside diameter, strung through ceramic insulators mounted on metal frame. Coil ends are staked and welded to terminal screw slots.

## Guide specifications (cont)

- 2) Heater assemblies are provided with integral fusing for protection of internal heater circuits not exceeding 48 amps each. Auto reset thermo limit controls, magnetic heater contactors (24 v coil) and terminal block all mounted in electric heater control box (minimum 18 ga galvanized steel) attached to end of heater assembly.

© 2023 Carrier  
Lewisburg, Tennessee 37091 USA  
[www.GoICPCommercial.com](http://www.GoICPCommercial.com)